KEY NOTES

1. PROVIDE NEW SEISMIC SUPPORT FOR TRAPEZE PIPING SUPPORTS IN TUNNEL. THIS SHALL BE A PART OF PHASE 3 WORK.
2. AFTER ALL PHASES ARE COMPLETE AND ALL PNEUMATIC CONTROLS ARE REPLACED WITH DIRECT DIGITAL CONTROLS THE (E) AIR COMPRESSOR WITH ALL ASSOCIATED PNEUMATIC CONTROLS SHALL BE REMOVED.

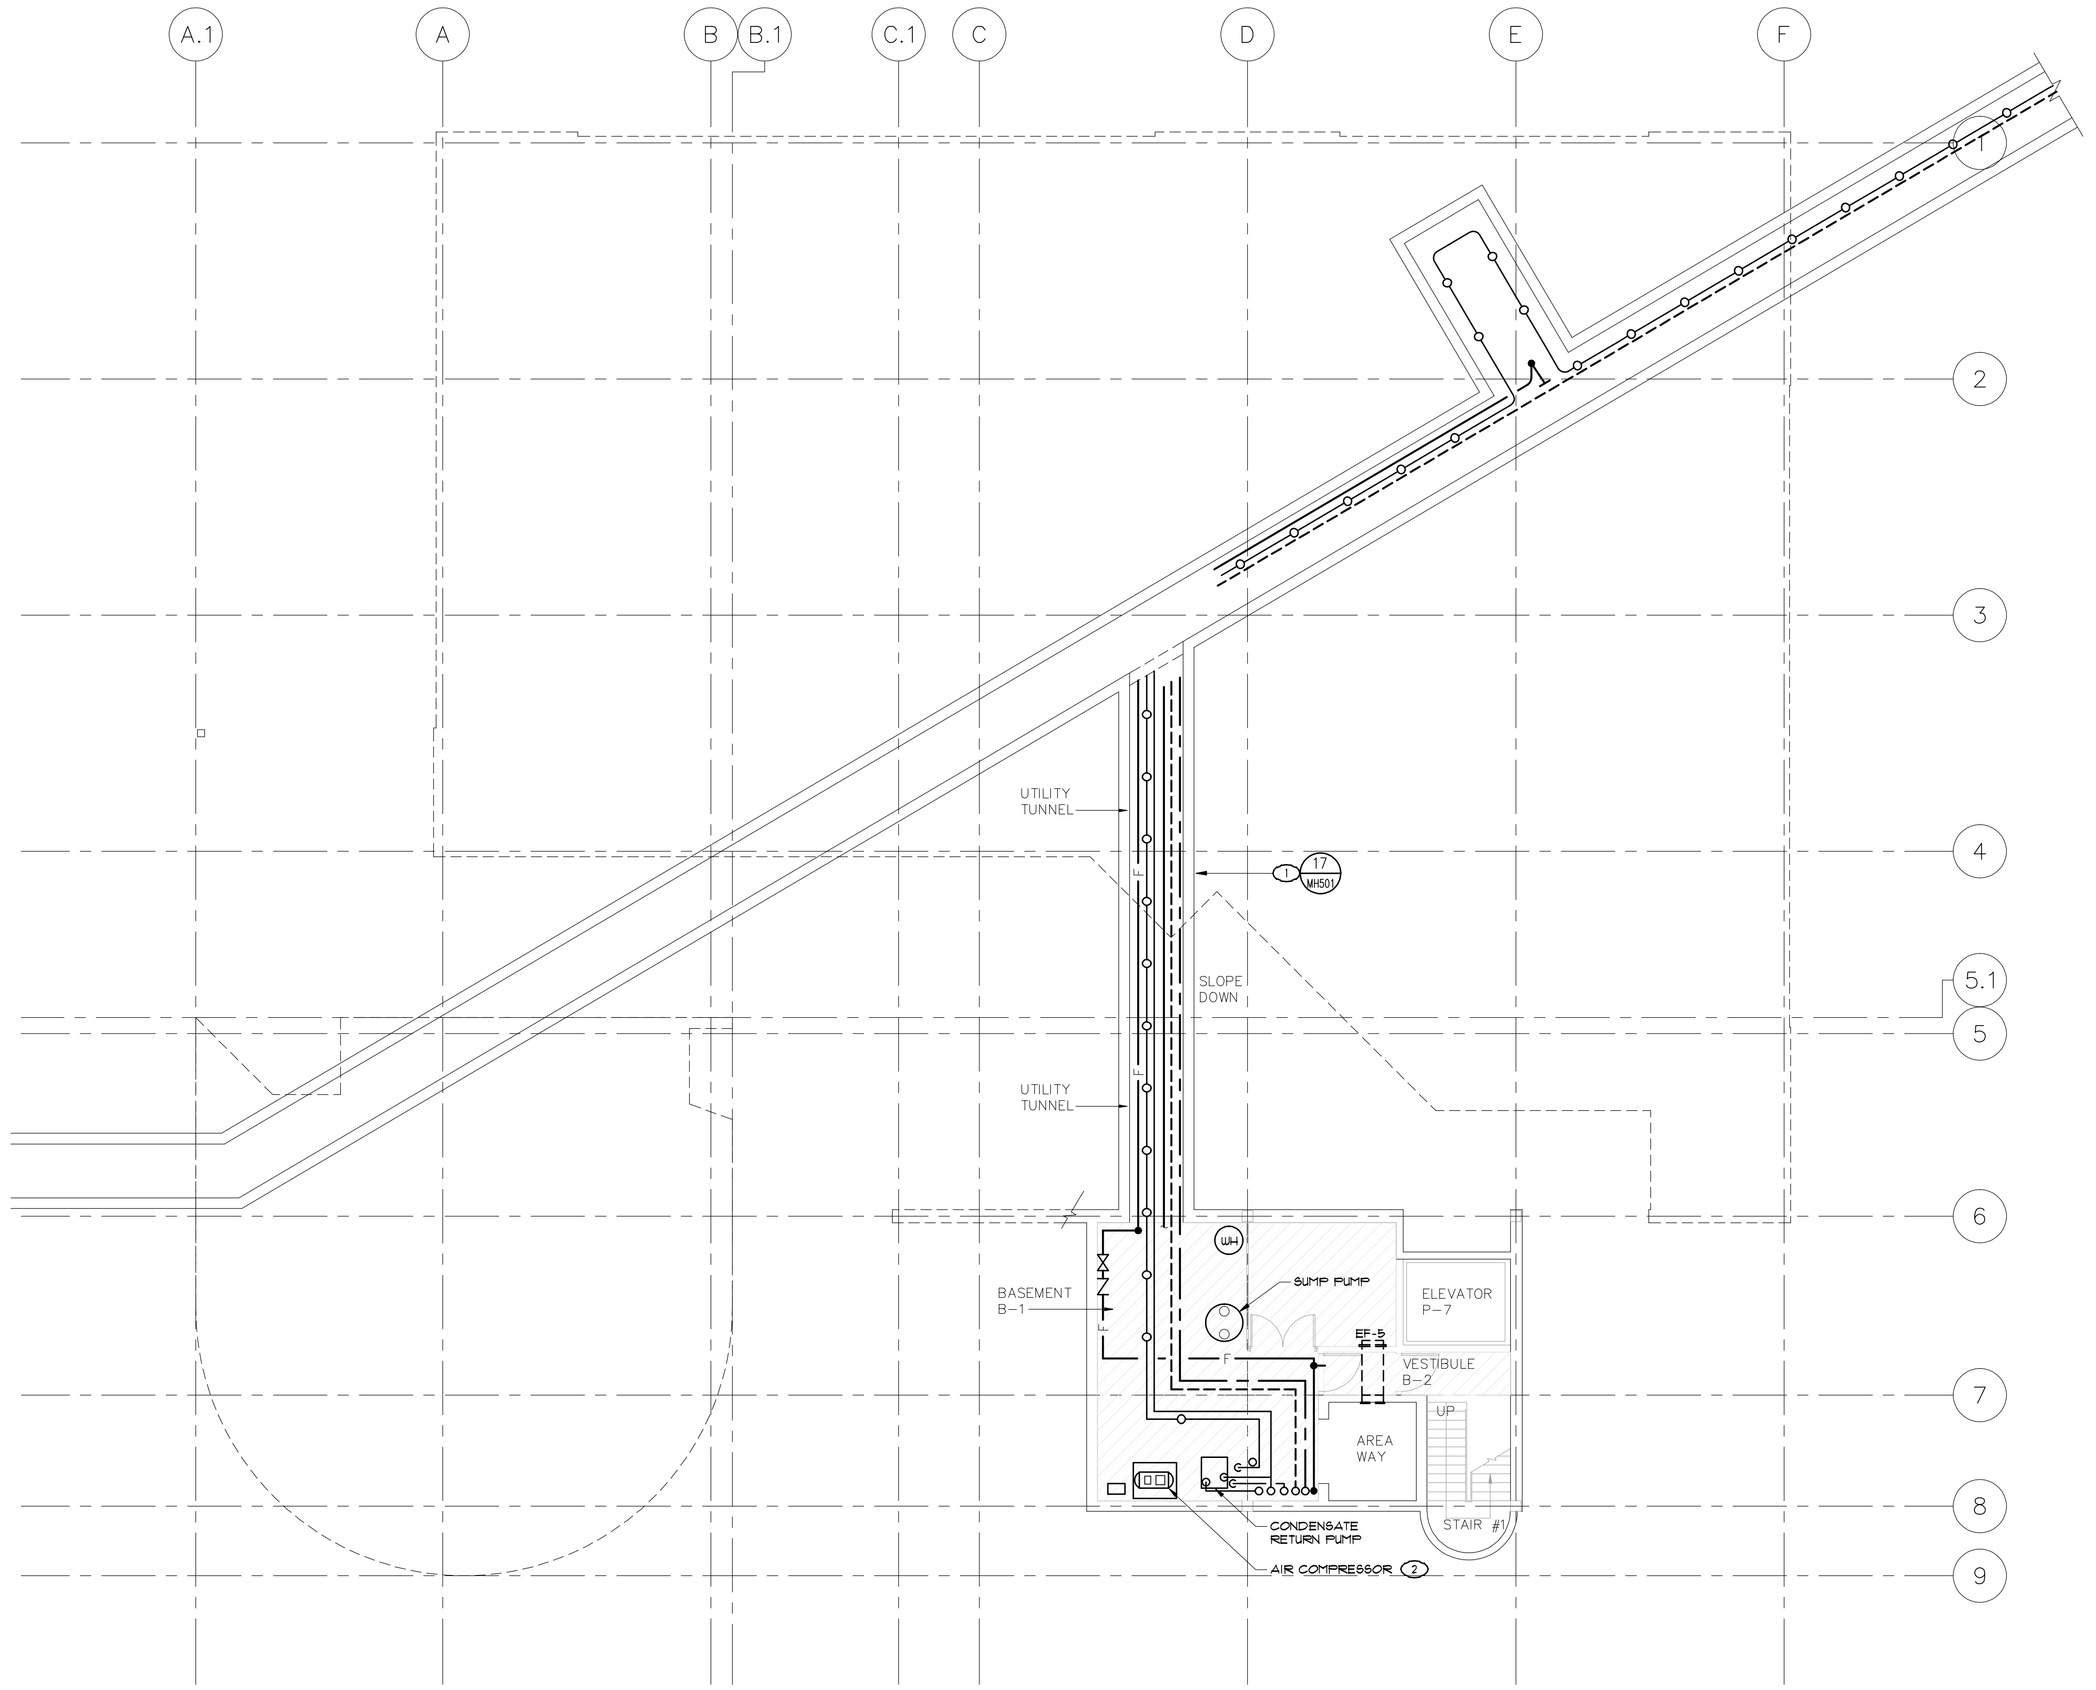

1 BASEMENT MECHANICAL FLOOR PLAN
SCALE: 1/8" = 1'-0"

Revisions:	Date

CONSULTANTS:

LP Consulting Engineers, Inc.
895 W. Ashlan Ave, Suite 101 Clovis, CA 93612
p 559-348-2130 - f 559-348-2131
www.lpengineers.com
Job #: 10-1098

ARCHITECT/ENGINEERS:

HMC Architects
1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title	BASEMENT MECHANICAL FLOOR PLAN
Approved: Project Director	
Project Title	BUILDING 24 SEISMIC CORRECTION AND ADDITION
Location	VAMC FRESNO, CA
Date	March 12, 2013
Checked	K.K.
Drawn	D.N.
Project Number	570-215
Building Number	24
Drawing Number	MH100 Dwg. 136 of 180

Office of Construction and Facilities Management
Department of Veterans Affairs

VA FORM 08-6231