


NOTE: EMS CONTROL PANELS SHALL BE MOUNTED ON SIDE OF EACH AH AND (1) MOUNTED NEAR HX-1 IN PENTHOUSE. PROVIDE ROUTER AND INTEGRATE WITH (E) EMS SYSTEM. DUCT SMOKE DETECTORS SHALL BE PROVIDED AND INSTALLED IN DUCT BY MECHANICAL AND WIRED BY ELECTRICAL.

[illegible]

LP
LP Consulting
Engineers, Inc.
885 W. Ashton Ave., Suite 101 Clark, CA 95611
p 916-346-2130 - f 916-346-2131
www.lppacific.com
Job #: 10-71096

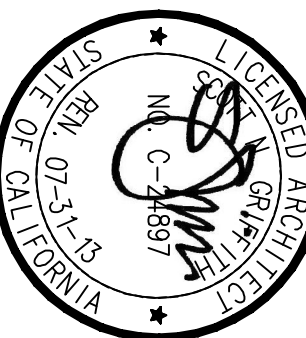

HMC Architects
1827 E. Ft. Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title
ENERGY MANAGEMENT
SYSTEM (EMS)

Project Title
BUILDING 24
SEISMIC CORRECTION
AND ADDITION

Project Number	570-215
Building Number	24

**Office of
Construction
and Facilities
Management**