KEY NOTES

1. REFRIGERANT PIPING DROPS IN WALL FROM THIRD FLOOR DOWN TO FIRST FLOOR, SEE SHEET MP1@3 & MP1@1 FOR CONTINUATION OF PIPING. SEE SHEET MH6@2 FOR PIPE SIZES ON SCHEMATICS.
2. VAV BOX WITH REHEAT COIL, REPLACE ALL COIL PIPING VALVES ALONG WITH ALL ASSOCIATED CONTROLS.
3. VAV BOX, WITH NO HOT WATER COIL.

EQUIPMENT NOTE

REFER TO SHEETS MH6@@ AND MH6@1 FOR EQUIPMENT SCHEDULES.

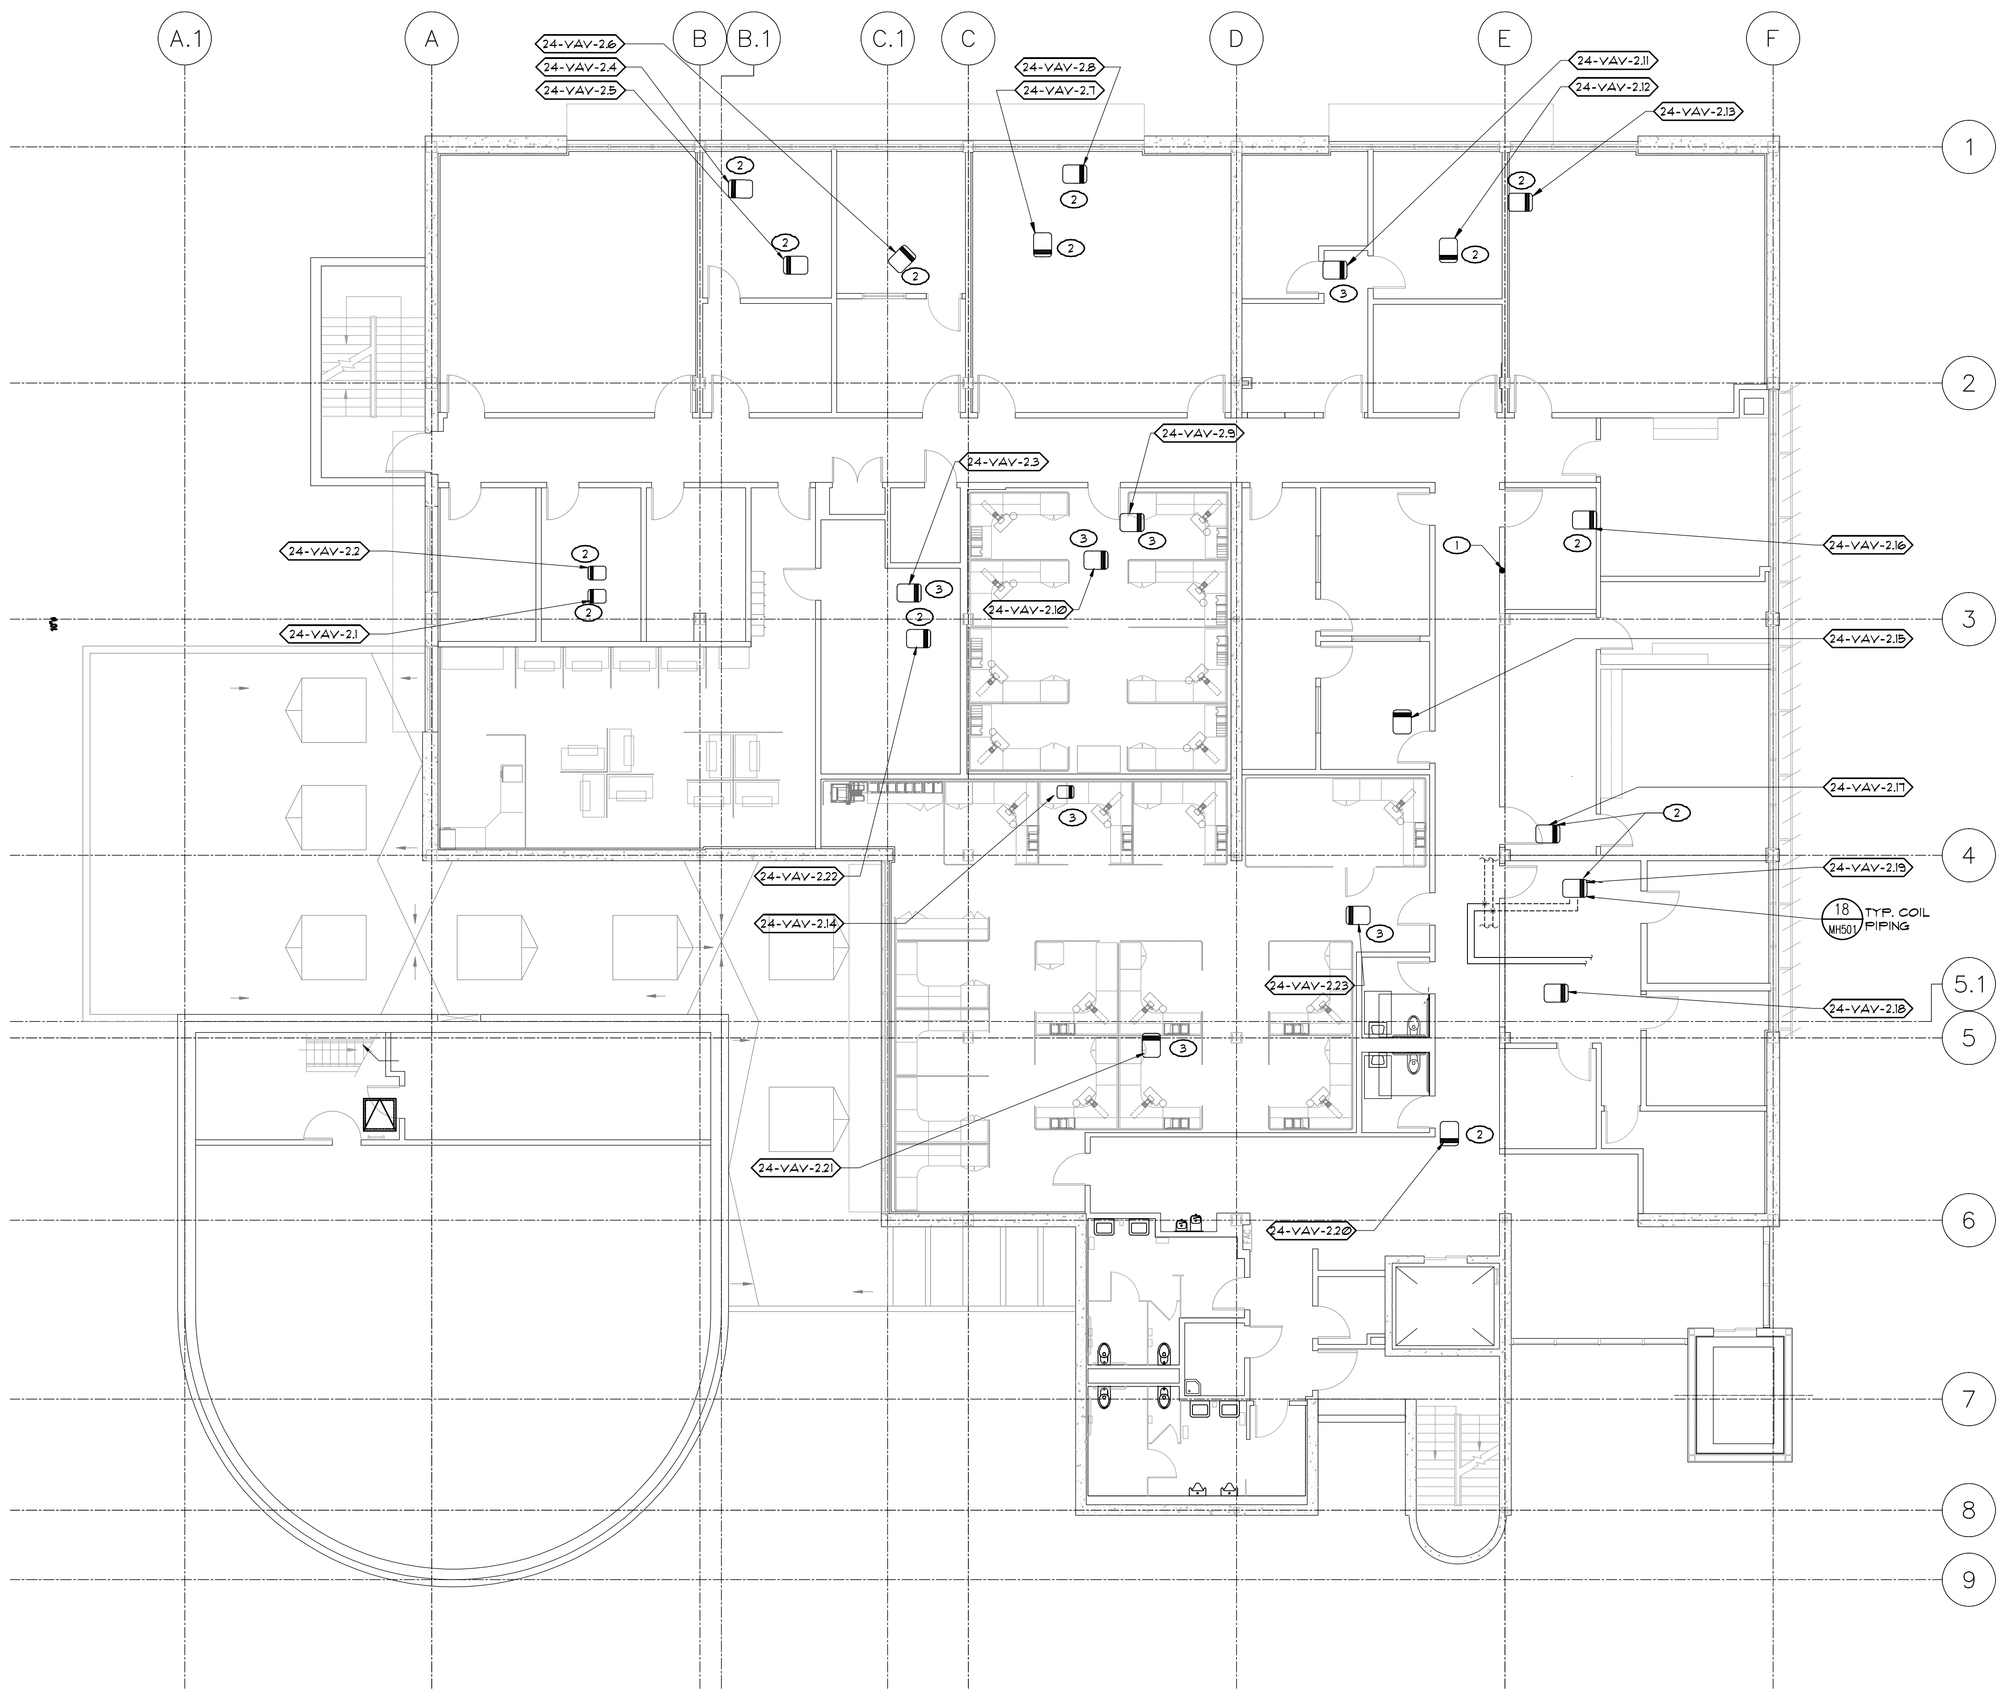

1 FIRST FLOOR MECHANICAL REMODEL PIPING PLAN
SCALE: 1/8" = 1'-0"

Revisions:	Date

CONSULTANTS:

LP Consulting Engineers, Inc.
895 W. Ashlan Ave, Suite 101 Clovis, CA 93612
p 559-348-2130 - f 559-348-2131
www.lpengineers.com
Job #: 10-1006

ARCHITECT/ENGINEERS:

HMC Architects
1827 E. Fir Avenue, Studio 103 / Fresno, CA 93720
T 559 322 2444 / www.hmcarchitects.com

Drawing Title	SECOND FLOOR MECHANICAL REMODEL PIPING PLAN
Approved Project Director	
Project Title	BUILDING 24 SEISMIC CORRECTION AND ADDITION
Location	VAMC FRESNO, CA
Date	March 12, 2013
Checked	K.K.
Drawn	D.N.
Project Number	570-215
Building Number	24
Drawing Number	MP102
Dwg. 148 of 180	

Office of Construction and Facilities Management
Department of Veterans Affairs

VA FORM 08-6231