


FIRST FLOOR HVAC ELECTRICAL PLAN NOTES:

1. NEW VAV BOX TO REPLACE EXISTING. RECONNECT EXISTING CONTROL WIRING.
2. NEW AIR HANDLER MOTORS TO REPLACE EXISTING. DISCONNECT EXISTING ELECTRICAL. CONNECT NEW MOTORS TO EXISTING POWER WIRING.
3. NEW FAN COIL IN ATTIC. VERIFY CONNECTION LOCATION AND REQUIREMENT IN FIELD WITH HVAC CONTRACTOR. PROVIDE NEW NON-FUSED DISCONNECT SWITCH IN ACCESSIBLE ATTIC. AT LOCATION WITH MINIMUM 30" X 36" FRONT WORKING CLEARANCE.
4. RUN 3/4" C WITH 2#12 + 1#12 GROUND TO EXISTING PANEL "P1A". PROVIDE NEW 15A/2P BREAKER IN PANEL. PROVIDE NEW IDENTIFICATION LABEL AT BREAKER.
5. TYPICAL: DENOTE MECHANICAL UNIT IDENTIFICATION. REFER TO SCHEDULES ON SHEETS MH600 & MH601.
6. CONNECT IDU. VERIFY CONNECTION LOCATION AND REQUIREMENT IN FIELD.
7. HANGFRAIN TO EXISTING PANEL. CONNECT TO NEW BREAKER. WITH PADLOCKABLE LOCK-OFF DEVICE AT HANDLE TO BE USED AS DISCONNECT.
8. EXISTING SWITCH AND WIRING FOR EXISTING HVAC EQUIPMENT CONTROL. TO REMAIN.
9. ELECTRICAL WORK FOR NEW HVAC EQUIPMENT SHALL BE INCLUDED IN DEDUCTIVE ALTERNATE 4.



CONSULTANTS:

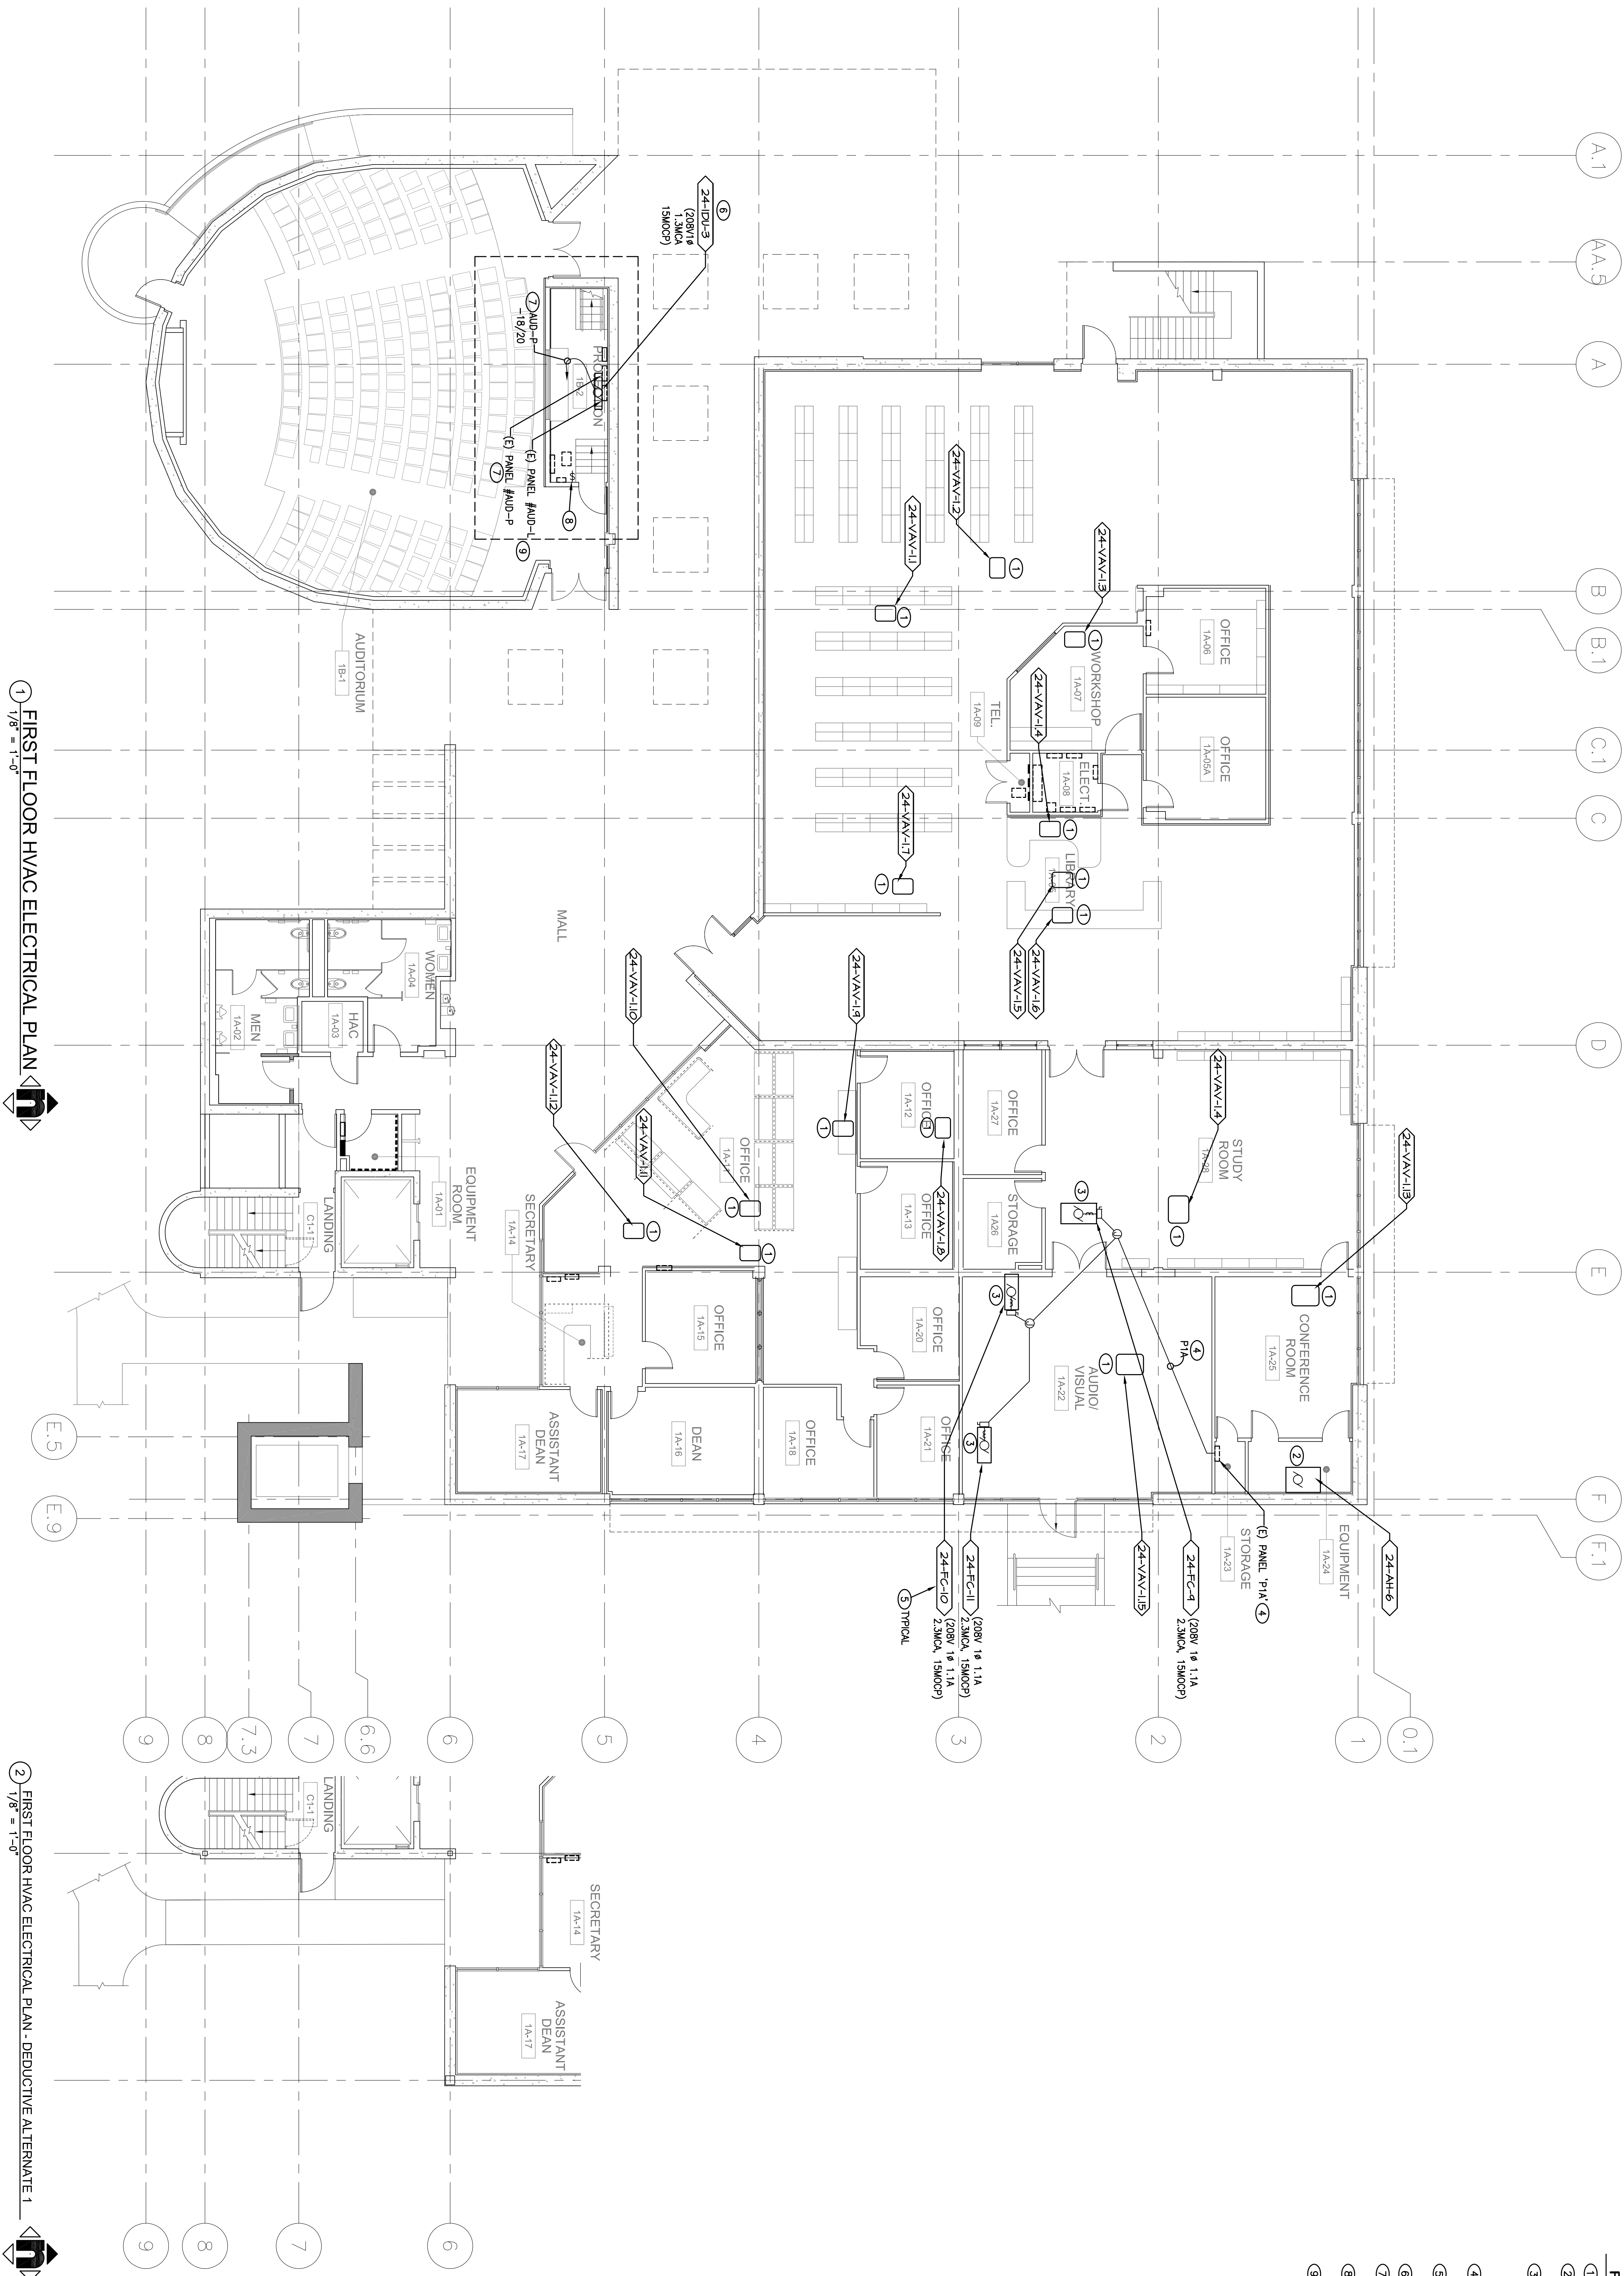

ARCHITECT/ENGINEERS:



Drawing Title  
FIRST FLOOR HVAC ELECTRICAL PLAN

Project Title  
BUILDING 24  
SEISMIC CORRECTION  
AND ADDITION

Approved Project Director  
Location  
VAMC FRESNO, CA

Date  
March 12, 2018  
Checked  
FK  
Drawn  
FK/LJS

Project Number  
570-215

Building Number  
24

Drawing Number  
ESI04

Dwg. T70 of 180

Office of  
Construction  
and Facilities  
Management

