


KEY NOTES

- 01 DEMO EXISTING EXHAUST GRILLE AND DUCTWORK AS SHOWN ON PLANS. PRIOR TO DEMO, RECORD GRILLE EXHAUST CFM AND TOTAL EXHAUST FAN CFM.
- 02 DEMO EXISTING SUPPLY GRILLE AND FLEXIBLE DUCTWORK. PRIOR TO DEMO, RECORD SUPPLY CFM.
- 03 DEMO EXISTING IN-WALL HEATER AND ASSOCIATED CONTROLS.
- 04 EXISTING THERMOSTAT TO BE RELOCATED.
- 05 RECORD AIRFLOW AND STATIC PRESSURE IN DUCTWORK DOWNSTREAM OF TERMINAL BOX PRIOR TO SYSTEM MODIFICATIONS.
- 06 DEMO EXISTING EXHAUST GRILLE AND DUCTWORK BACK TO MAIN. CAP AND SEAL AIR TIGHT.
- 07 REMOVE TEMP TRAC MONITOR AND SAVE FOR RELOCATION TO NEW CLEAN SUPPLY ROOM 2437A.
- 08 DEMO EXISTING HEPA FAN/FILTER UNIT AND RETURN TO OWNER OR DISPOSE OF AS DIRECTED.
- 09 DEMO EXISTING LIEBERT UNIT AND ASSOCIATED CONTROLS, RETURN TO OWNER. DEMO ASSOCIATED ELECTRICAL BACK TO PANEL.
- 10 REMOVE EXISTING HEPA FAN/FILTER CONTROLLER, PRESSURE MONITOR/ALARM, ASSOCIATED SENSORS AND POWER BACK TO ELECTRICAL PANEL OR JUNCTION BOX. RETURN TO OWNER OR DISPOSE OF AS DIRECTED. PATCH/REPAIR WALL TO MATCH EXISTING.


DEMOLITION LEGEND

SYMBOL	DESCRIPTION
—————	EXISTING TO REMAIN
-----	EXISTING TO BE REMOVED
	DEMO TO THIS POINT



1 SECOND FLOOR DEMO - DUCTWORK
1/8" = 1'-0"

95% SUBMISSION - NOT FOR CONSTRUCTION

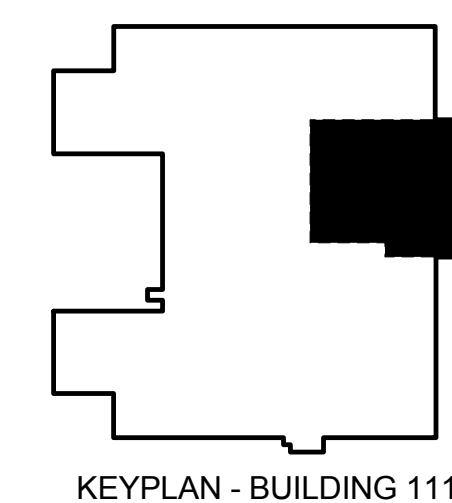

<div>Stamp / Seal</div> <div> <div> <div>THESE DOCUMENTS ARE FOR INTERIM REVIEW AND NOT INTENDED FOR CONSTRUCTION, BIDDING, OR PERMIT PURPOSES.</div> <div>2-14-2013</div> <div>ENGINEER OF RECORD</div> <div>DARREN LEE HARVEY, PE</div> <div>STATE: KANSAS</div> <div>REGISTRATION #: 19666</div> </div> </div> <div> <div>Revisions:</div> <div></div> <div>Date</div> </div>	<div>CONSULTANTS:</div> <div>  <div> <div>9201 West Broadway</div> <div>Brooklyn Park, MN 55445</div> <div>Tel: 763.315.7600</div> <div>Fax: 763.315.7600</div> </div> </div>		<div>ARCHITECT/ENGINEERS:</div> <div>  <div> <div>CHICAGO</div> <div>345 N. Canal Street Suite 701</div> <div>Chicago, Illinois 60606</div> <div>T: 312.454.9434</div> <div>F: 312.454.9439</div> </div> <div> <div>AUSTIN</div> <div>5121 Bee Cave Road #203</div> <div>Austin, Texas 78746</div> <div>T: 512.327.4149</div> <div>F: 512.327.7679</div> </div> </div>		<div>Drawing Title</div> <div>SECOND FLOOR DEMOLITION - DUCTWORK</div>		<div>Project Number</div> <div>111 RENOVATE X-RAY 5</div>		<div>Project Name</div> <div>111 RENOVATE X-RAY 5</div>		<div>Project Number</div> <div>695-12-195</div>		<div>Office of Construction and Facilities Management</div> 
	<div>Location</div> <div>CLEMENT J. ZABLOCKI VA MEDICAL CENTER MILWAUKEE, WI</div>		<div>Building Number</div> <div>111</div>		<div>Checked</div> <div>DLH</div>		<div>Drawn</div> <div>EPS</div>		<div>Drawing Number</div> <div>MD-101</div>		<div>Dwg. of</div>		