


- GENERAL NOTES:**
- REFER TO 4/ES-701 FOR MORE INFORMATION.
 - REFER TO SIEMENS YS10 DRAWINGS FOR MORE REQUIREMENTS.


- KEYED NOTES:**
- (3)#2, #2G., 1-1/4".
 - NEW 70A/3P ENCLOSED CIRCUIT BREAKER. COORDINATE WITH SPECIFICATIONS AND SIEMENS REQUIREMENTS FOR X-RAY EQUIPMENT.

1 POWER RISER DIAGRAM
N.T.S.

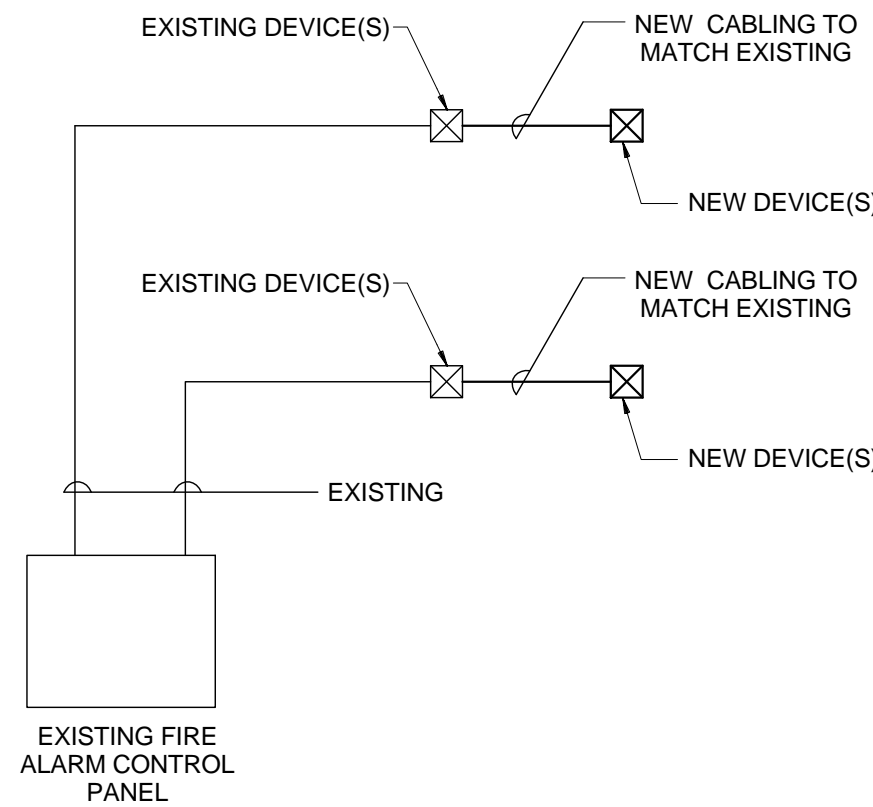

- GENERAL NOTES:**
- CONTRACTOR SHALL FIELD VERIFY WHICH EXISTING FIRE ALARM CIRCUITS ARE TO BE AFFECTED. QUANTITY OF CIRCUITS SHOWN HERE IS SCHEMATIC IN NATURE AND DOES NOT INDICATE ACTUAL QUANTITIES.

2 FIRE ALARM RISER DIAGRAM
N.T.S.

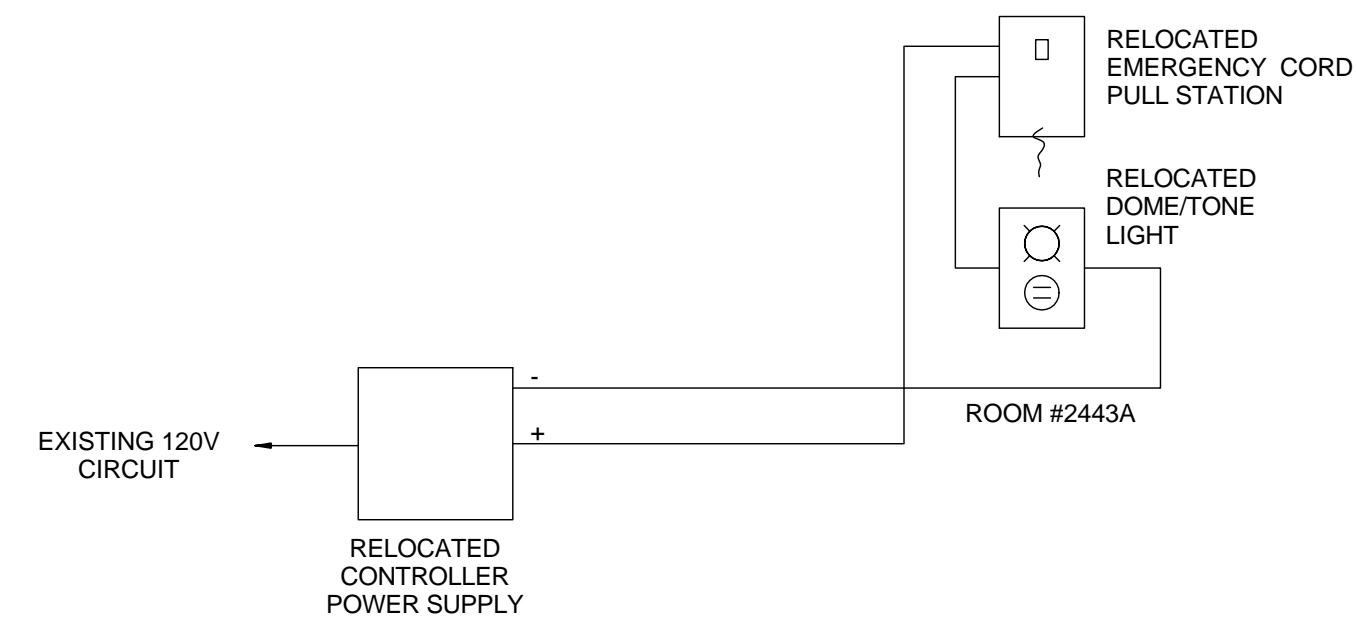

- NOTES:**
- MOUNT DOME LIGHTS AT CEILING.
 - SEE SHEET ES-501 FOR DEVICE LOCATIONS.
 - MOUNT POWER SUPPLY NEAR CEILING.
 - MOUNT PIEZO HORN BEHIND DOME LIGHT. WIRE IN PARALLEL.

3 EMERGENCY CALL SYSTEM DETAIL
N.T.S.

95% SUBMISSION - NOT FOR CONSTRUCTION

Revisions:		Date		Stamp / Seal		CONSULTANTS:		ARCHITECT/ENGINEERS:		Drawing Title		Project Name		Project Number		Office of Construction and Facilities Management	
						IEA		COX DESIGN ASSOCIATES		ELECTRICAL DIAGRAMS		111 RENOVATE X-RAY 5		695-12-195			
						SSR Smith Seckman Reid, Inc.		ARCHITECTURE PLANNING INTERIORS				Date		02.14.13			
						9201 West Broadway Brooklyn Park, MN 55445 Tel: 763.315.7900 Fax: 763.315.7920		CHICAGO 345 N. Canal Street Suite 701 Chicago, Illinois 60606 T: 312.454.9434 F: 312.454.9439		AUSTIN 5121 Bee Cave Road #203 Austin, Texas 78746 T: 512.327.4149 F: 512.327.7679		Location		Drawing Number			
										CLEMMENT J. ZABLOCKI VA MEDICAL CENTER MILWAUKEE, WI		Building Number		Checked		Drawn	
												111		Checker		Author	
																ES-601	
																Dwg. of	