


NOTES FOR TEMPORARY HVAC UNITS



1. FOR ROOF PROTECTION, LAY DOWN 2 LAYERS 30# FELT AND PRESSURE-TREATED 2"x12" FOR SKID TO SIT ON.
2. CONNECT TEMPORARY POWER TO PANEL LOCATED IN MECHANICAL ROOM. COORDINATE CONNECTION WITH VA PERSONNEL.
3. CONSTRUCTION SHALL BE PHASED TO REPLACE AHU-1A DURING COOLING MONTHS IF POSSIBLE.

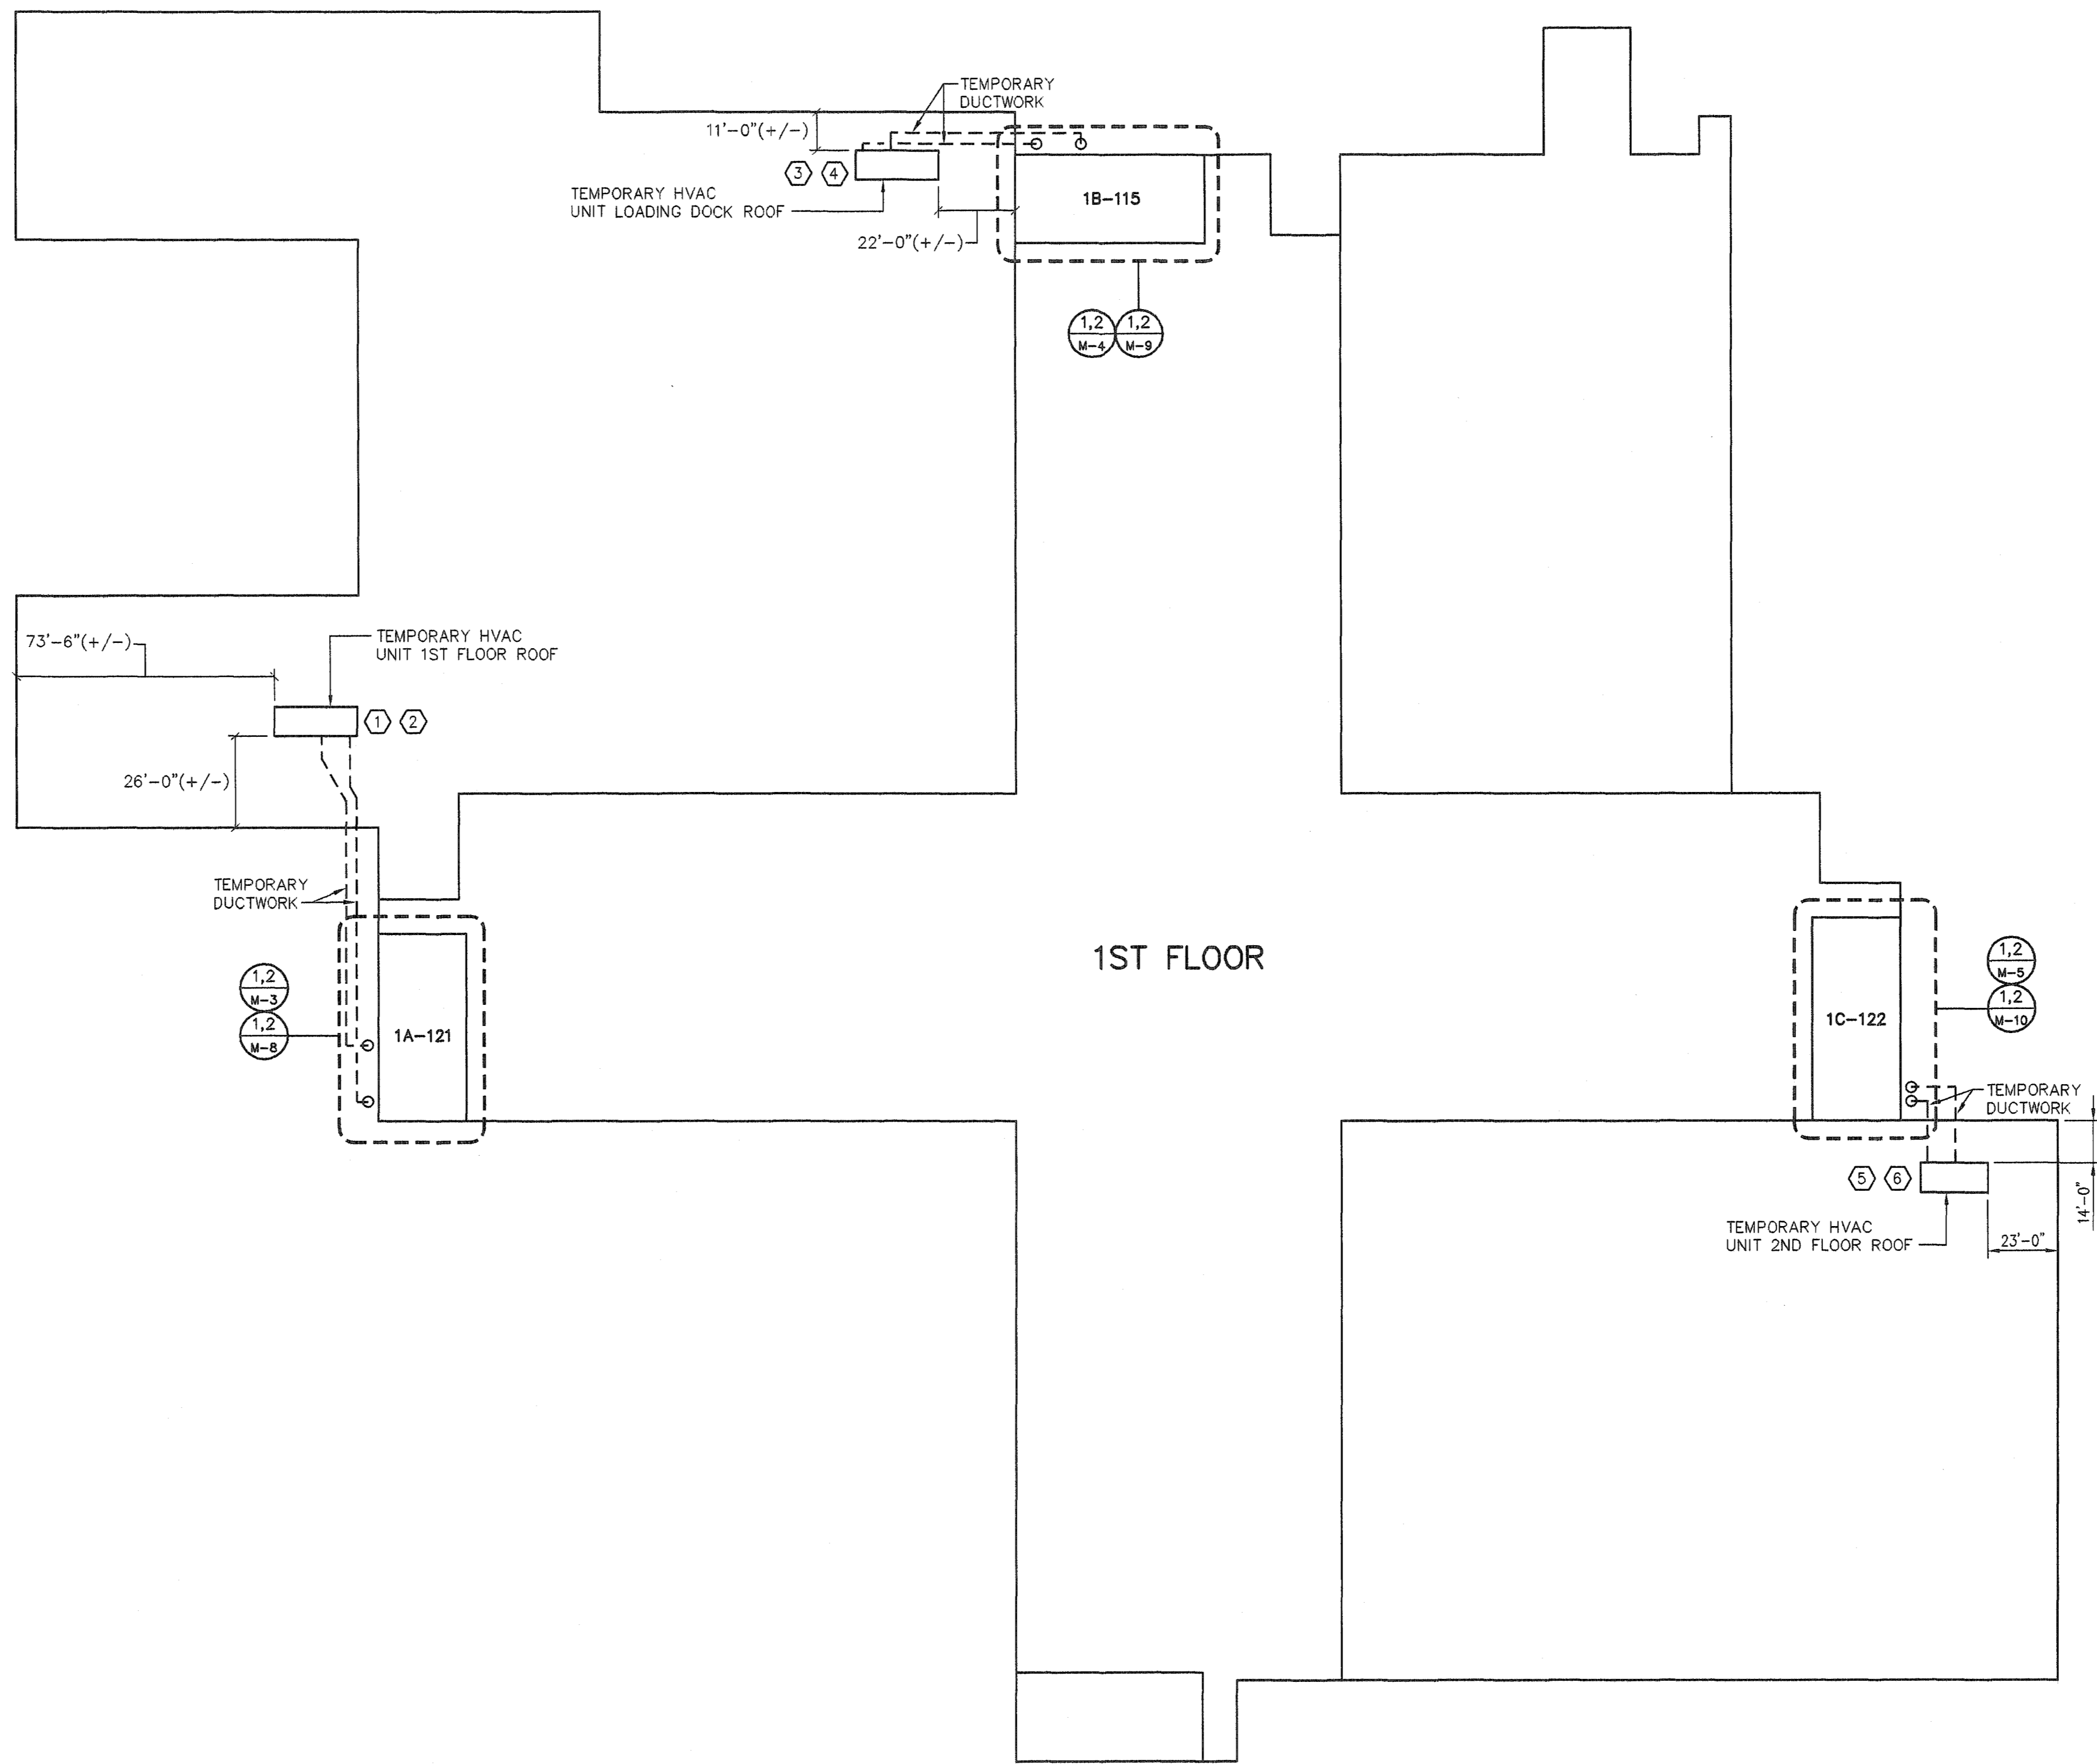

CONSTRUCTION NOTES:

- ① - DURING COOLING MONTHS, PROVIDE TEMPORARY AHU 1A-CM. UNIT SHALL OPERATE IN NORMAL COOLING MODE. PROVIDE TEMPORARY 4" CHILLED WATER PIPING BETWEEN AHU 1A-CM AND EXISTING 4" CHILLED WATER PIPING IN MECHANICAL ROOM 1A-121.
- ② - DURING HEATING MONTHS, PROVIDE TEMPORARY AHU 1A-HM. UNIT SHALL OPERATE IN NORMAL HEATING MODE. POWER SHALL BE SUPPLIED BY TEMPORARY GENERATOR TG-1.
- ③ - DURING COOLING MONTHS, PROVIDE TEMPORARY AHU 1B-CM. UNIT SHALL OPERATE IN NORMAL COOLING MODE. PROVIDE TEMPORARY 4" CHILLED WATER PIPING BETWEEN AHU 1B-CM AND EXISTING 4" CHILLED WATER PIPING IN MECHANICAL ROOM 1B-142.
- ④ - DURING HEATING MONTHS, PROVIDE TEMPORARY AHU 1B-HM. UNIT SHALL OPERATE IN NORMAL HEATING MODE.
- ⑤ - DURING COOLING MONTHS, PROVIDE TEMPORARY AHU 1C-CM. UNIT SHALL OPERATE IN NORMAL COOLING MODE.
- ⑥ - DURING HEATING MONTHS, PROVIDE TEMPORARY AHU 1C-HM. UNIT SHALL OPERATE AS A FAN ONLY.

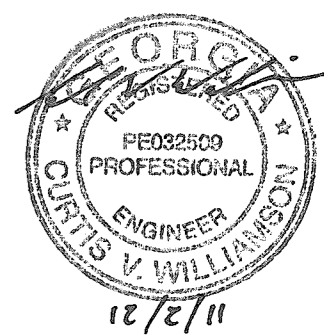

FIRST FLOOR KEY PLAN



		Drawn By: LPM	Recommended: Chief, Engineering Dept.	Recommended: ACOS/Research	<div>JOHNSON, LASCHOBIER & ASSOCIATES, P.C. ENGINEERS • DESIGNERS • CONSULTANTS LANDSCAPE ARCHITECTS 1290 BROAD ST., AUGUSTA, GEORGIA 30901 PHONE: (706) 724-5756 FAX: (706) 724-3955</div>	Approved:	Project Title: Correct AHU/HVAC Deficiencies, Phase 5 Building 801 – Downtown Division	Date: 8/30/10	
		Checked: CVW	Recommended: Safety Manager	Recommended: Energy Engineer		FACILITY MANAGEMENT EXECUTIVE	Project No. 509–10–120		
RE-ISSUED FOR CONSTRUCTION	12/02/11	Recommended: M & O General Foreman	Recommended: Informatics Manager	Recommended: GEMS Coordinator		Approved:	Drawing No. M–1		
ISSUED FOR CONSTRUCTION	05/06/11	Recommended: Chief, Construction Management	Recommended: Med. Center Epidemiologist	Recommended:		MEDICAL CENTER DIRECTOR	Dwg. 2 of 18		
Revisions:	Date:								



Department of Veterans Affairs
VAMC Augusta, Georgia
Engineering Service (138)