




HVAC DEMOLITION PLAN
LOWER LEVEL ROOM 1C-122
 1 M-5
 0.5 1 2 4 8 12 FT.
 SCALE: 1/4"=1'-0"
 N

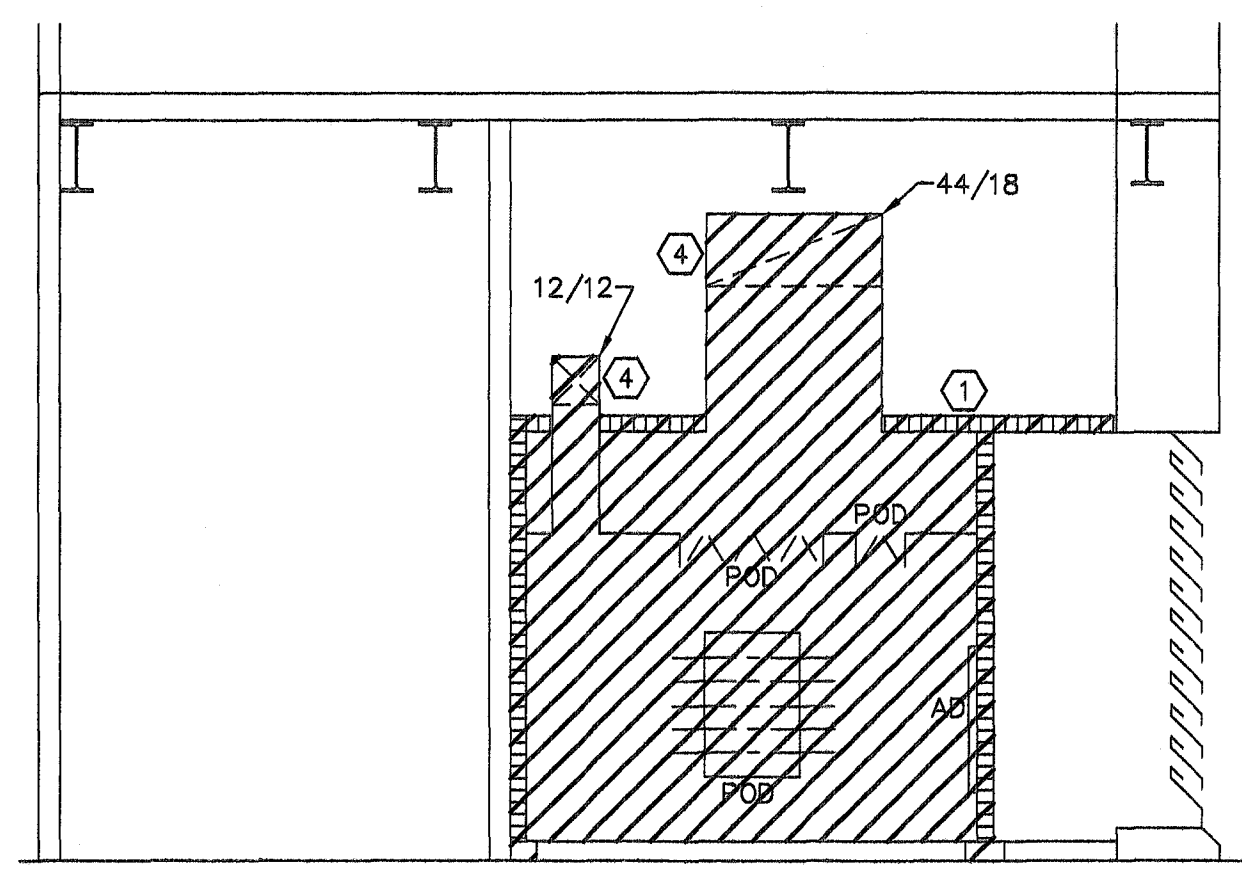


SECTION
 4 M-5
 0.5 1 2 4 8 12 FT.
 SCALE: 1/4"=1'-0"

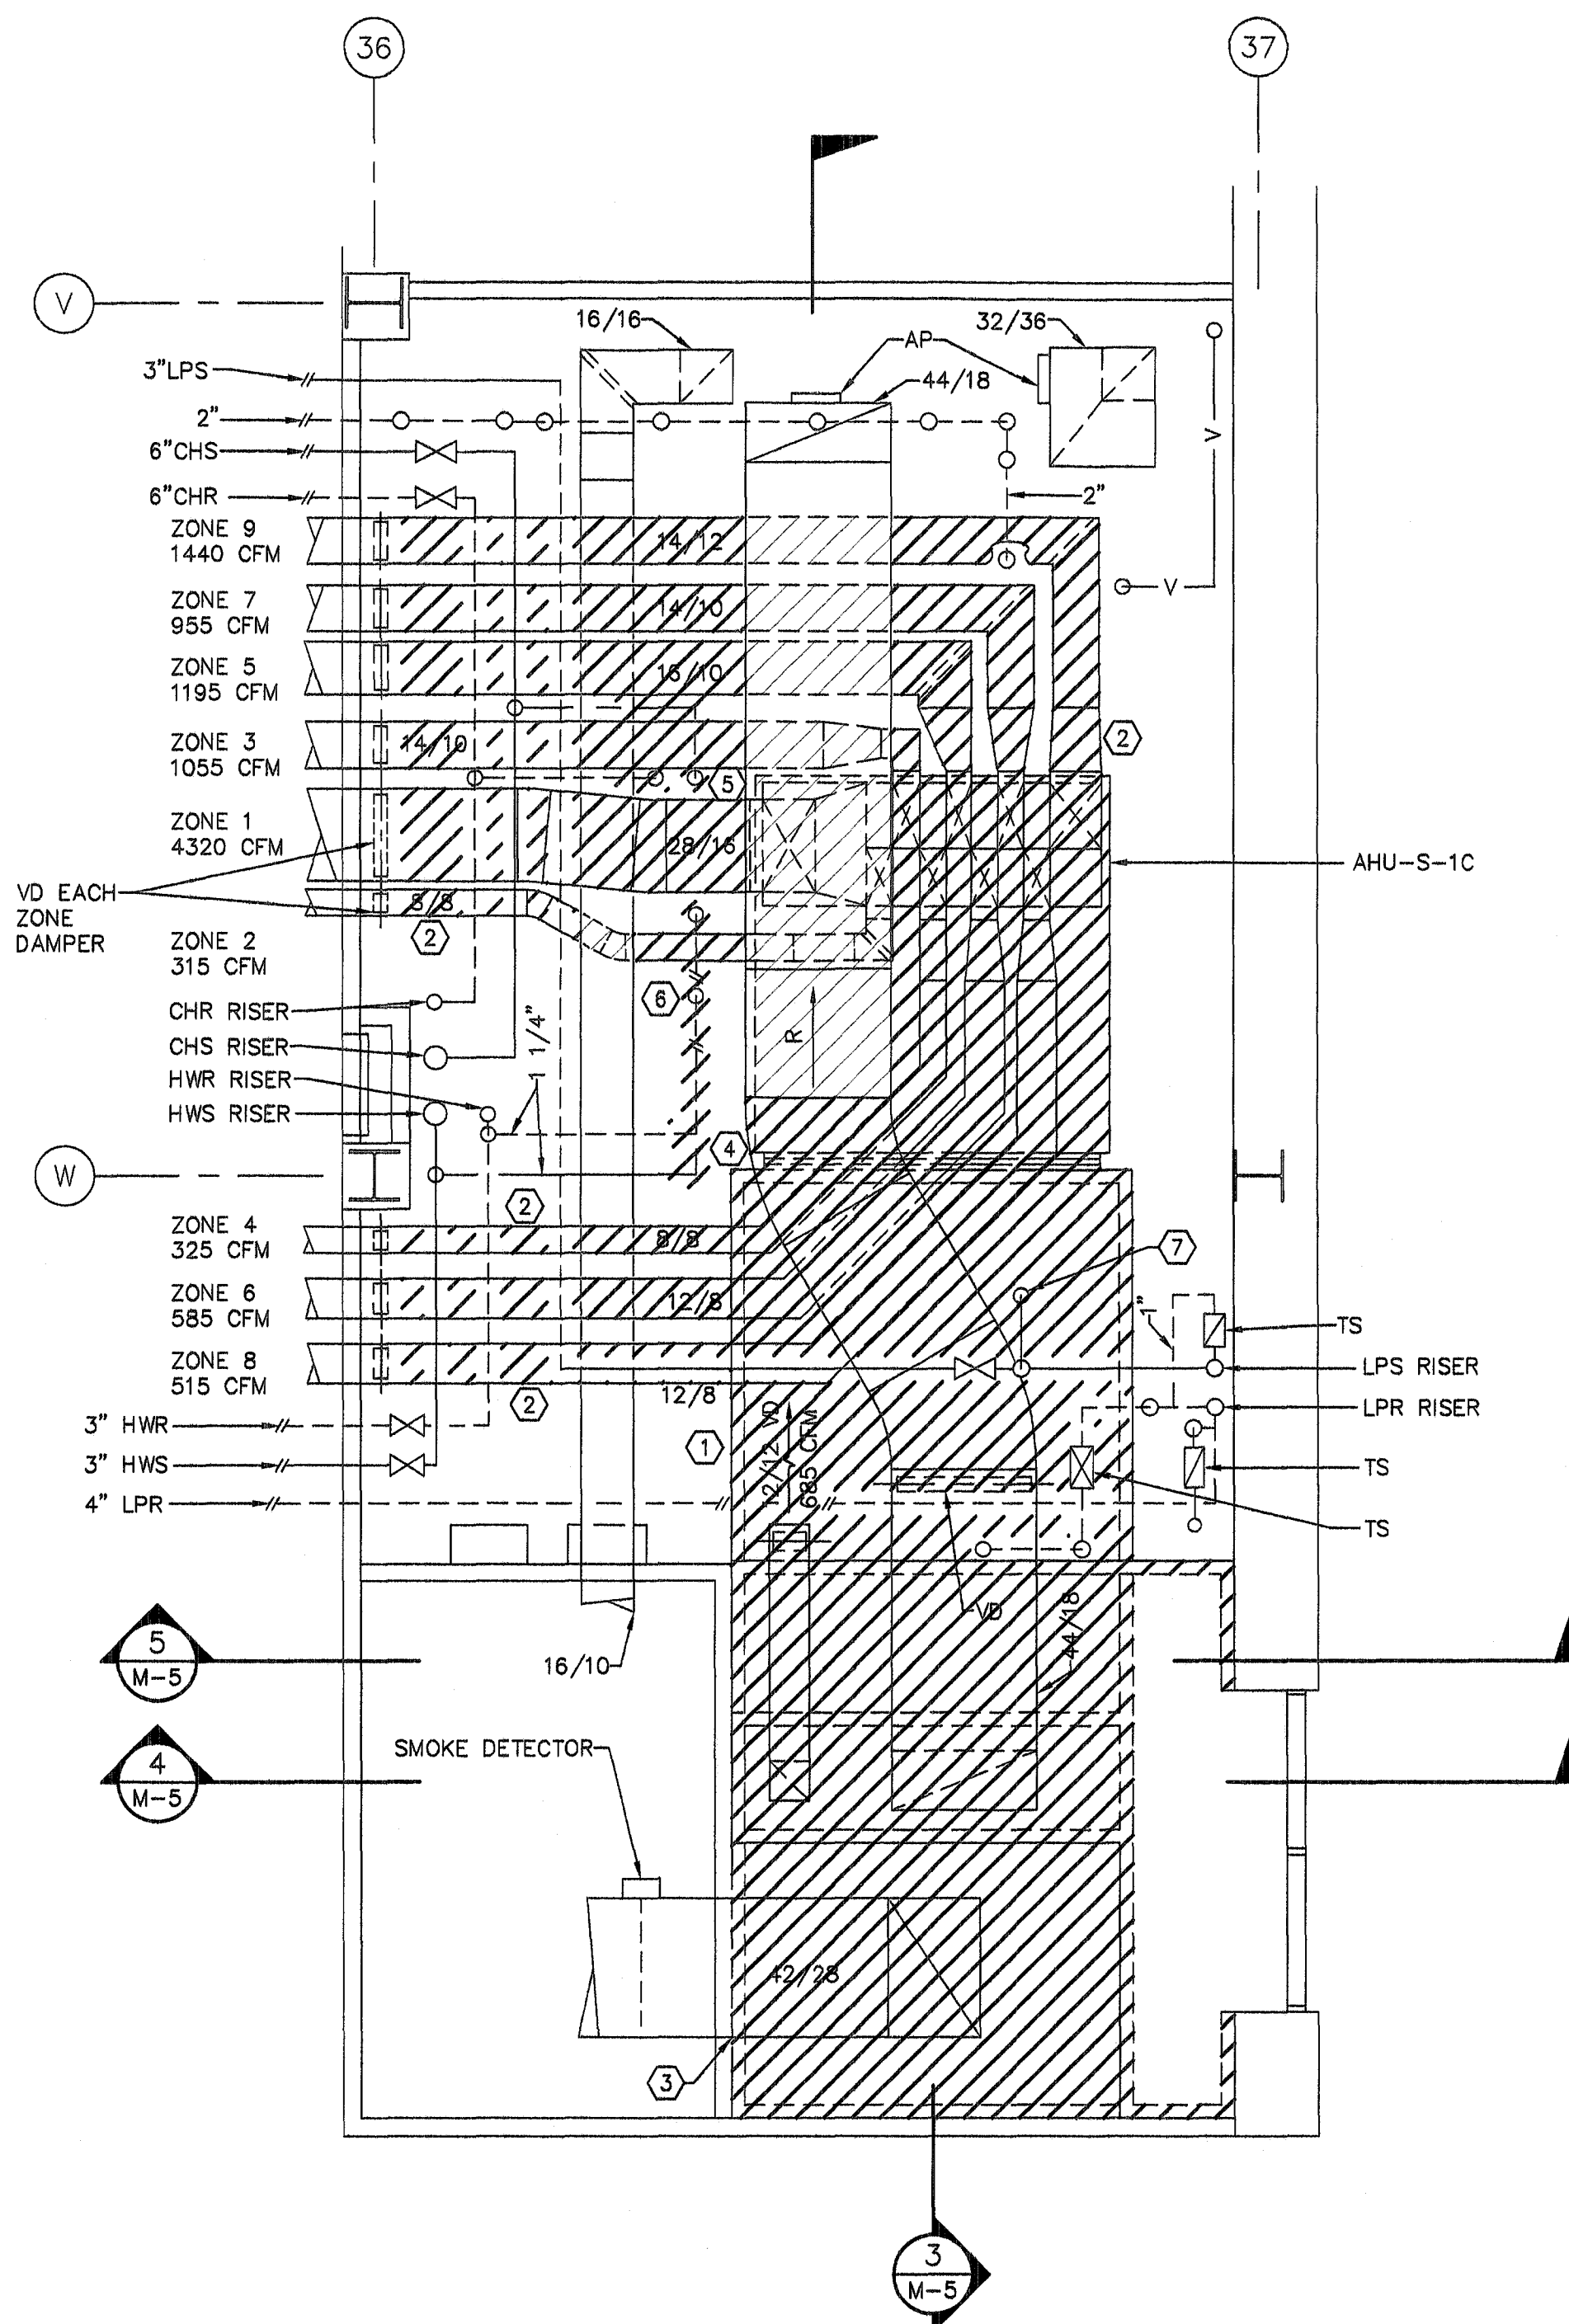

HVAC DEMOLITION PLAN
UPPER LEVEL ROOM 1C-122
 2 M-5
 0.5 1 2 4 8 12 FT.
 SCALE: 1/4"=1'-0"
 N

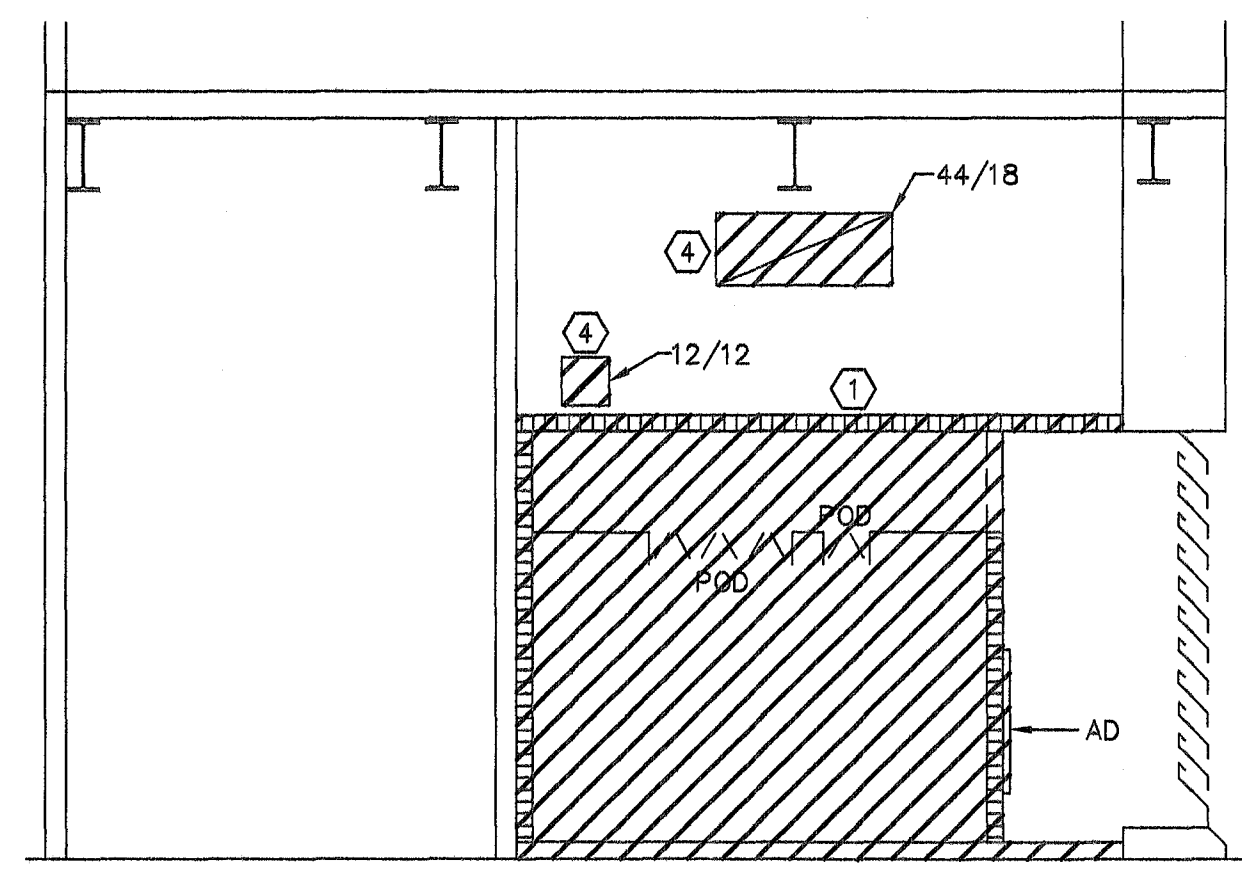

SECTION
 5 M-5
 0.5 1 2 4 8 12 FT.
 SCALE: 1/4"=1'-0"

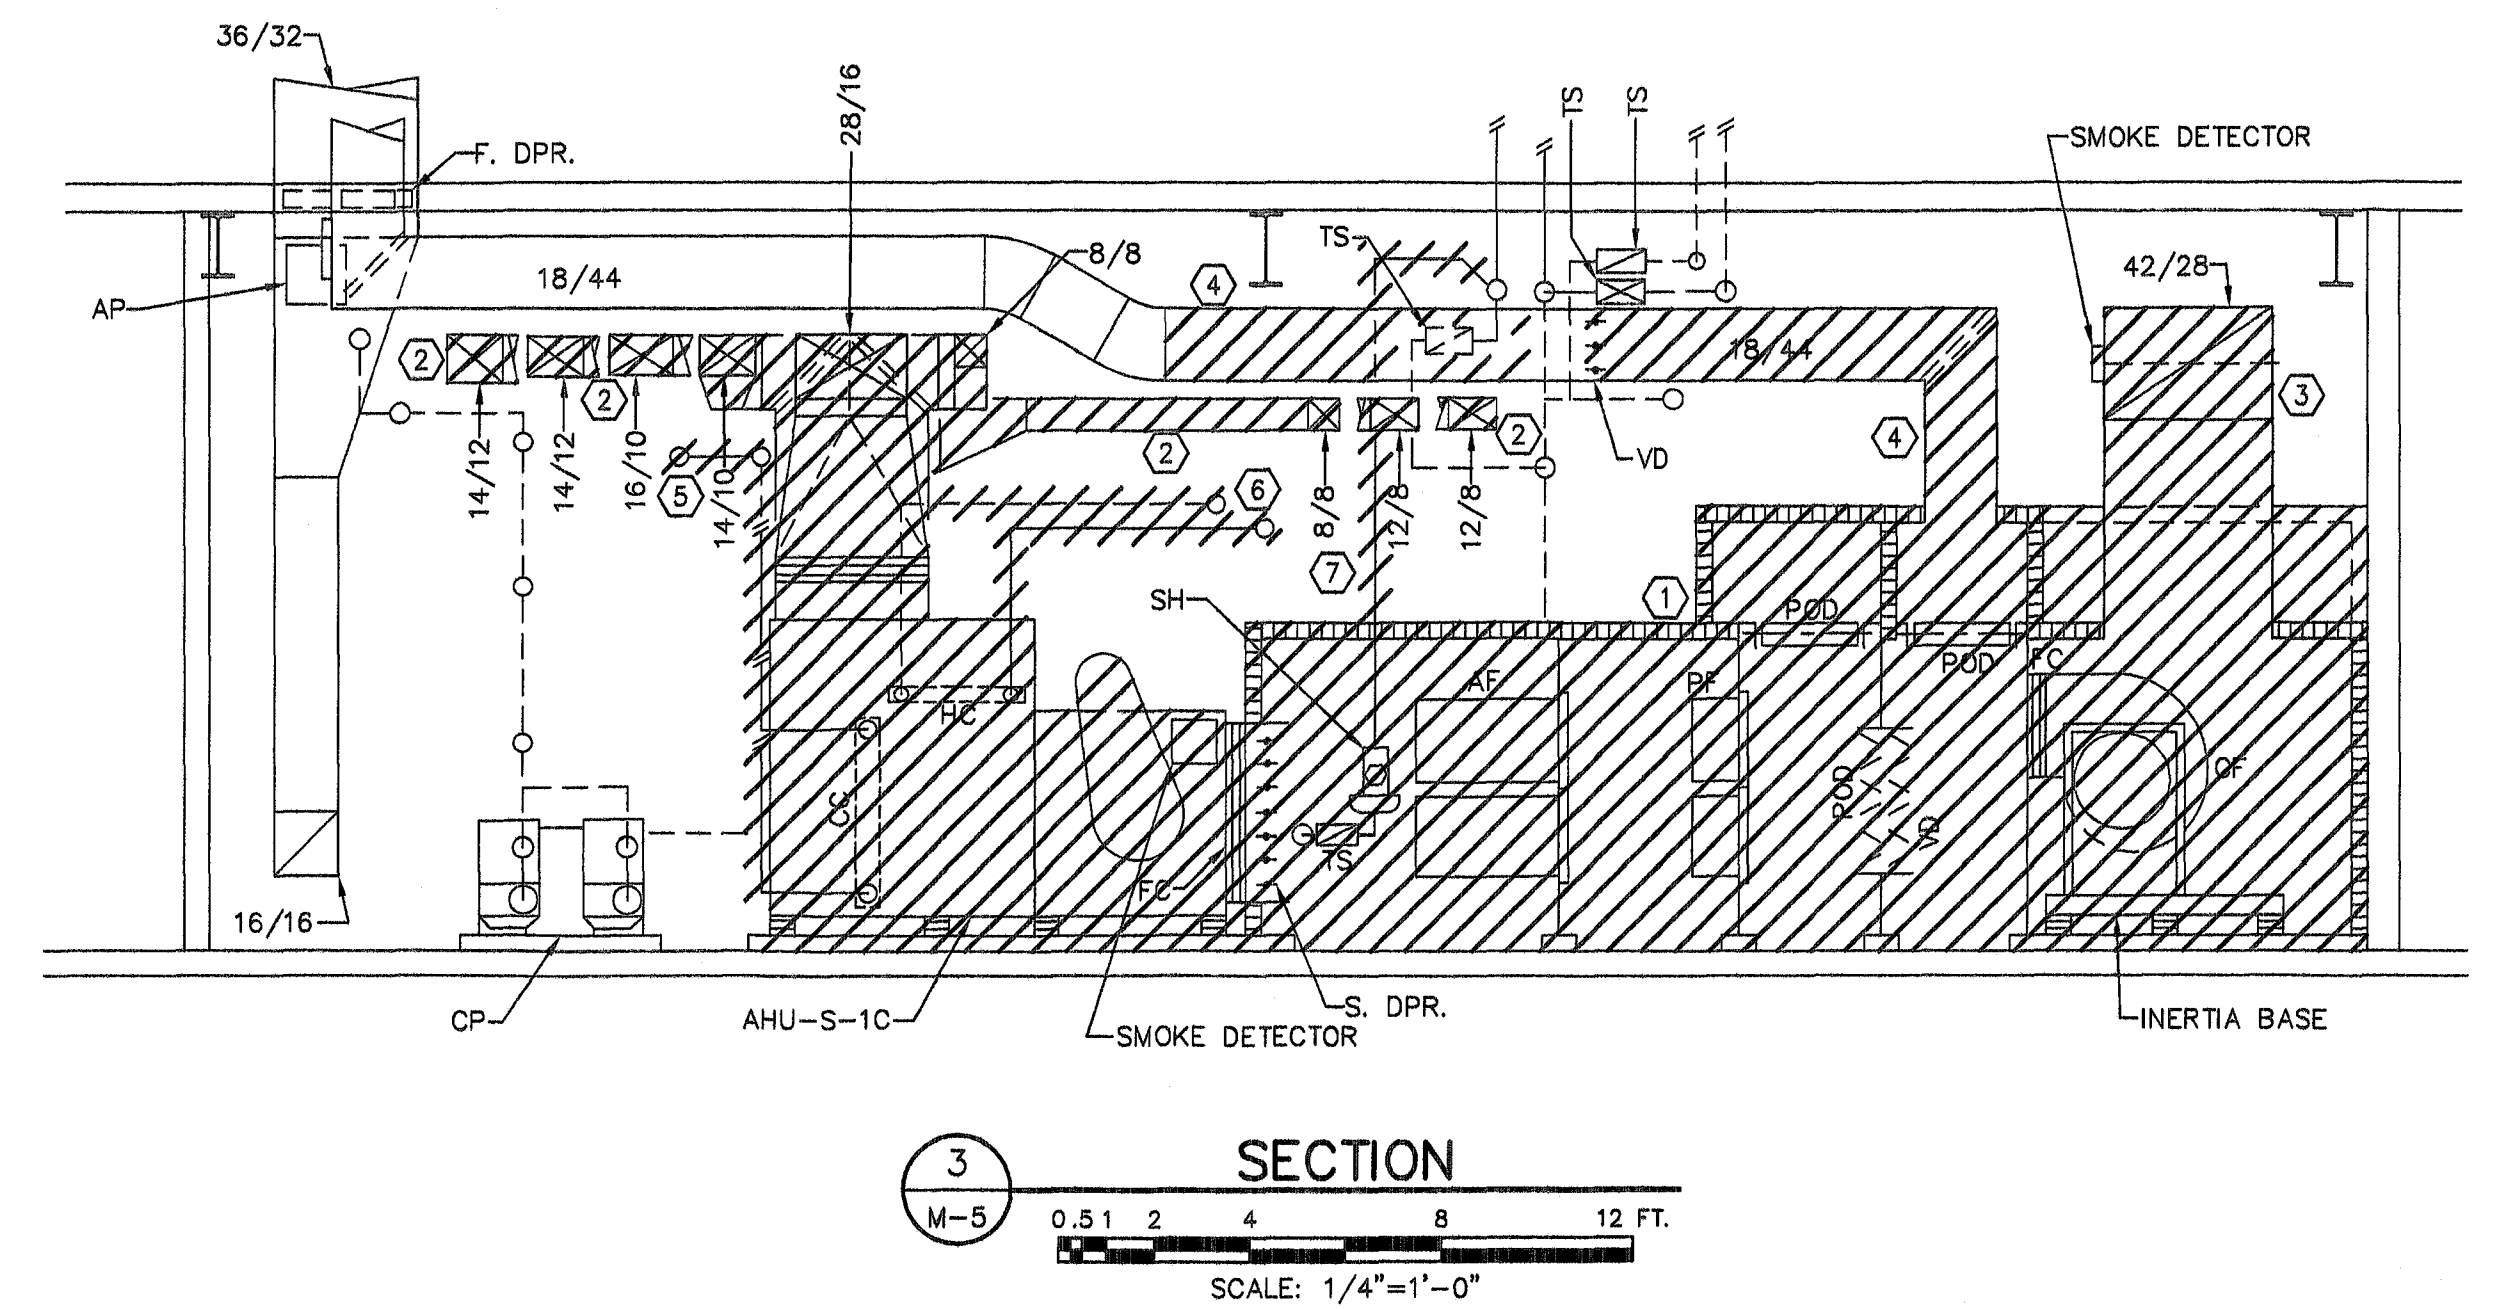


SECTION
 3 M-5
 0.5 1 2 4 8 12 FT.
 SCALE: 1/4"=1'-0"

DEMOLITION NOTES:

- DEMOLISH AND REMOVE EXISTING AIR HANDLING UNIT.
- DEMOLISH AND REMOVE EXISTING SUPPLY AIR DUCTWORK. PREP END OF DUCT FOR NEW DUCTWORK CONNECTION.
- DEMOLISH AND REMOVE EXISTING RETURN AIR DUCTWORK. PREP END OF DUCT FOR NEW DUCTWORK CONNECTION.
- DEMOLISH AND REMOVE EXISTING EXHAUST AIR DUCTWORK. PREP END OF DUCT FOR NEW DUCTWORK CONNECTION.
- DEMOLISH AND REMOVE CHILLED WATER PIPING. PREP END OF PIPE FOR NEW PIPING CONNECTION.
- DEMOLISH AND REMOVE HEATING HOT WATER PIPING. PREP END OF PIPE FOR NEW PIPING CONNECTION.
- DEMOLISH AND REMOVE LOW PRESSURE STEAM SUPPLY PIPING. PREP END OF PIPE FOR NEW PIPING CONNECTION.
- DEMOLISH AND REMOVE LOW PRESSURE CONDENSATE RETURN PIPING. PREP END OF PIPE FOR NEW PIPING CONNECTION.

GENERAL DEMOLITION NOTES:

- COORDINATE DEMOLITION WORK WITH HOSPITAL STAFF TO ENSURE THAT FIRE ALARMS HAVE BEEN DEACTIVATED IN AFFECTED AREAS PRIOR TO BEGINNING DEMOLITION WORK AND PROVIDE DETAILS OF ALL PREPARATION WORK FOR DEMOLITION ACTIVITIES.
- ALL CONTROL PANELS SHOULD BE FREE OF ABANDONED PNEUMATIC TUBING AND ELECTRICAL WIRING. ALL ABANDONED PNEUMATIC TUBING AND ELECTRICAL WIRING SHOULD BE PROPERLY TERMINATED IN PULL BOXES ABOVE CONTROL PANELS. PROPER TERMINATION OF PNEUMATIC TUBING SHOULD BE WITH BARBED PLUGS.

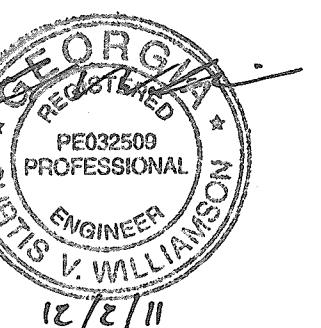

12/7/11

| | | | | | | | |
|---|--|---|--|--|--|--|---|
| RE-ISSUED FOR CONSTRUCTION 12/02/11 ISSUED FOR CONSTRUCTION 05/06/11 Revisions: Date: | Drawn By: LPM Checked: CVW Recommended: M & O General Foreman Recommended: Chief, Construction Management | Recommended: Chief, Engineering Dept. Recommended: Safety Manager Recommended: Informatics Manager Recommended: Med. Center Epidemiologist | Recommended: ACOS/Research Recommended: Energy Engineer Recommended: GEMS Coordinator Recommended: | <div data-bbox="1409 1932 1706 2016"> </div> | Approved: FACILITY MANAGEMENT EXECUTIVE Approved: MEDICAL CENTER DIRECTOR | Project Title: Correct AHU/HVAC Deficiencies, Phase 5 Building 801 - Downtown Division Drawing Title: MECH. ROOM 1C-122 HVAC DEMOLITION PLANS | Date: 8/30/10 Project No. 509-10-120 Drawing No. M-5 Dwg. 6 of 18 <div data-bbox="2715 1900 2908 2047"> </div> |
|---|--|---|--|--|--|--|---|