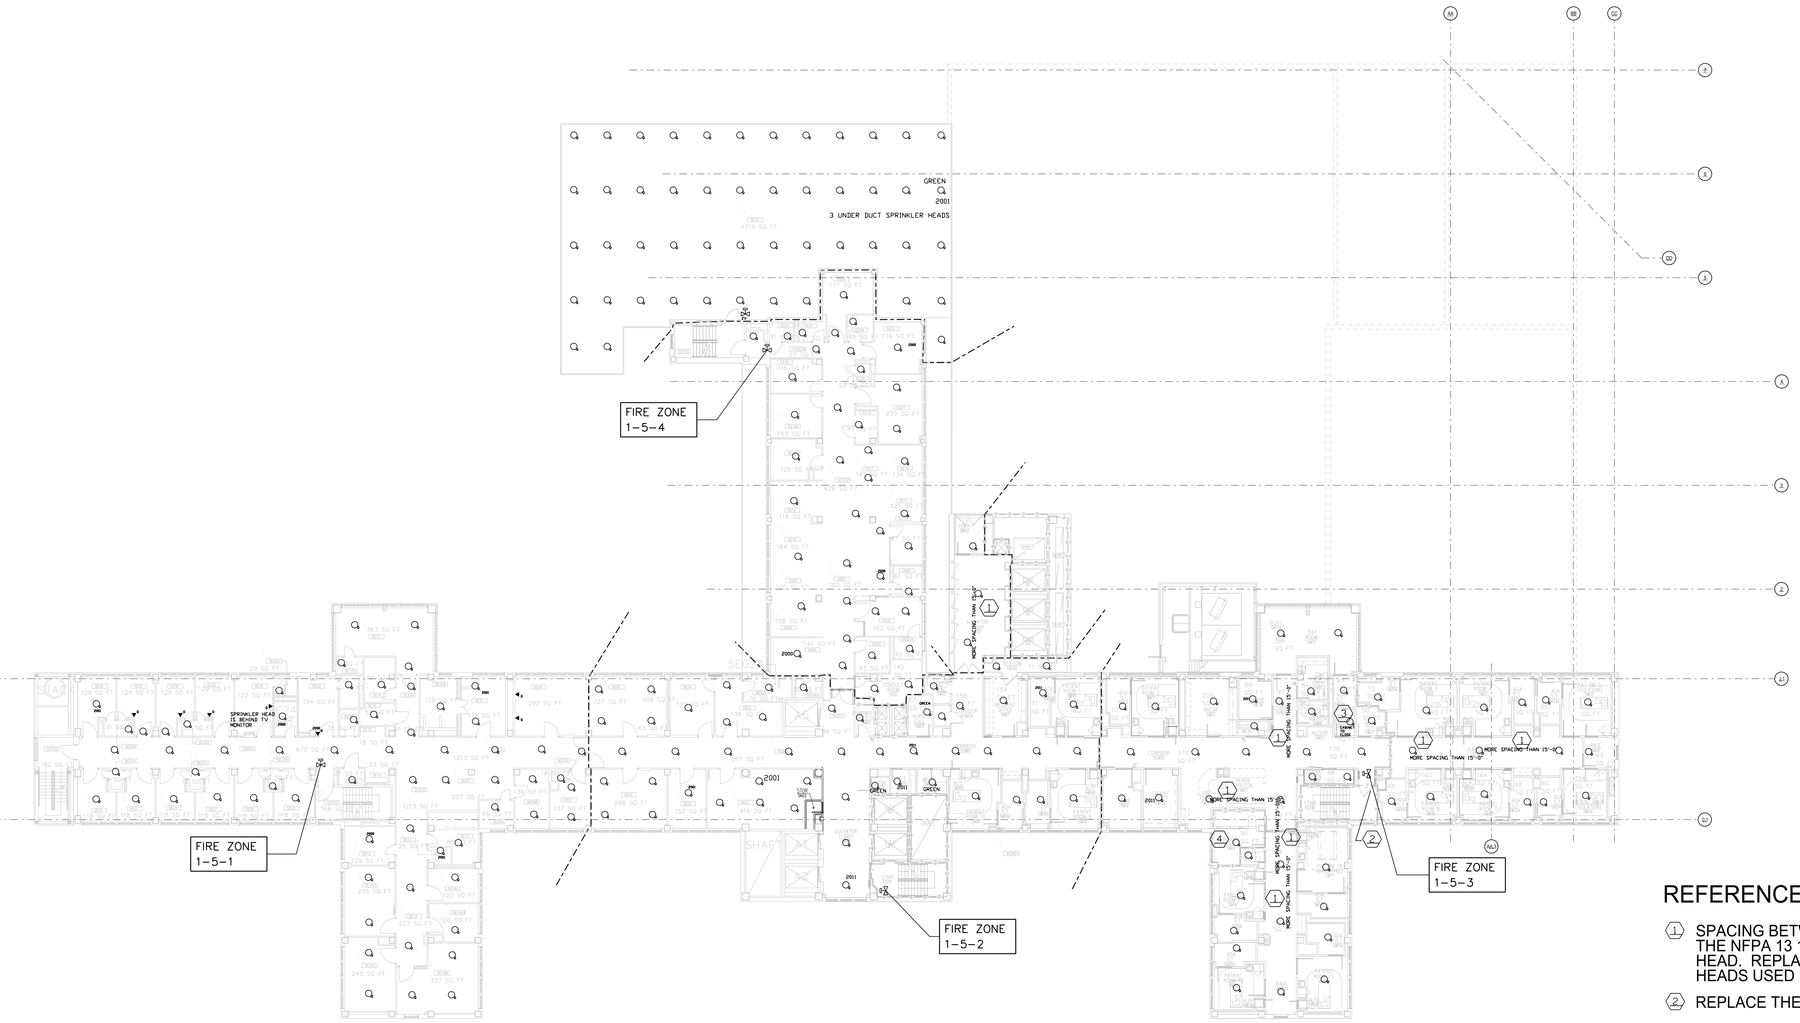

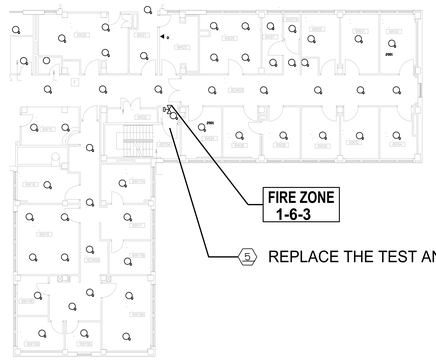

REFERENCE NOTES:

1. SPACING BETWEEN SPRINKLER HEADS IS GREATER THAN THE NFPA 13 15'-0" LIMIT. ADD AN ADDITIONAL SPRINKLER HEAD. REPLACE THE EXTENDED COVERAGE SPRINKLER HEADS USED IN THIS SPACING THAT IS GREATER THAN 15'-0".
2. REPLACE THE TEST AND DRAIN VALVE FOR ZONE 1-5-3.
3. MOVE SPRINKLER HEAD AWAY FROM CABINET INTO THE SOUTHEAST CORNER OF ROOM.
4. MOVE EXISTING SPRINKLER HEAD TO A CEILING TILE CLOSE TO THE DOOR. ADD NEW SPRINKLER HEAD BACE AROUND CORNER TO COVER REST OF ROOM.
5. REPLACE THE TEST AND DRAIN VALVE FOR ZONE 1-6-3.



SCALE: 1/16" = 1'-0"

REVISIONS	DATE	REVISIONS	DATE	REVISIONS	DATE

HEERY
Heery International Inc.
125 South Dubuque Street,
Suite 500,
Iowa City, IA 52240-4003
319-354-4700

project number 11-25505

DRAWING TITLE: **FIRE SPRINKLER PLAN LEVEL 5 & 6**

PROJECT TITLE: **REPLACE SPRINKLER HEADS**

DATE: 05/21/2013

PROJECT NO.: 636A8-13-001

BUILDING NO.: BLDG 1 | CHECKED: JMB | DRAWN: JMB

DRAWING NO.: 1-F6 DWG. 7 OF 9

LOCATION: ICVA HEALTH CARE SYSTEM

OFFICE OF FACILITIES

DEPARTMENT OF VETERANS AFFAIRS

PROJECT: IC - VVAC - EXPAND BLDG. 1 FOR PACT PROJECT
SHEET TITLE: F:\11\MEP\11-12505\...\CADD\11-F6.11.25505.IAC.DGN
PLOTTED BY: JMB ON 5/21/2013
PEN TABLE: HEERY ENG.PEN 12"=1'-0"

VA FORM 08-6231, FEB. 1983