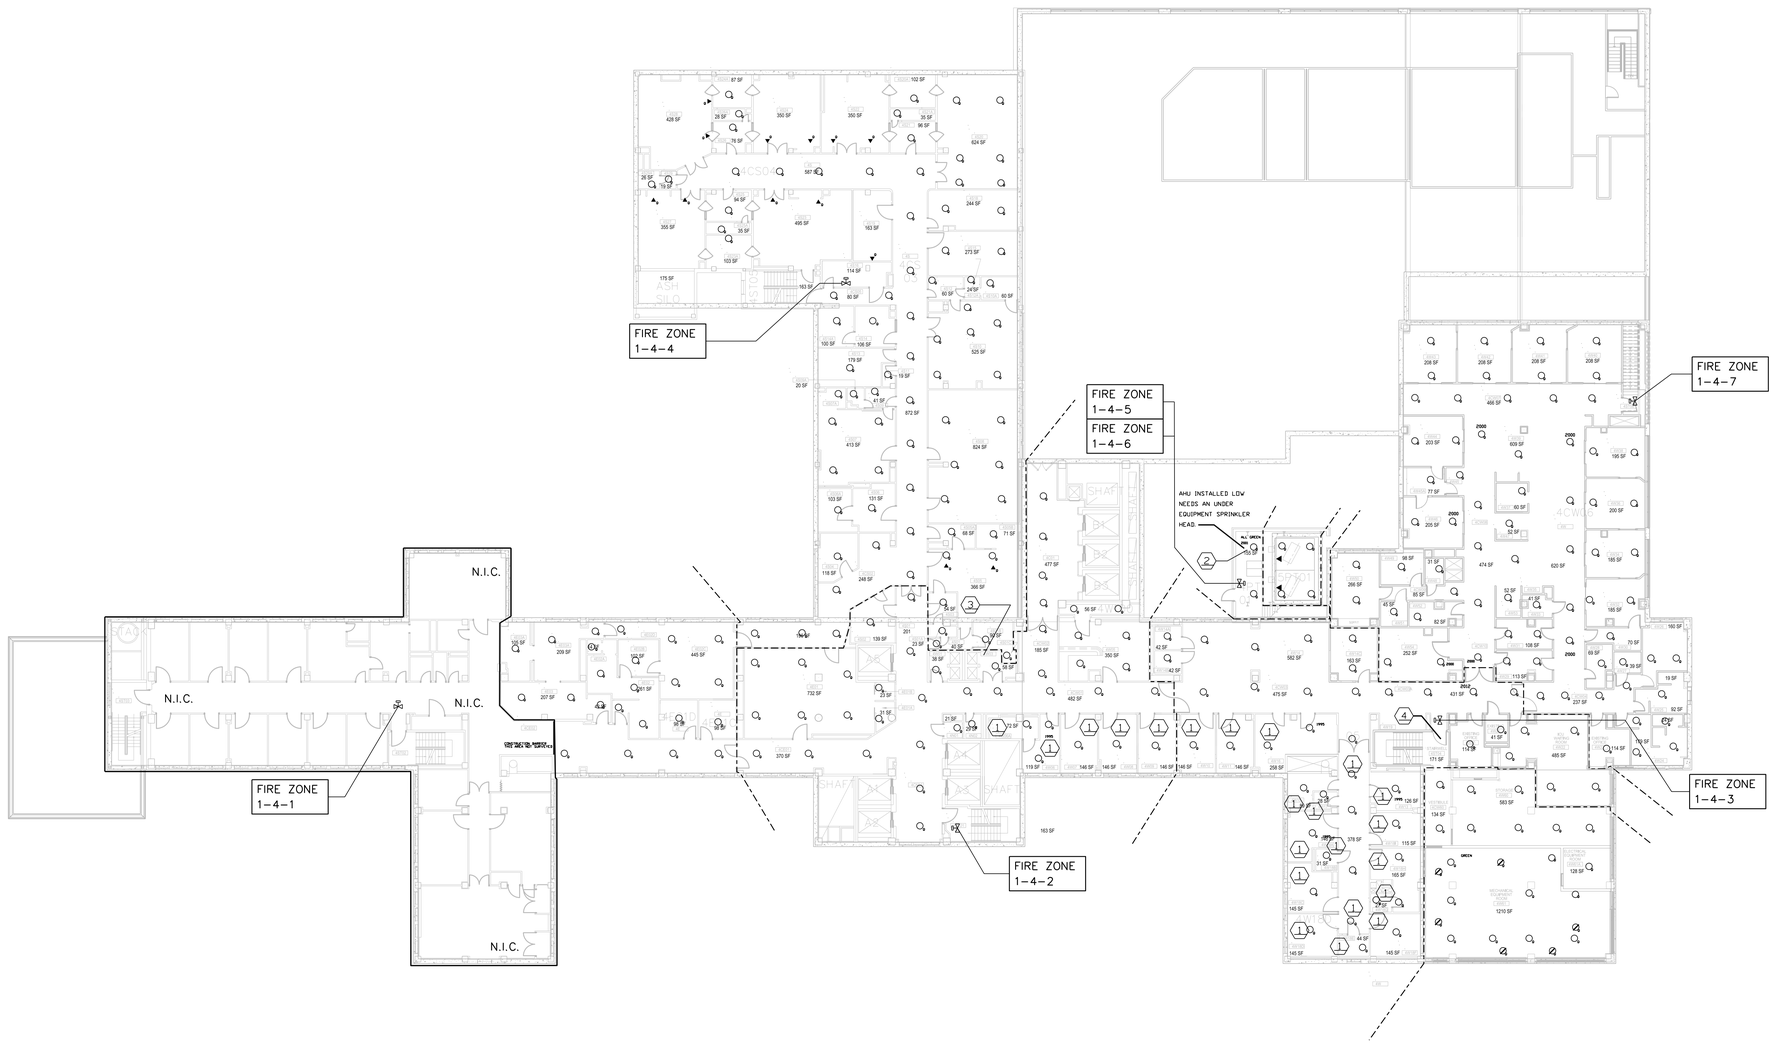

REFERENCE NOTES:

1. CHANGES OUT THE 1995 QUICK RESPONSE SPRINKLER HEADS TO NEW QUICK (RED BULB) SPRINKLER HEADS.
2. ADD A NEW SPRINKLER HEAD UNDER AHU PLATFORM AS THIS AREA NOT COVERED BY THE HIGH EXISTING SPRINKLERS.
3. ADD A NEW SPRINKLER HEAD IN SE CORNER OF THE ROOM AND MOVE THE EXISTING SPRINKLER CLOSER TO THE DOOR. THIS WILL ALLOW THE NURSE CALL RACK TO HAVE A TALLER SECTION ADDED IN THE FUTURE. KEEP THE 6'-0" SEPARATION.
4. REPLACE THE TEST AND DRAIN VALVE FOR ZONE 1-4-3.



REVISIONS	DATE	REVISIONS	DATE	REVISIONS	DATE

HEERY

Heery International Inc.
125 South Dubuque Street,
Suite 500,
Iowa City, IA 52240-4003
319-354-4700

project number 11-25505

DRAWING TITLE: FIRE SPRINKLER PLAN LEVEL 4	PROJECT TITLE: REPLACE SPRINKLER HEADS		DATE: 05/21/2013	
			PROJECT NO.: 636A8-13-001	
	BUILDING NO.: BLDG 1	CHECKED: JMB	DRAWN: JMB	DRAWING NO.: 1-F5
	LOCATION: ICVA HEALTH CARE SYSTEM			DWG. 6 OF 9

OFFICE OF FACILITIES

DEPARTMENT OF VETERANS AFFAIRS

VA FORM 08-6231, FEB. 1983

PROJECT: IC-VAMC-EXPAND BLDG 1 FOR PACT PROJECT
SHEET TITLE: F:\11\H\11-25505\CADD\1-F5-11-25505.DGN
PLOT BY: JBRADSHAW
PLOTTED BY: JBRADSHAW
PEN TABLE: HEERY ENG.PEN 12+PSBW

THREE INCHES = ONE FOOT
ONE AND ONE-HALF INCHES = ONE FOOT
ONE INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
THREE-EIGHTHS INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT