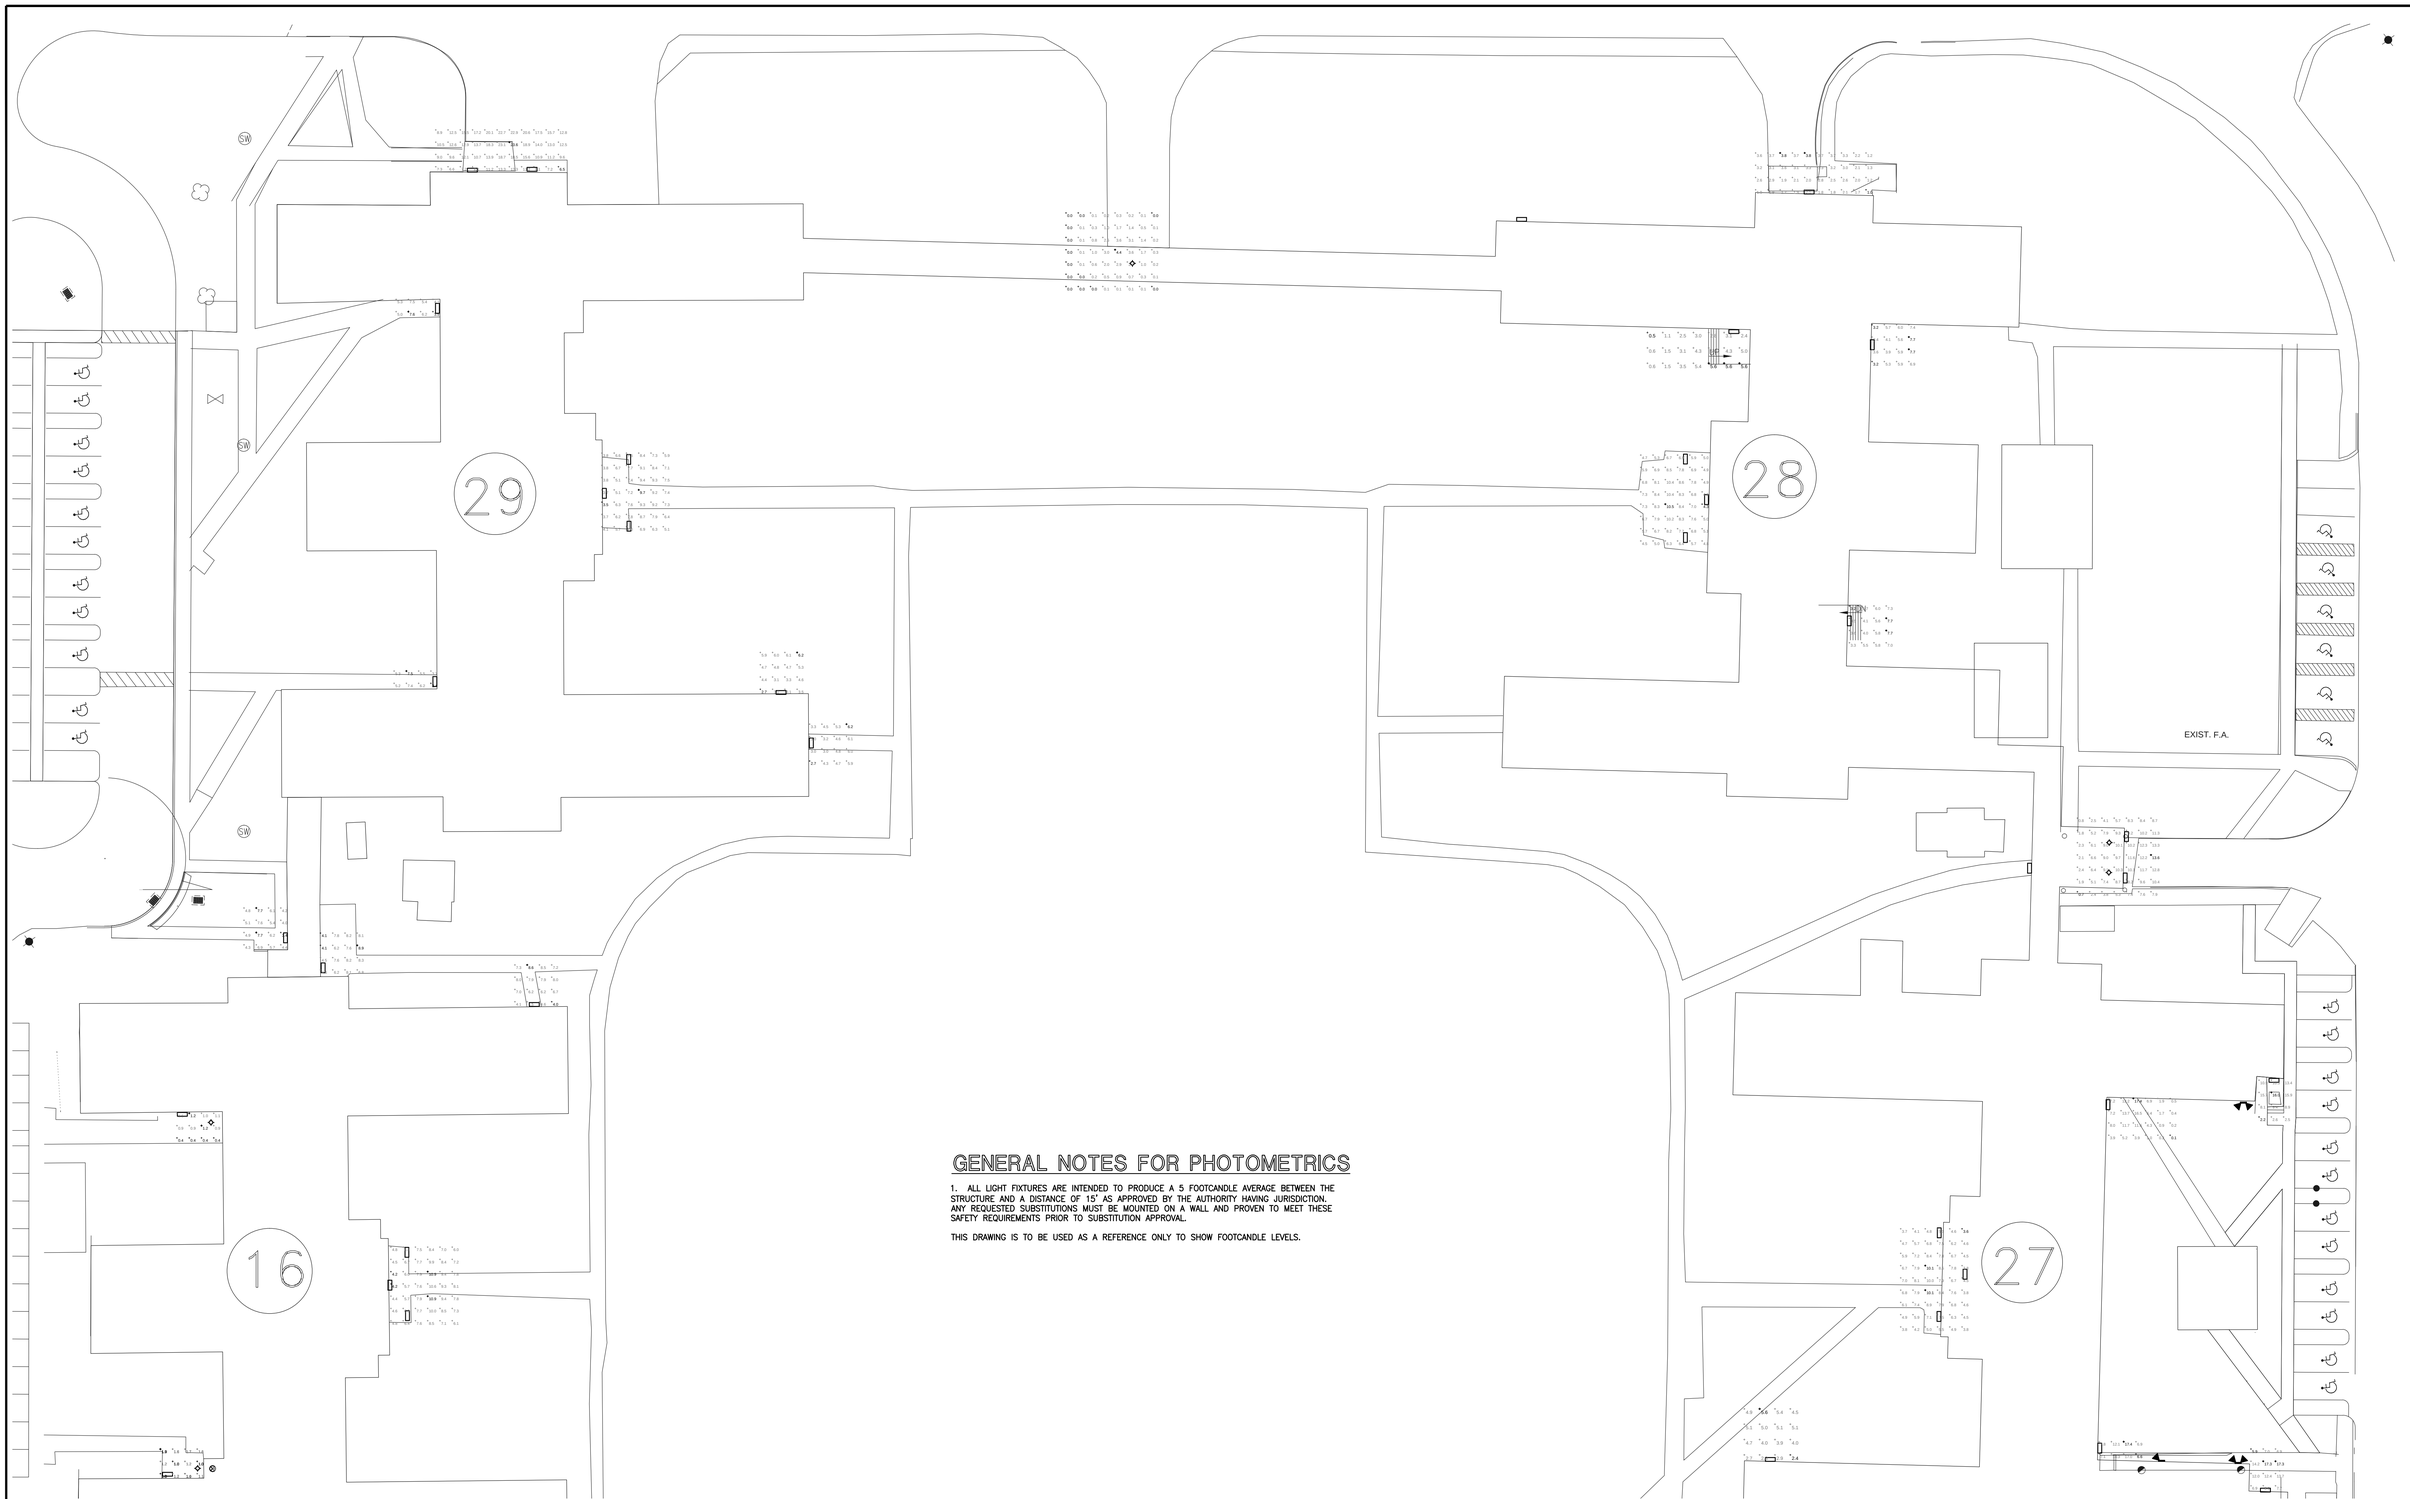

GENERAL NOTES FOR PHOTOMETRICS

1. ALL LIGHT FIXTURES ARE INTENDED TO PRODUCE A 5 FOOTCANDLE AVERAGE BETWEEN THE STRUCTURE AND A DISTANCE OF 15' AS APPROVED BY THE AUTHORITY HAVING JURISDICTION. ANY REQUESTED SUBSTITUTIONS MUST BE MOUNTED ON A WALL AND PROVEN TO MEET THESE SAFETY REQUIREMENTS PRIOR TO SUBSTITUTION APPROVAL.

THIS DRAWING IS TO BE USED AS A REFERENCE ONLY TO SHOW FOOTCANDLE LEVELS.

SITE PLAN - DECORATIVE POLE AND BOLLARD LIGHTING

NO SCALE

100% CONSTRUCTION DOCUMENTS

Revisions:	Date

CONSULTANTS:

STATE OF KENTUCKY — DENIS OSBNEY — 23513 — LICENSED PROFESSIONAL ENGINEER

MAR 28 2013

ARCHITECT/ENGINEERS:

HAL-PE ASSOCIATES
ENGINEERING SERVICES, INC.
823 Scott Blvd.
Covington, KY 41011-2447
(859) 431-6083 (office)
(859) 431-6136 (fax)
www.halpeinc.com

HAL-PE
A Veteran Owned Small Business

Drawing Title: PHOTOMETRICS

Approved for Design Concept Only

Project Title: REPLACE EXTERIOR BUILDING LIGHTING

Project Number: 596-12-101

Building Number:

Location: LEESTOWN ROAD, LEXINGTON, KENTUCKY

Date: 03-28-2013 | Checked: DRG | Drawn: LDG

Drawing Number: EL005

Dwg. 6 of 9

Department of Veterans Affairs

VA FORM 08-6231