




NTS

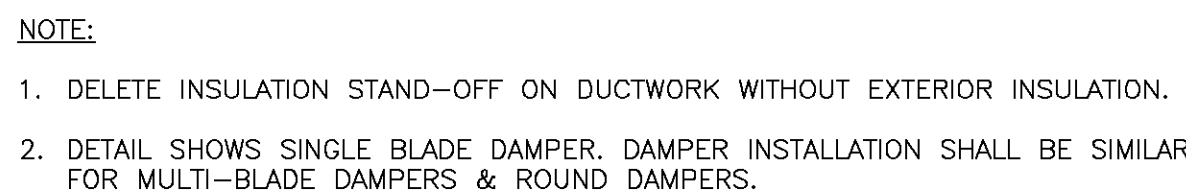

NTS

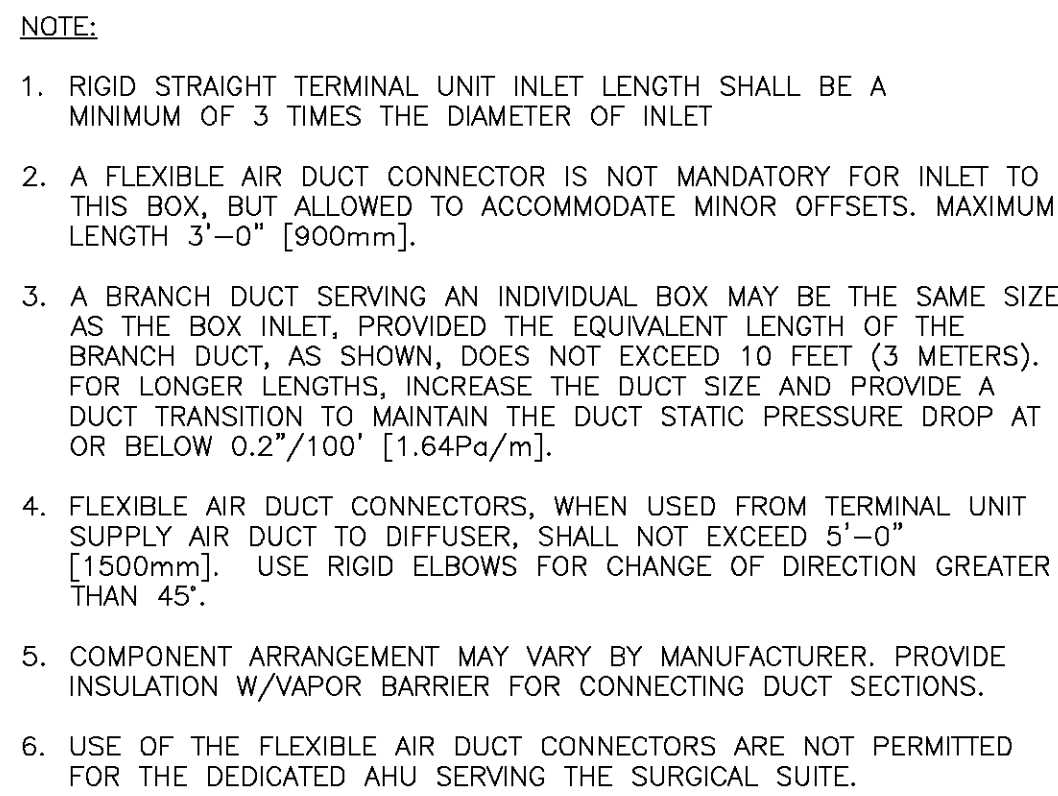

NTS




| LOAD RATED FASTENERS | | HANGER STRAPS OR RODS | | | |
|---------------------------|--------------------------|-------------------------------|-------------------|-------------------------------|--|
| MAX. DUCT Ø [in. / mm] | | QUANTITY / SIZE [in. / mm] | MAX. LBS. [kg] | MAX. SPACING [in. / mm] | |
| 26 [660] | ONE 1 [25] x 12 GA STRAP | 260 [119] | 144 [3600] | | |
| 36 [900] | ONE 1 [25] x 18 GA STRAP | 420 [190] | 144 [3600] | | |
| ONE | ONE 1 [25] x 18 GA STRAP | 500 [217] | 144 [3600] | | |
| 60 [1500] | TWO 3/8 [10] x 10S RODS | 1320 [598] | 144 [3600] | | |
| 84 [2100] | TWO 1/2 [13] x 10S RODS | 2500 [1133] | 144 [3600] | | |

A technical diagram of a circular manhole. It shows a cross-section of the manhole with two vertical hanger rods on opposite sides. A band is shown around the circumference of the manhole. Labels with leader lines point to the hanger rods and the band. The text 'OVER 50" [1250mm] Ø' is written below the manhole, indicating the diameter.



NTS

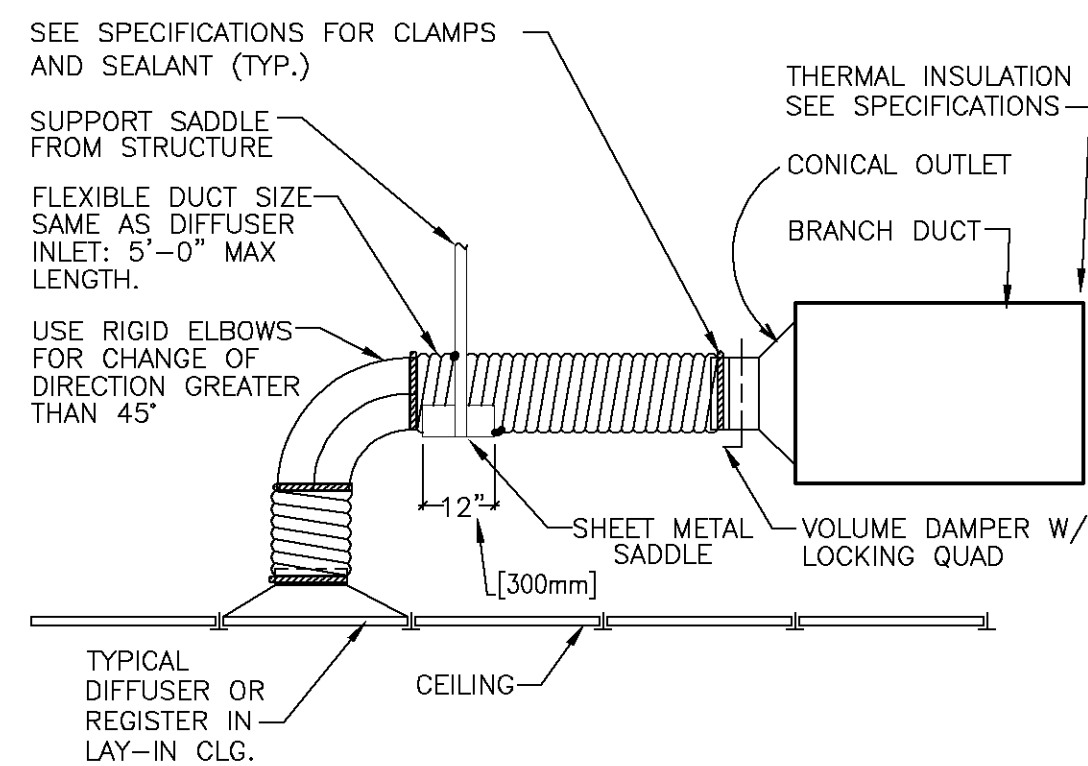

4 NTS

2 NTS

Office of
Construction
and Facilities
Management