




BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 5

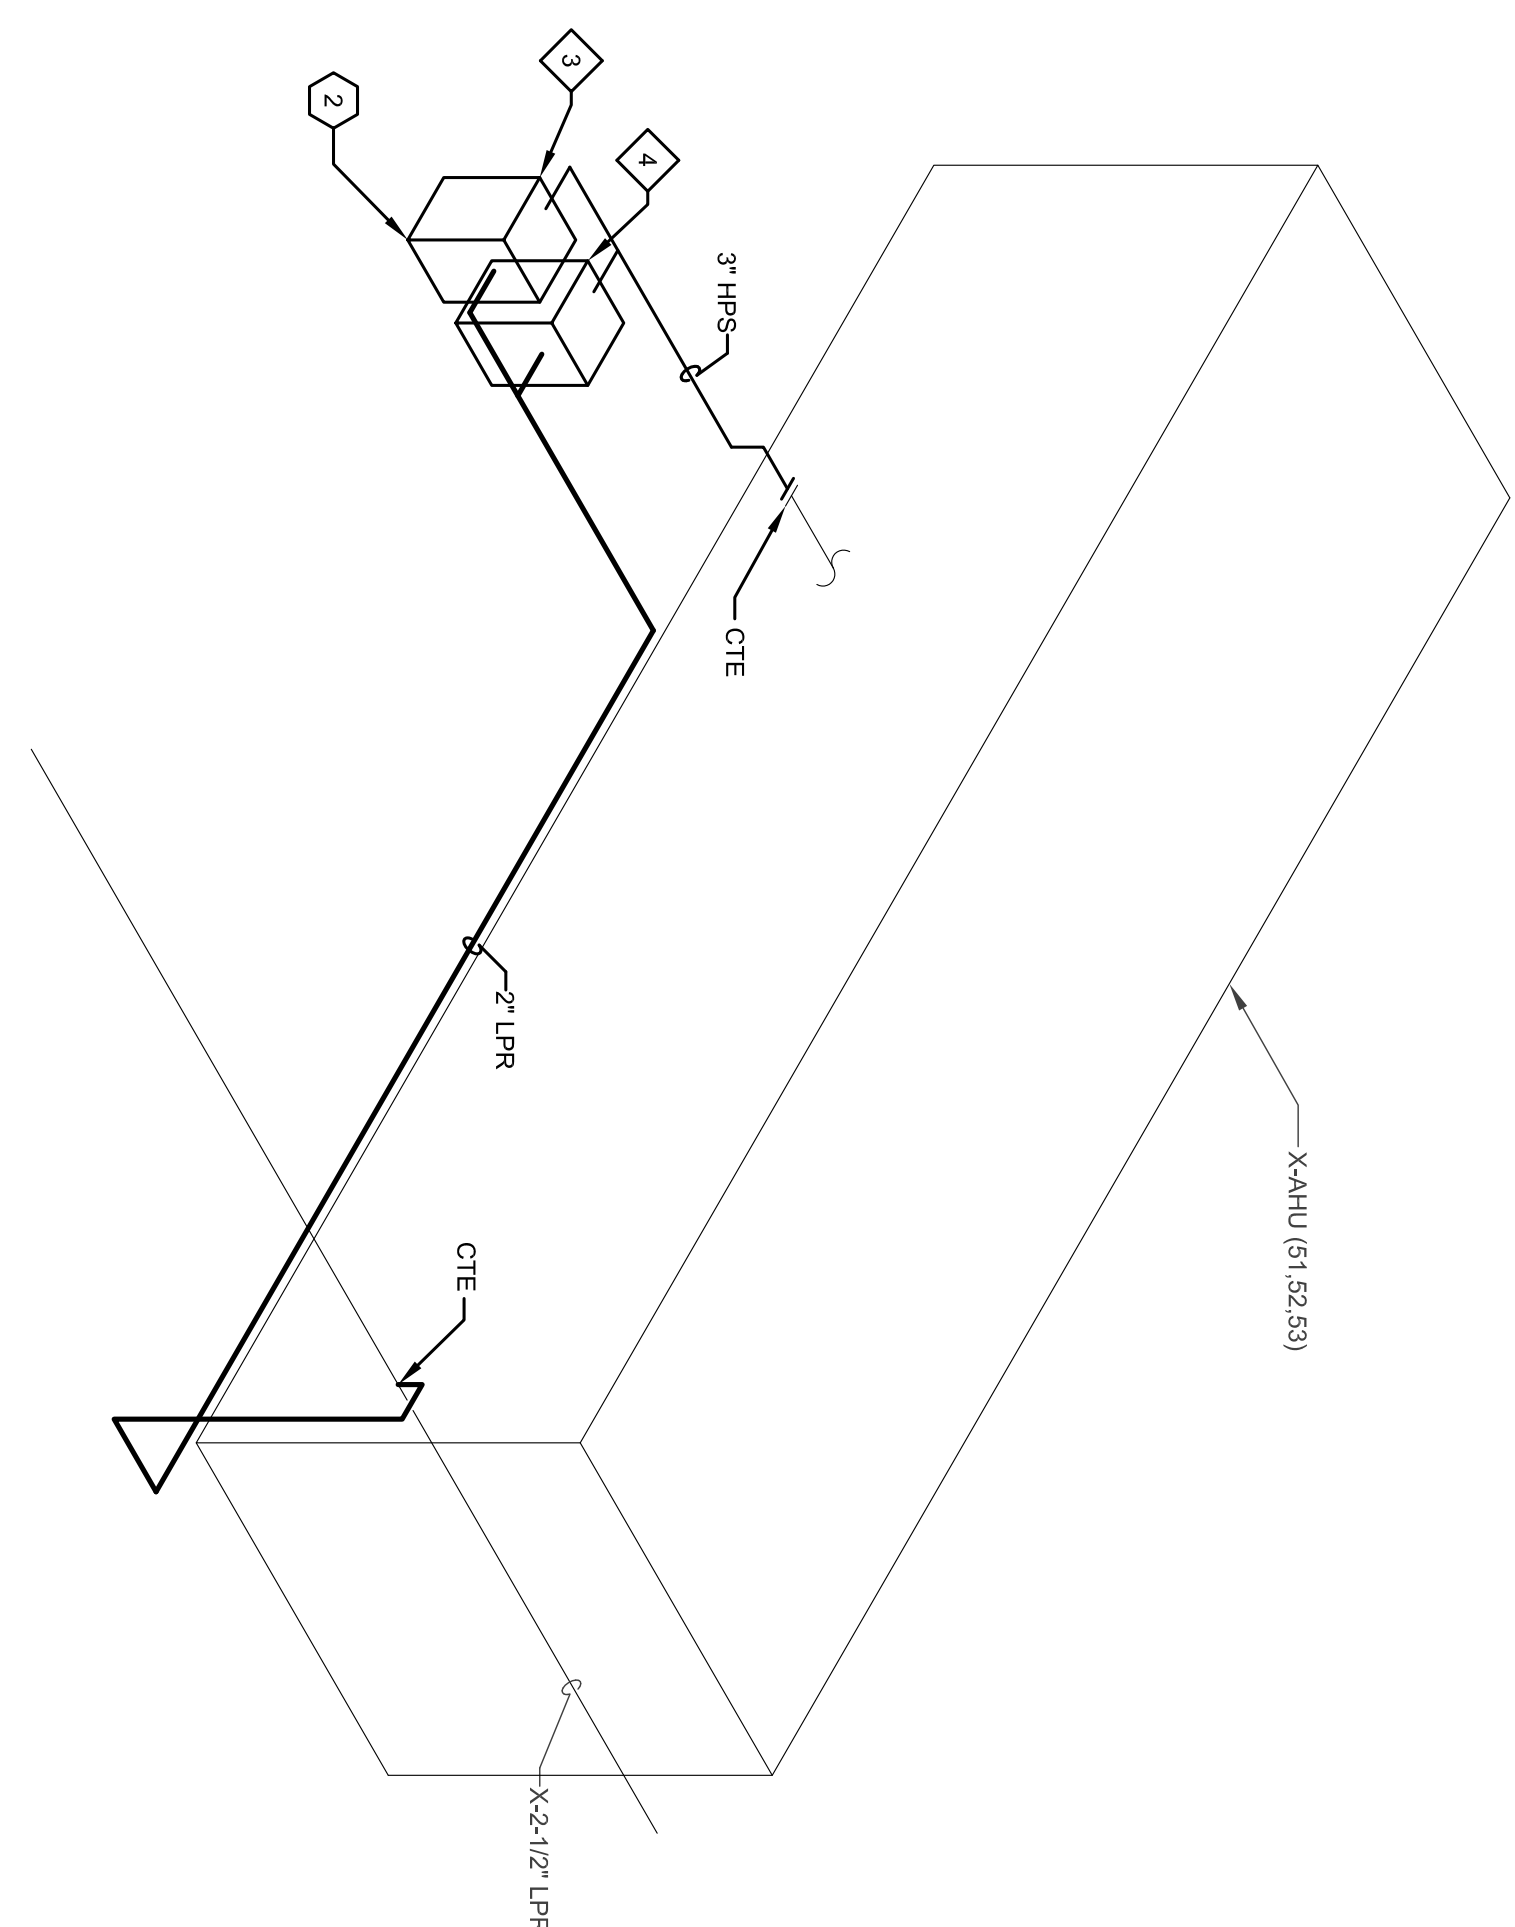

BASEMENT DETAIL 2 - NEW WORK PLAN AREA 5

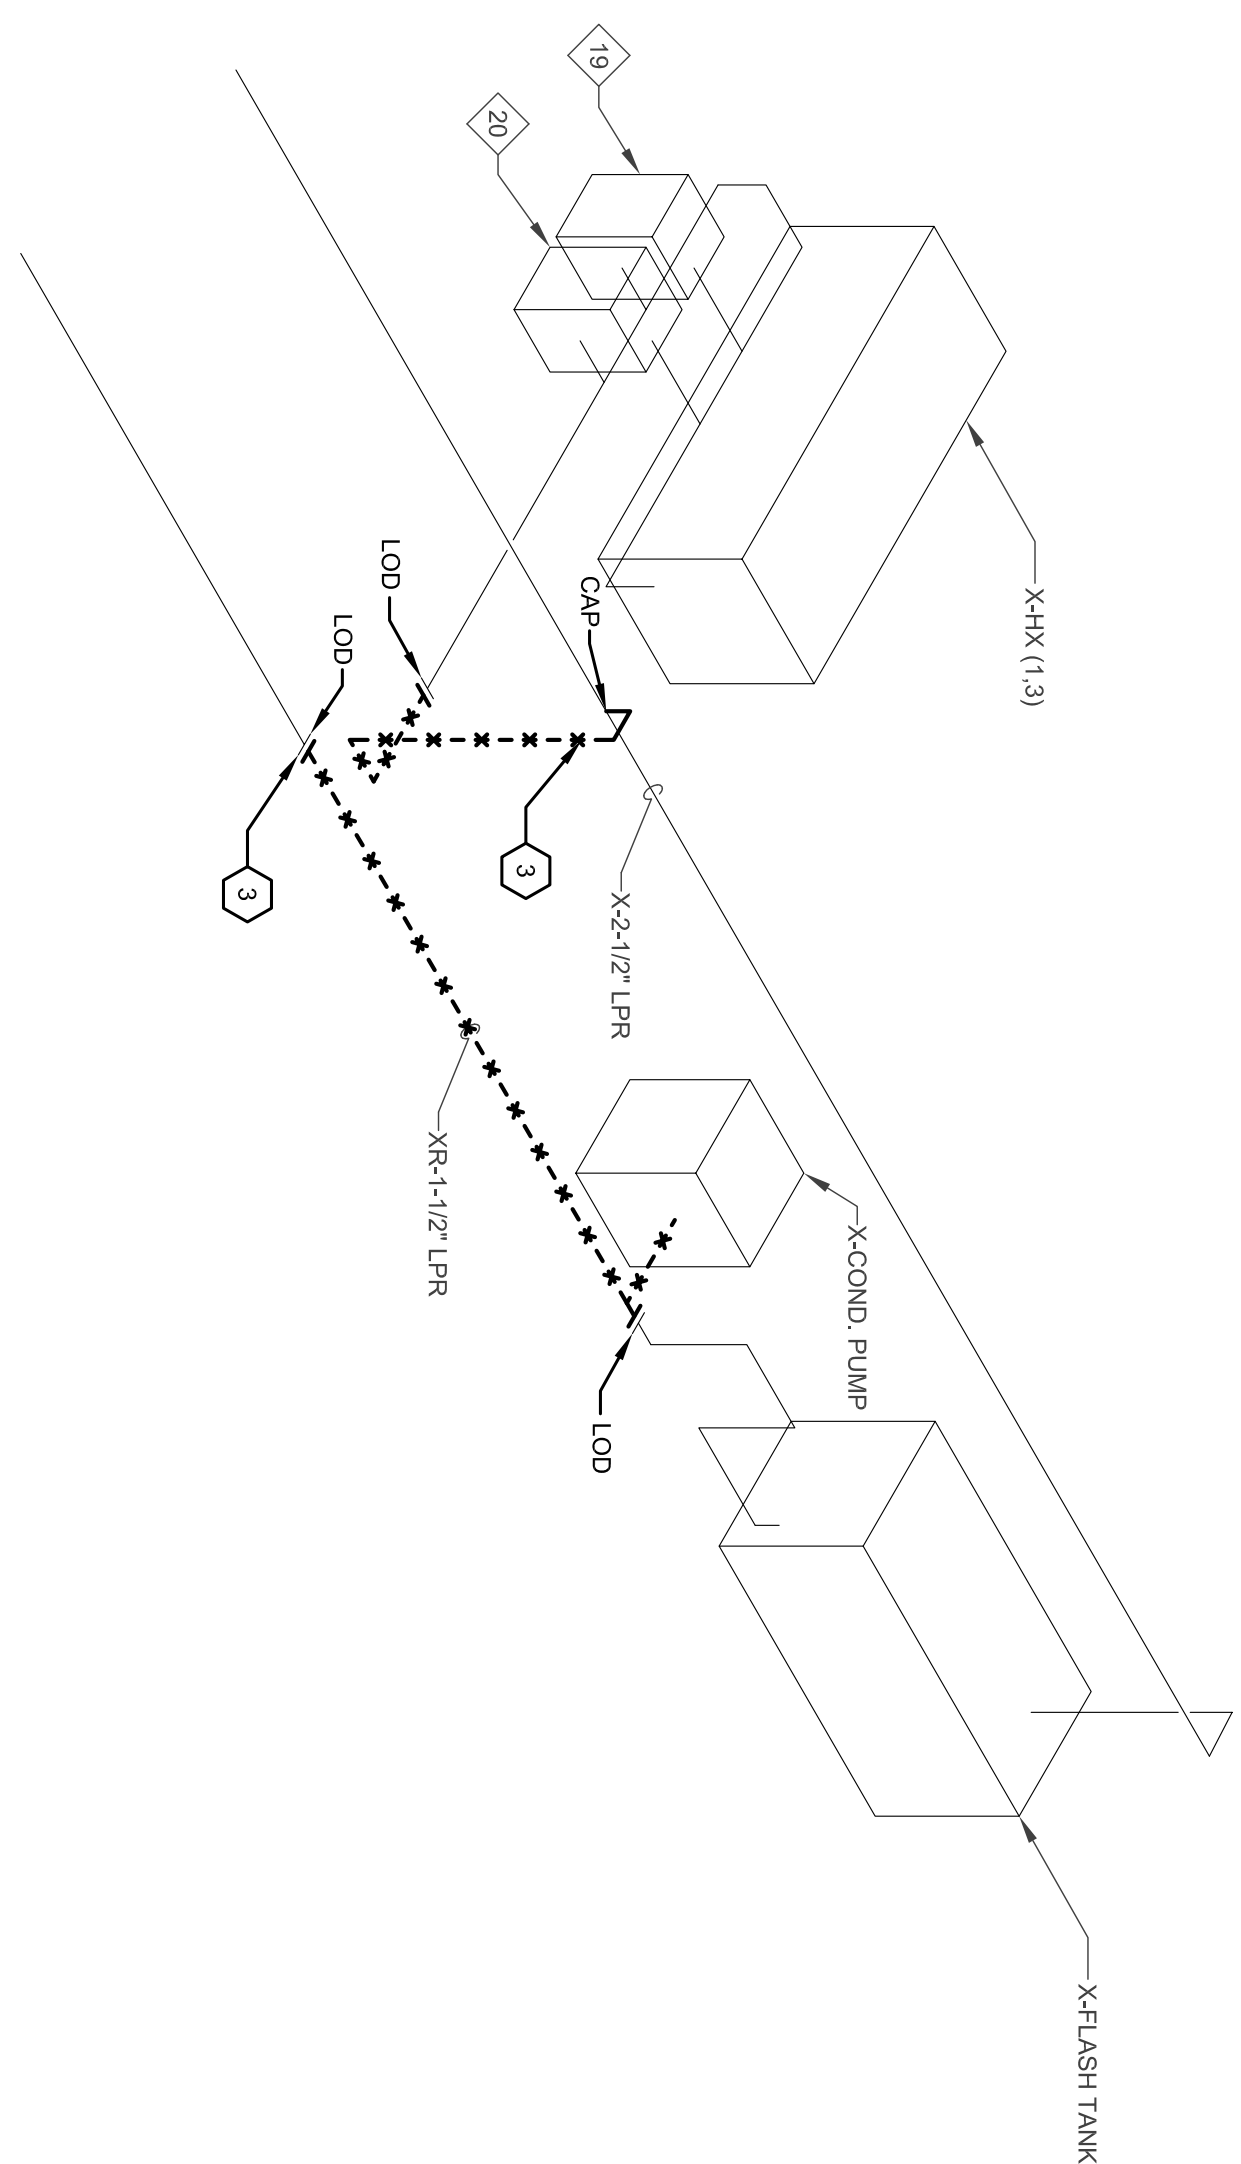

BASEMENT DETAIL 3 - DEMOLITION PLAN AREA 5
NOT TO SCALE ROOM BA109

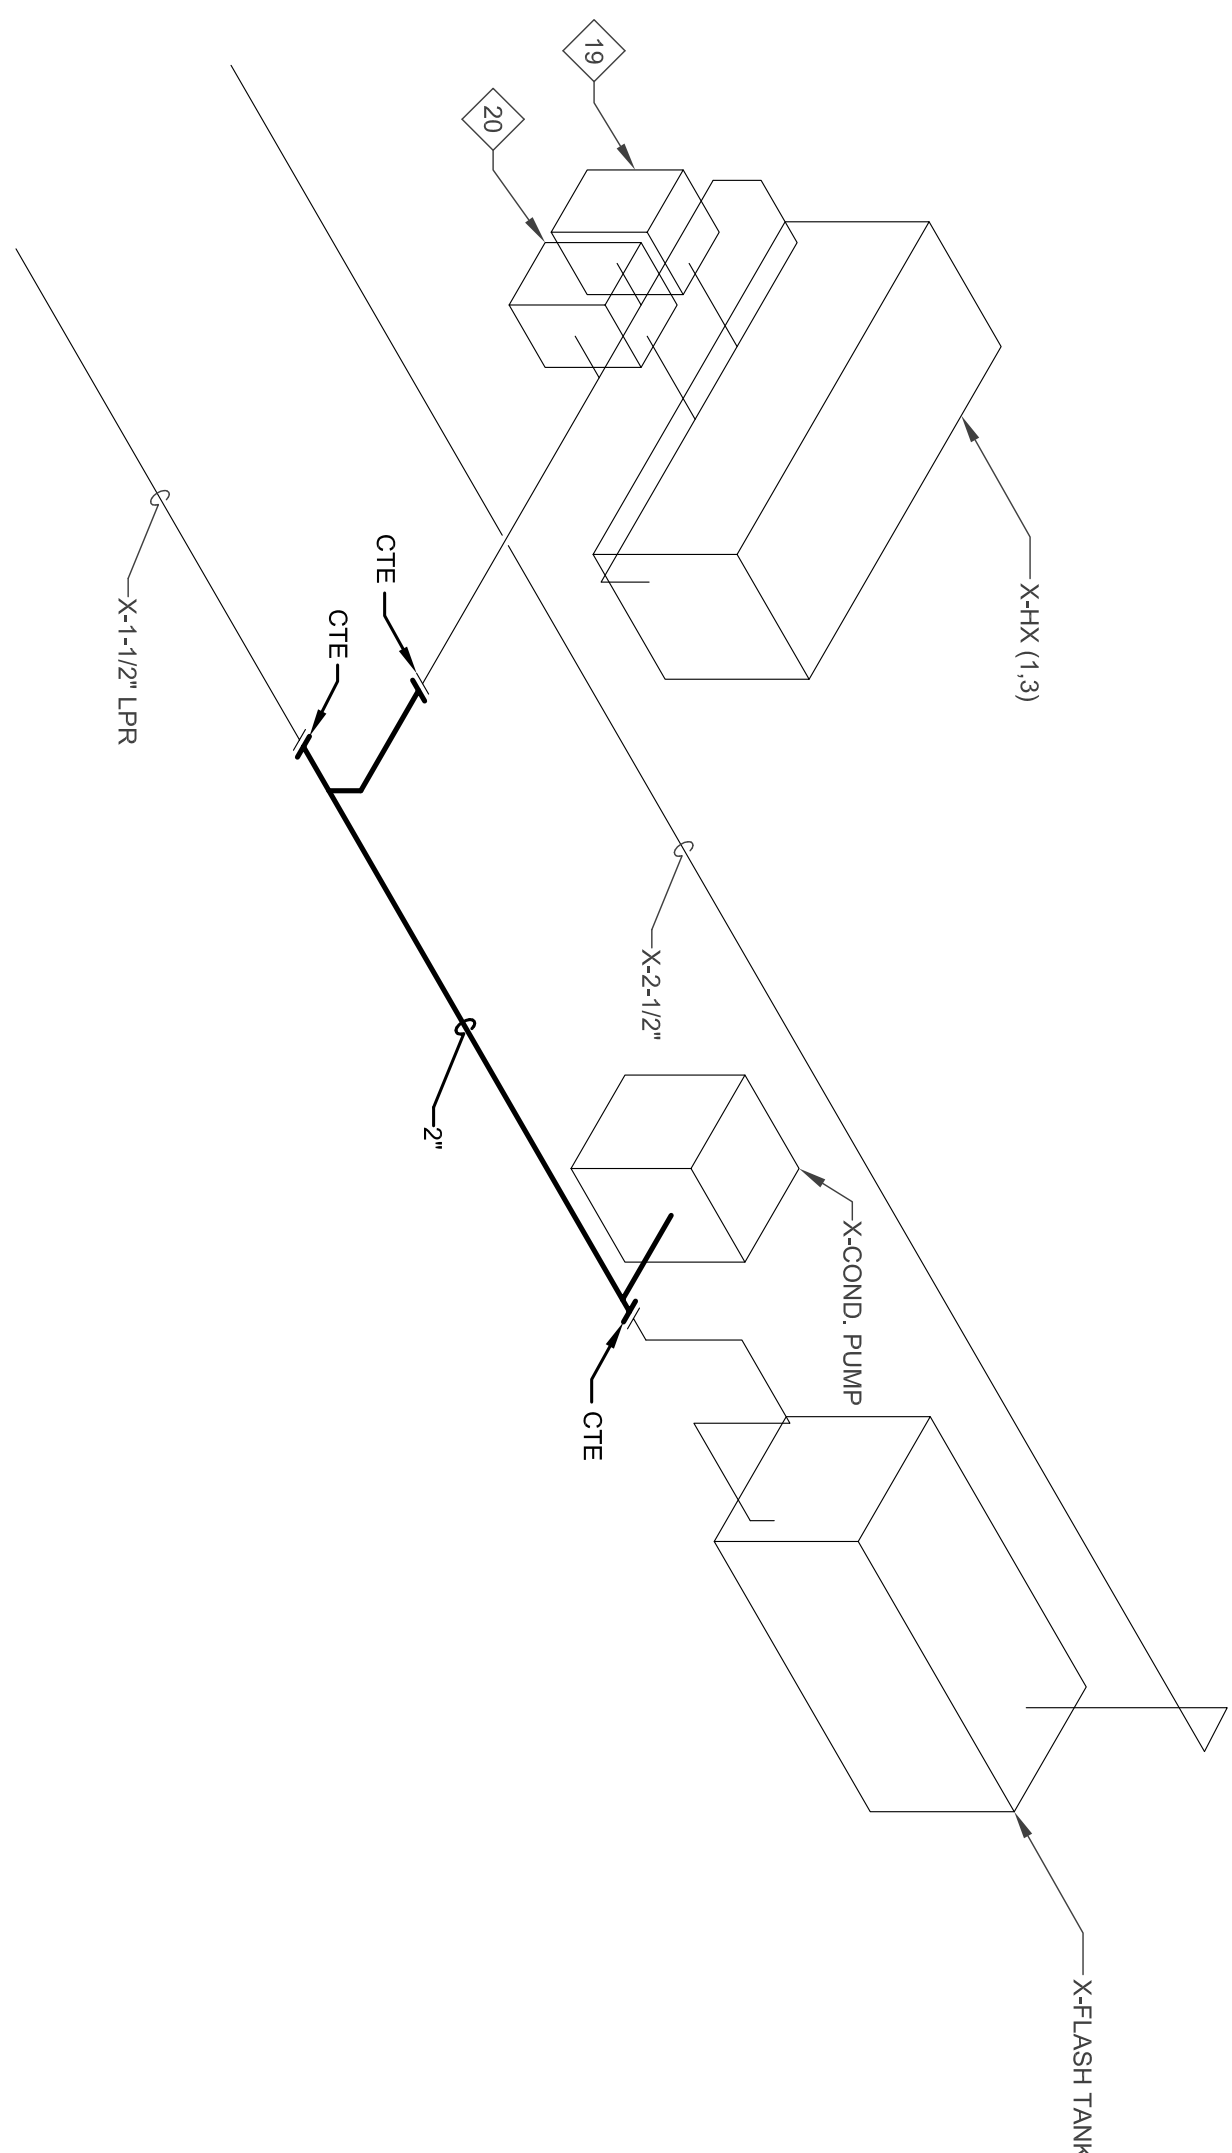


BASEMENT DETAIL 4 - NEW WORK PLAN AREA 5

CODED NOTES:

- 1. REMOVE EXISTING STEAM TRAPS COMPLETE.
- 2. INSTALL NEW STEAM TRAP/PUMP AND ASSOCIATED PIPING. CONNECT PIPING TO EXISTING CONDENSATE PIPING. SEE DETAIL 1406.
- 3. REMOVE EXISTING CONDENSATE PIPING AS SHOWN.

one eighth inch = one foot

0 4 8 16



one quarter inch = one foot

0 4 8

three eighths inch = one foot

one half inch = one foot

0

three quarters inch = one foot

one inch = one foot

6" 0

one and one half inches = one foot


6" 0

three inches = one foot
6"

ISSUED FOR REBID	05-23-13
FINAL CD-SUBMISSION	12-21-12
95% SUBMISSION	11-30-12
65% SUBMISSION	11-16-12
Revisions:	Date

CONSULTANTS:

F&T
FREDRICK, FREDRICK & TELLER
ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL (440) 546-8886
FAX (440) 546-8838

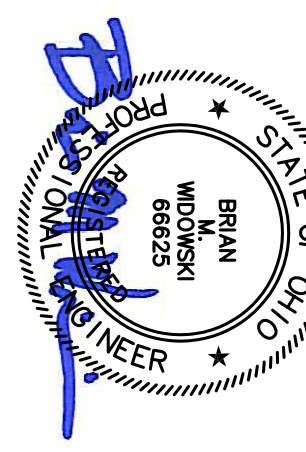

ARCHITECT:

BASEMENT STEAM/CONDENSATE PIPING DETAILS

Approved: Project Director

Project Title

UPGRADES

VAMC

Date _____

Checked

WFW

541-12-115

→

4-05

**Office of
Facilities
Management**

