



BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 1
NOT TO SCALE ROOM K16 1

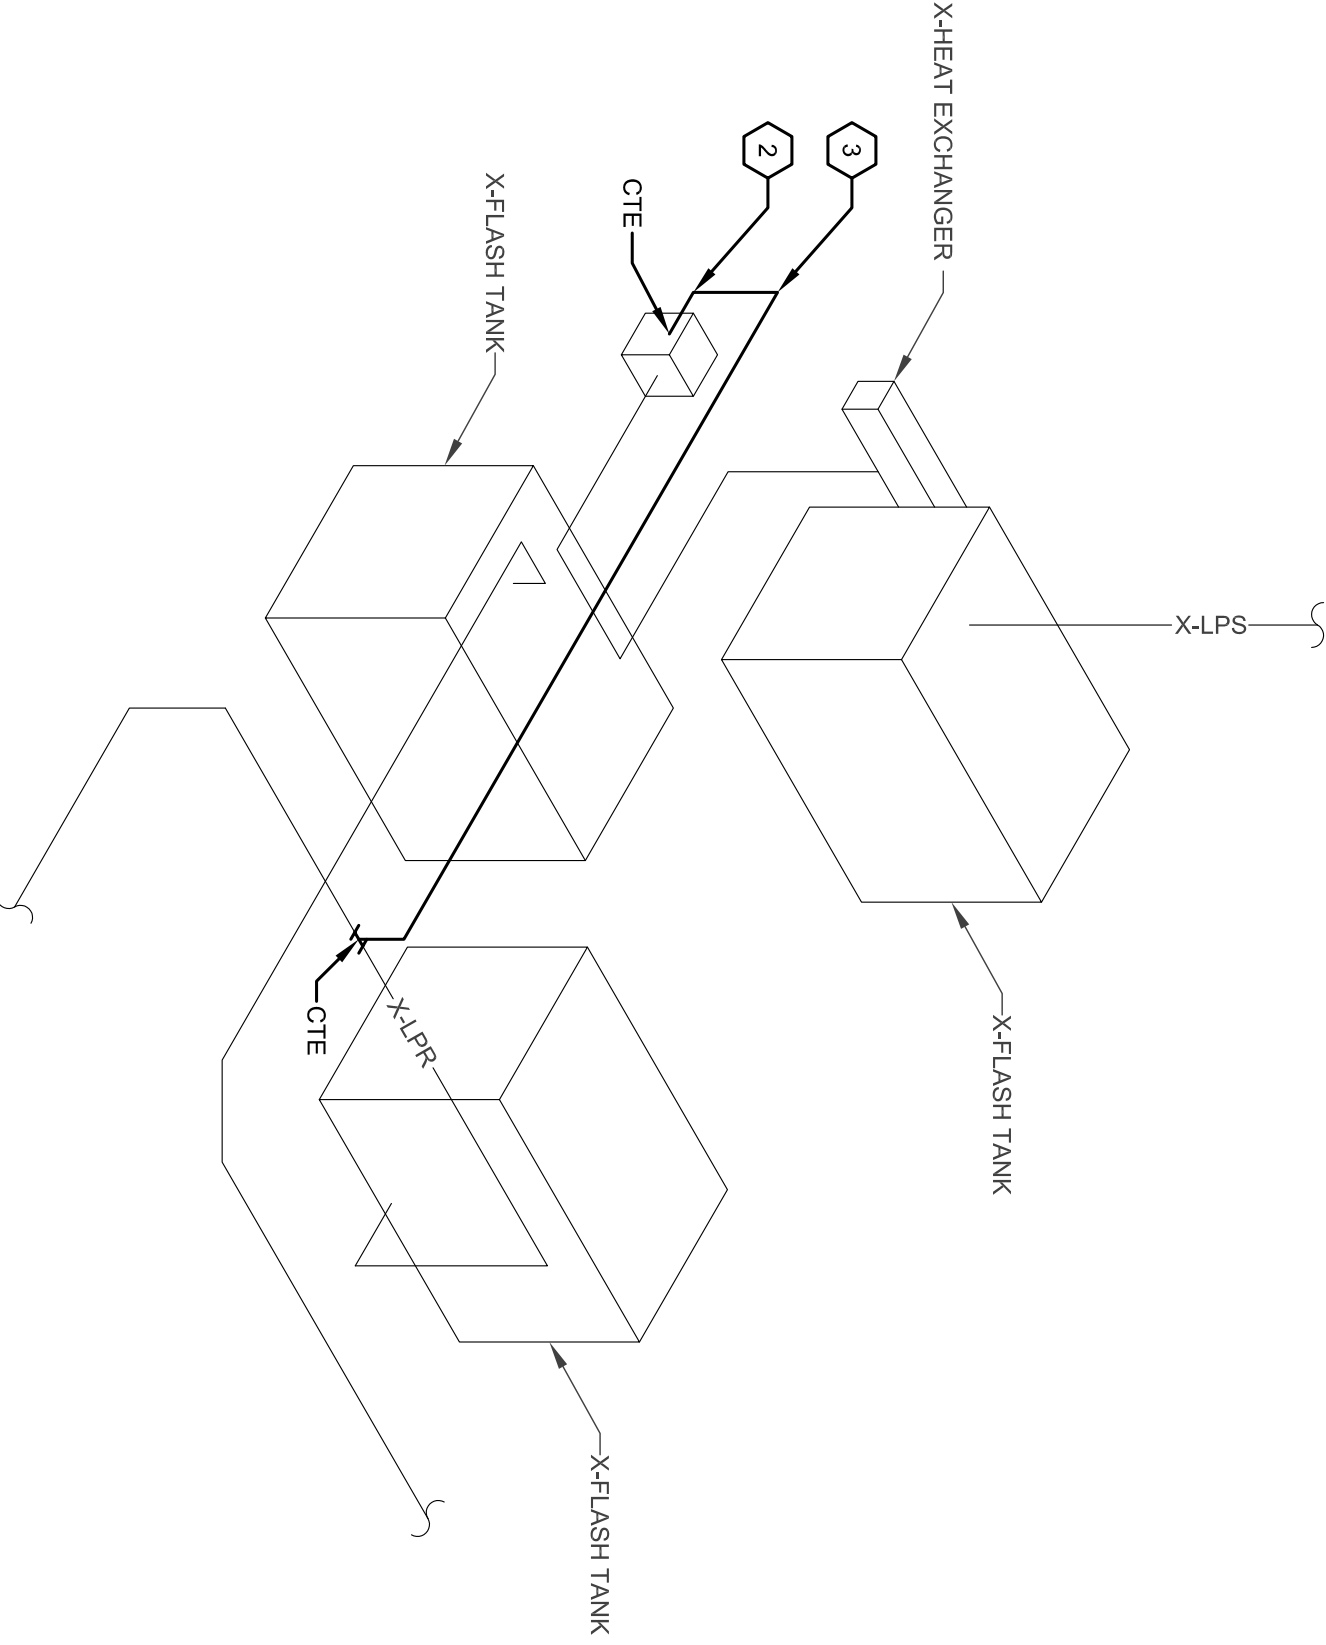

BASEMENT DETAIL 2 - NEW WORK PLAN AREA 1
NOT TO SCALE ROOM K16 2

CODED NOTES:
1 REMOVE CONDENSATE LINE BACK FROM TRAP TO EXISTING IMN.
2 INSTALL NEW CONDENSATE PIPING TO EXISTING CONDENSATE RETURN LINE.
3 NEW CONDENSATE RETURN LINE TO BE INSTALLED UNDER EXISTING HEAT EXCHANGER.

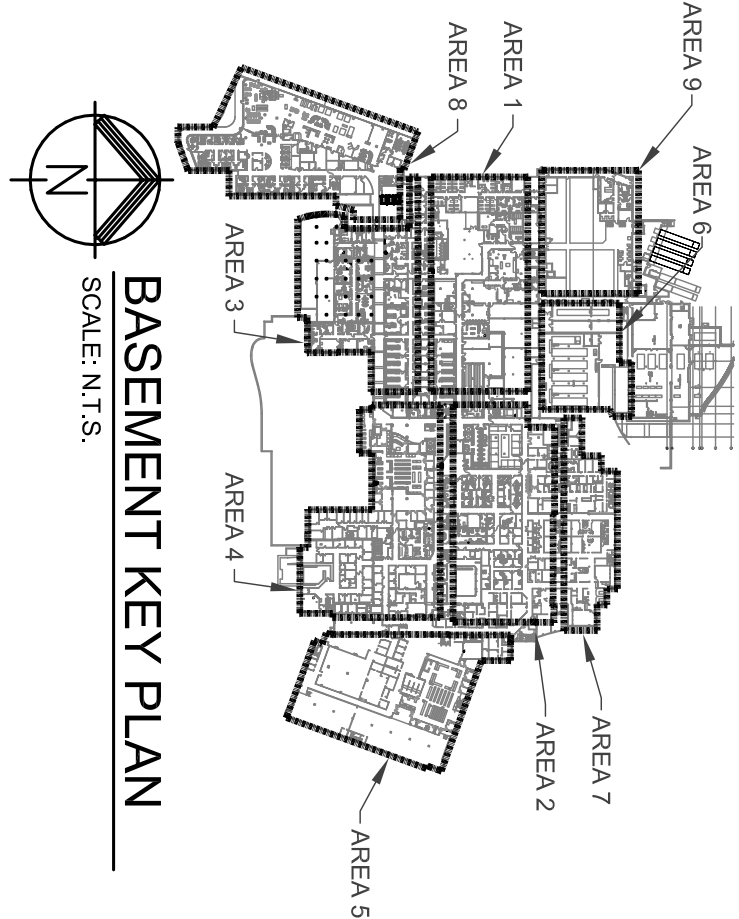

ISSUED FOR REBID		06-23-13	
FINAL CD-SUBMISSION		12-21-12	
95% SUBMISSION		11-30-12	
65% SUBMISSION		11-16-12	
Revisions:		Date	
CONSULTANTS:		ARCHITECT:	
FREDRICK, FREDRICK & HELLER ENGINEERS, INC. 872 EAST ROYALTON ROAD BROADVIEW HTS., OHIO 44147 TEL: (440) 346-8800 FAX: (440) 346-8888		Drawing Title BASEMENT STEAM/CONDENSATE PIPING DETAILS	
Approved Project Director		Project Title STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES	
Date 12-21-12		Location VAMC - WADE PARK	
Checked WFW		Drawn JMF	
Building Number 1		Drawing Number 4-02	
Office of Facilities Management		Project Number 641-12-115	
DRAFTING WORKS-ALLIANCE			