


BASEMENT DETAIL 1 - DEMOLITION PLAN AREA 1

NOT TO SCALE ROOM K05


1

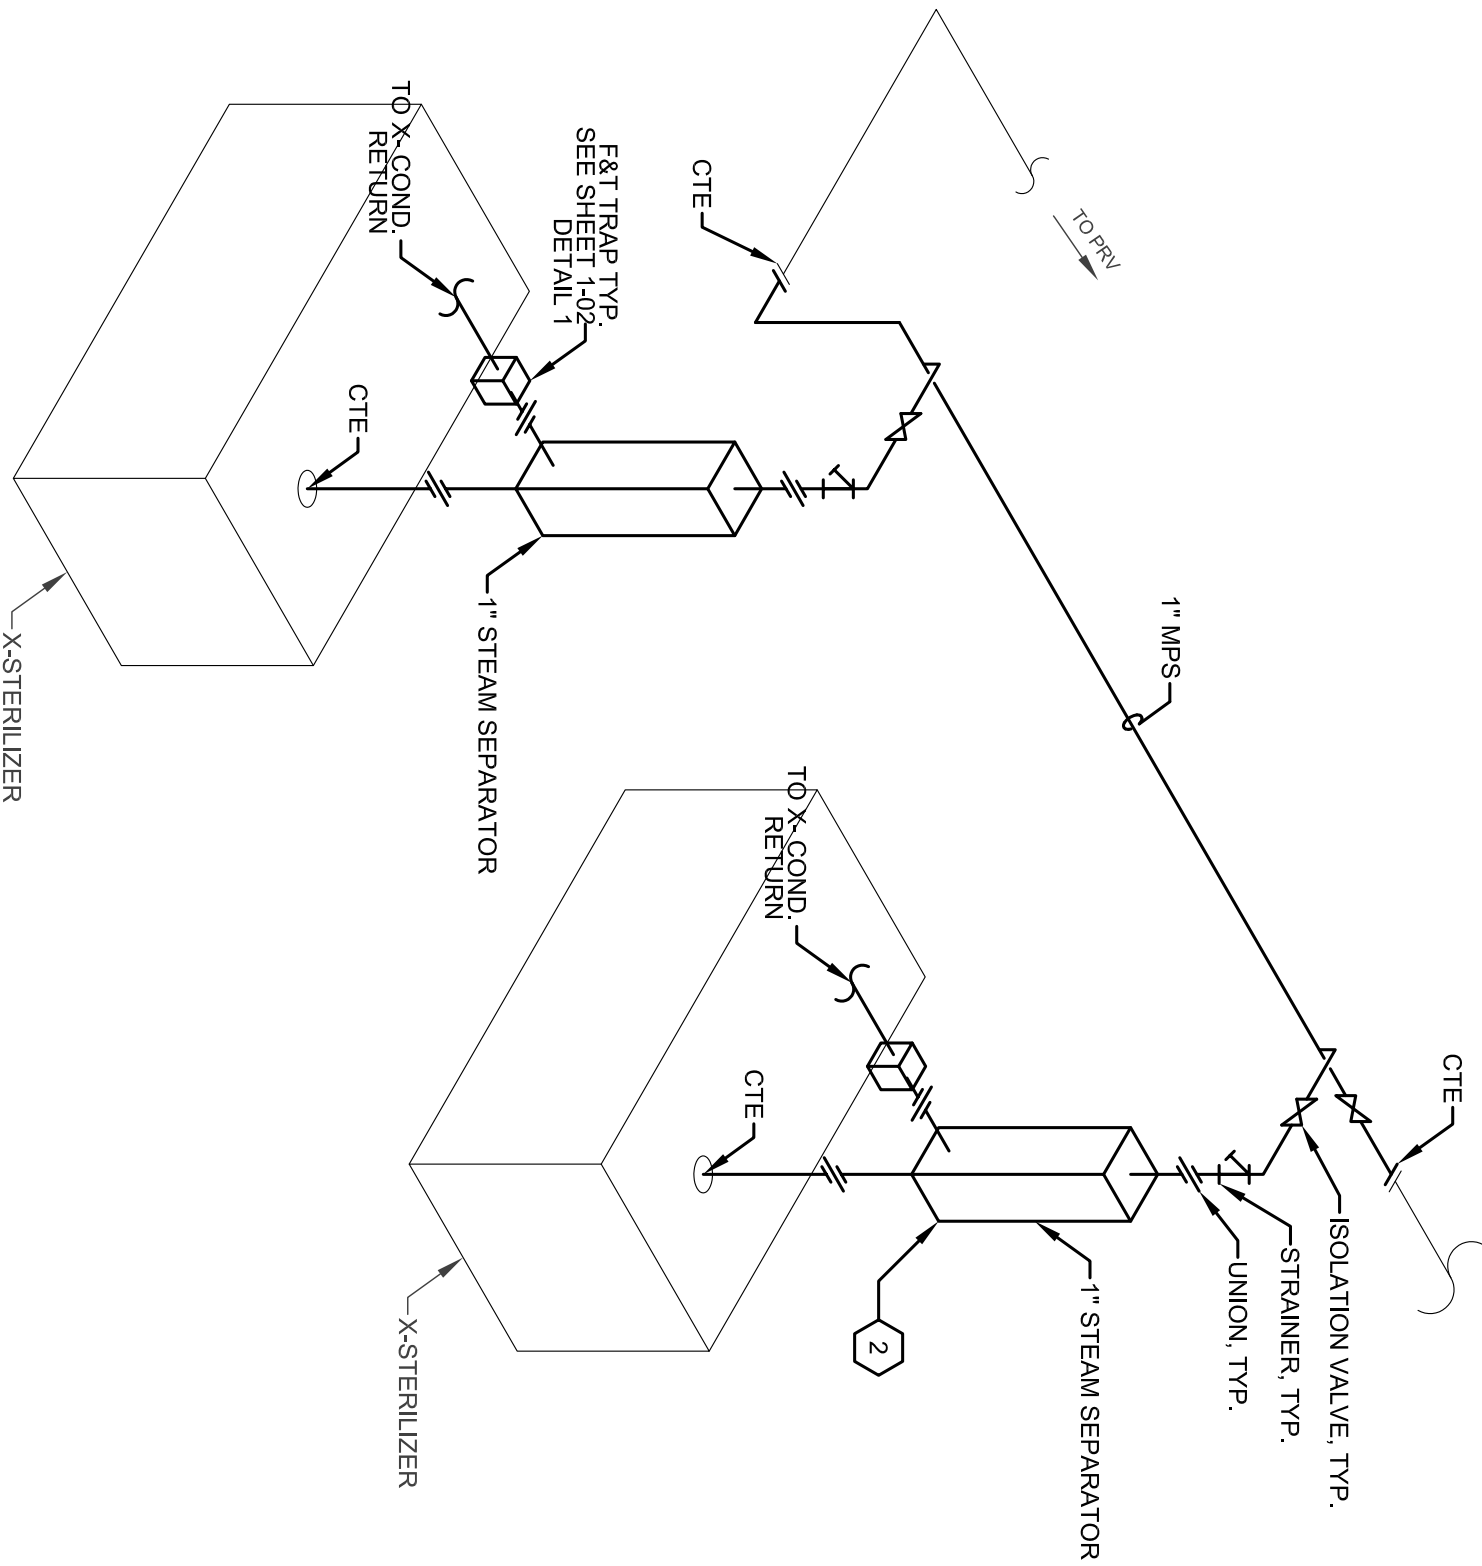


BASEMENT DETAIL 2 - NEW WORK PLAN AREA 1

NOT TO SCALE ROOM K05

2

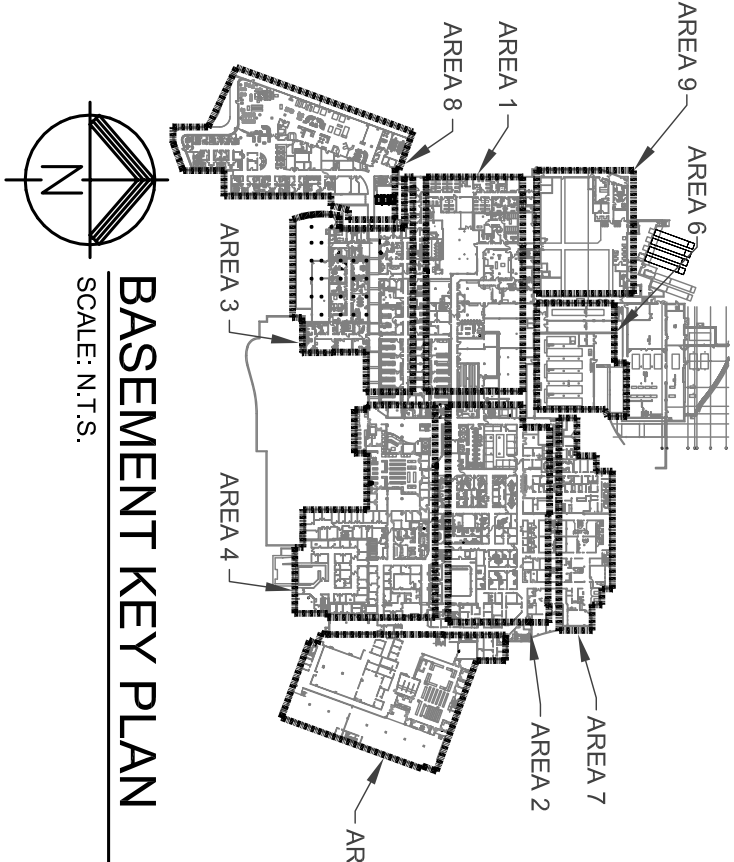


- CODED NOTES:**
- 1 REMOVE STEAM LINE AS SHOWN.
  - 2 INSTALL VERTICAL STEAM SEPARATOR ASSEMBLY TO STERILIZER.
  - 3 REMOVE CONDENSATE RETURN LINE AS INDICATED.
  - 4 NEW CONDENSATE RETURN LINE TO BE INSTALLED UNDER EXISTING FOL

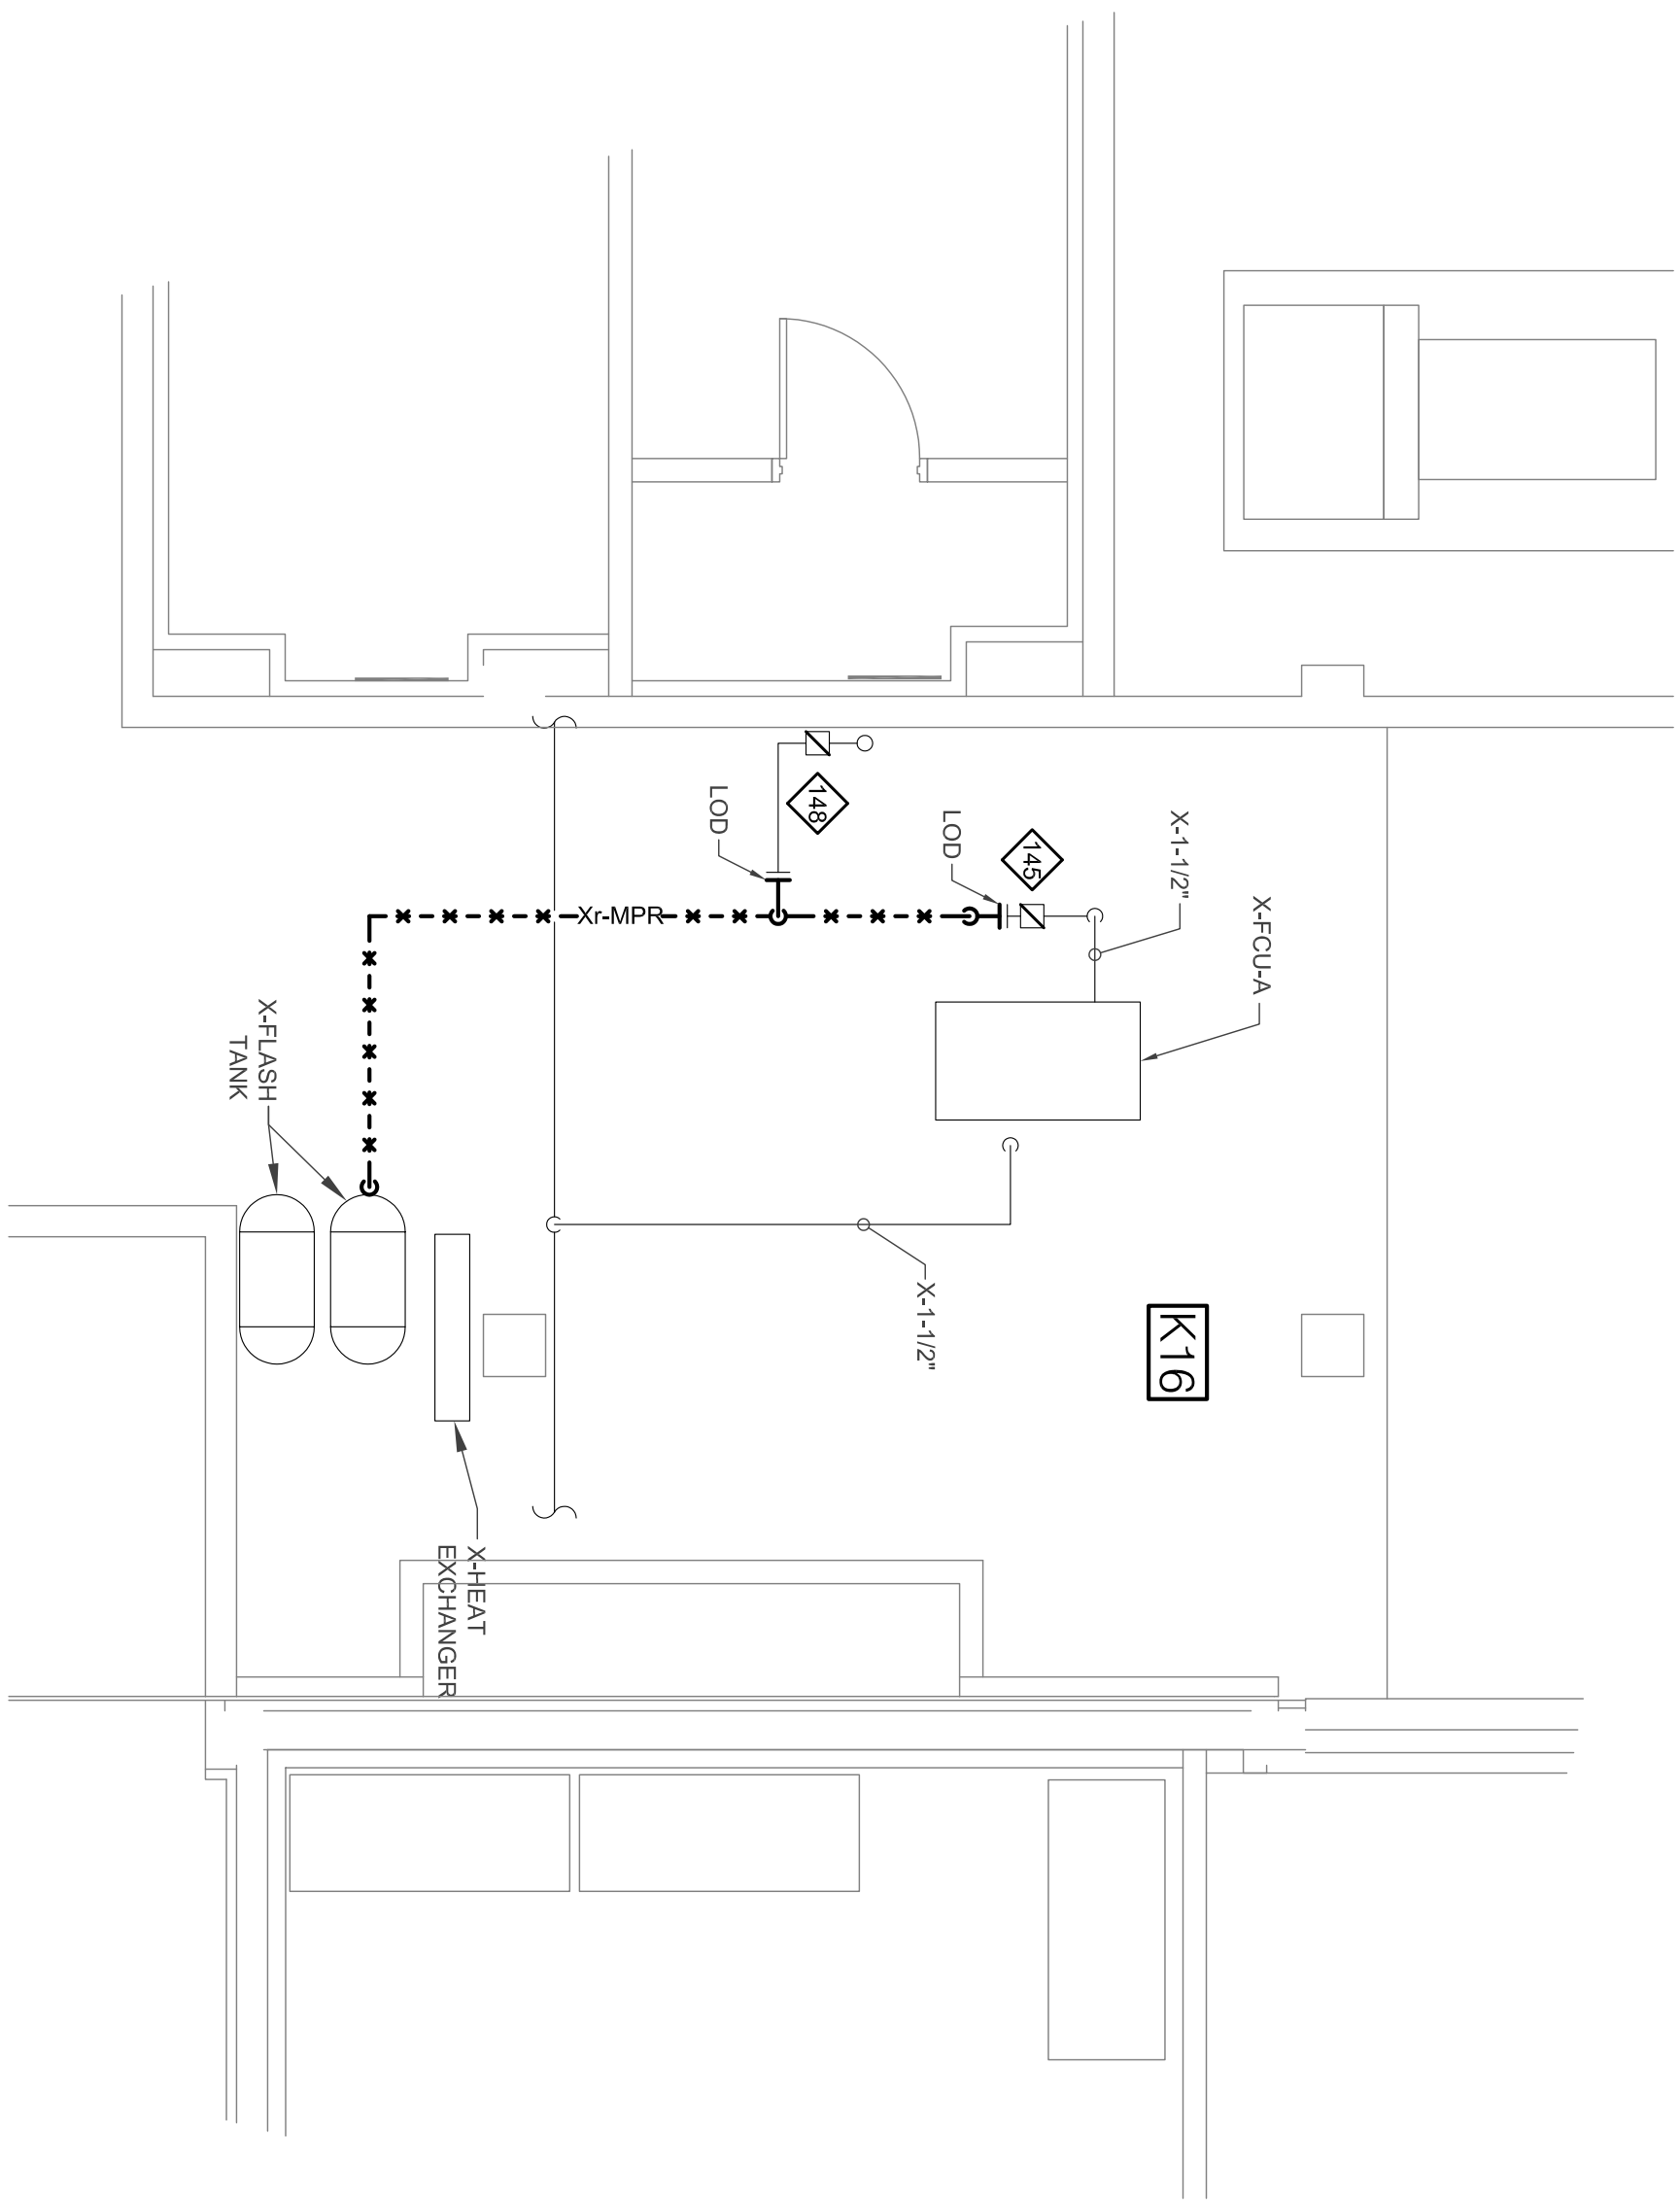

BASEMENT DETAIL 3 - DEMOLITION PLAN AREA 1

NOT TO SCALE

3

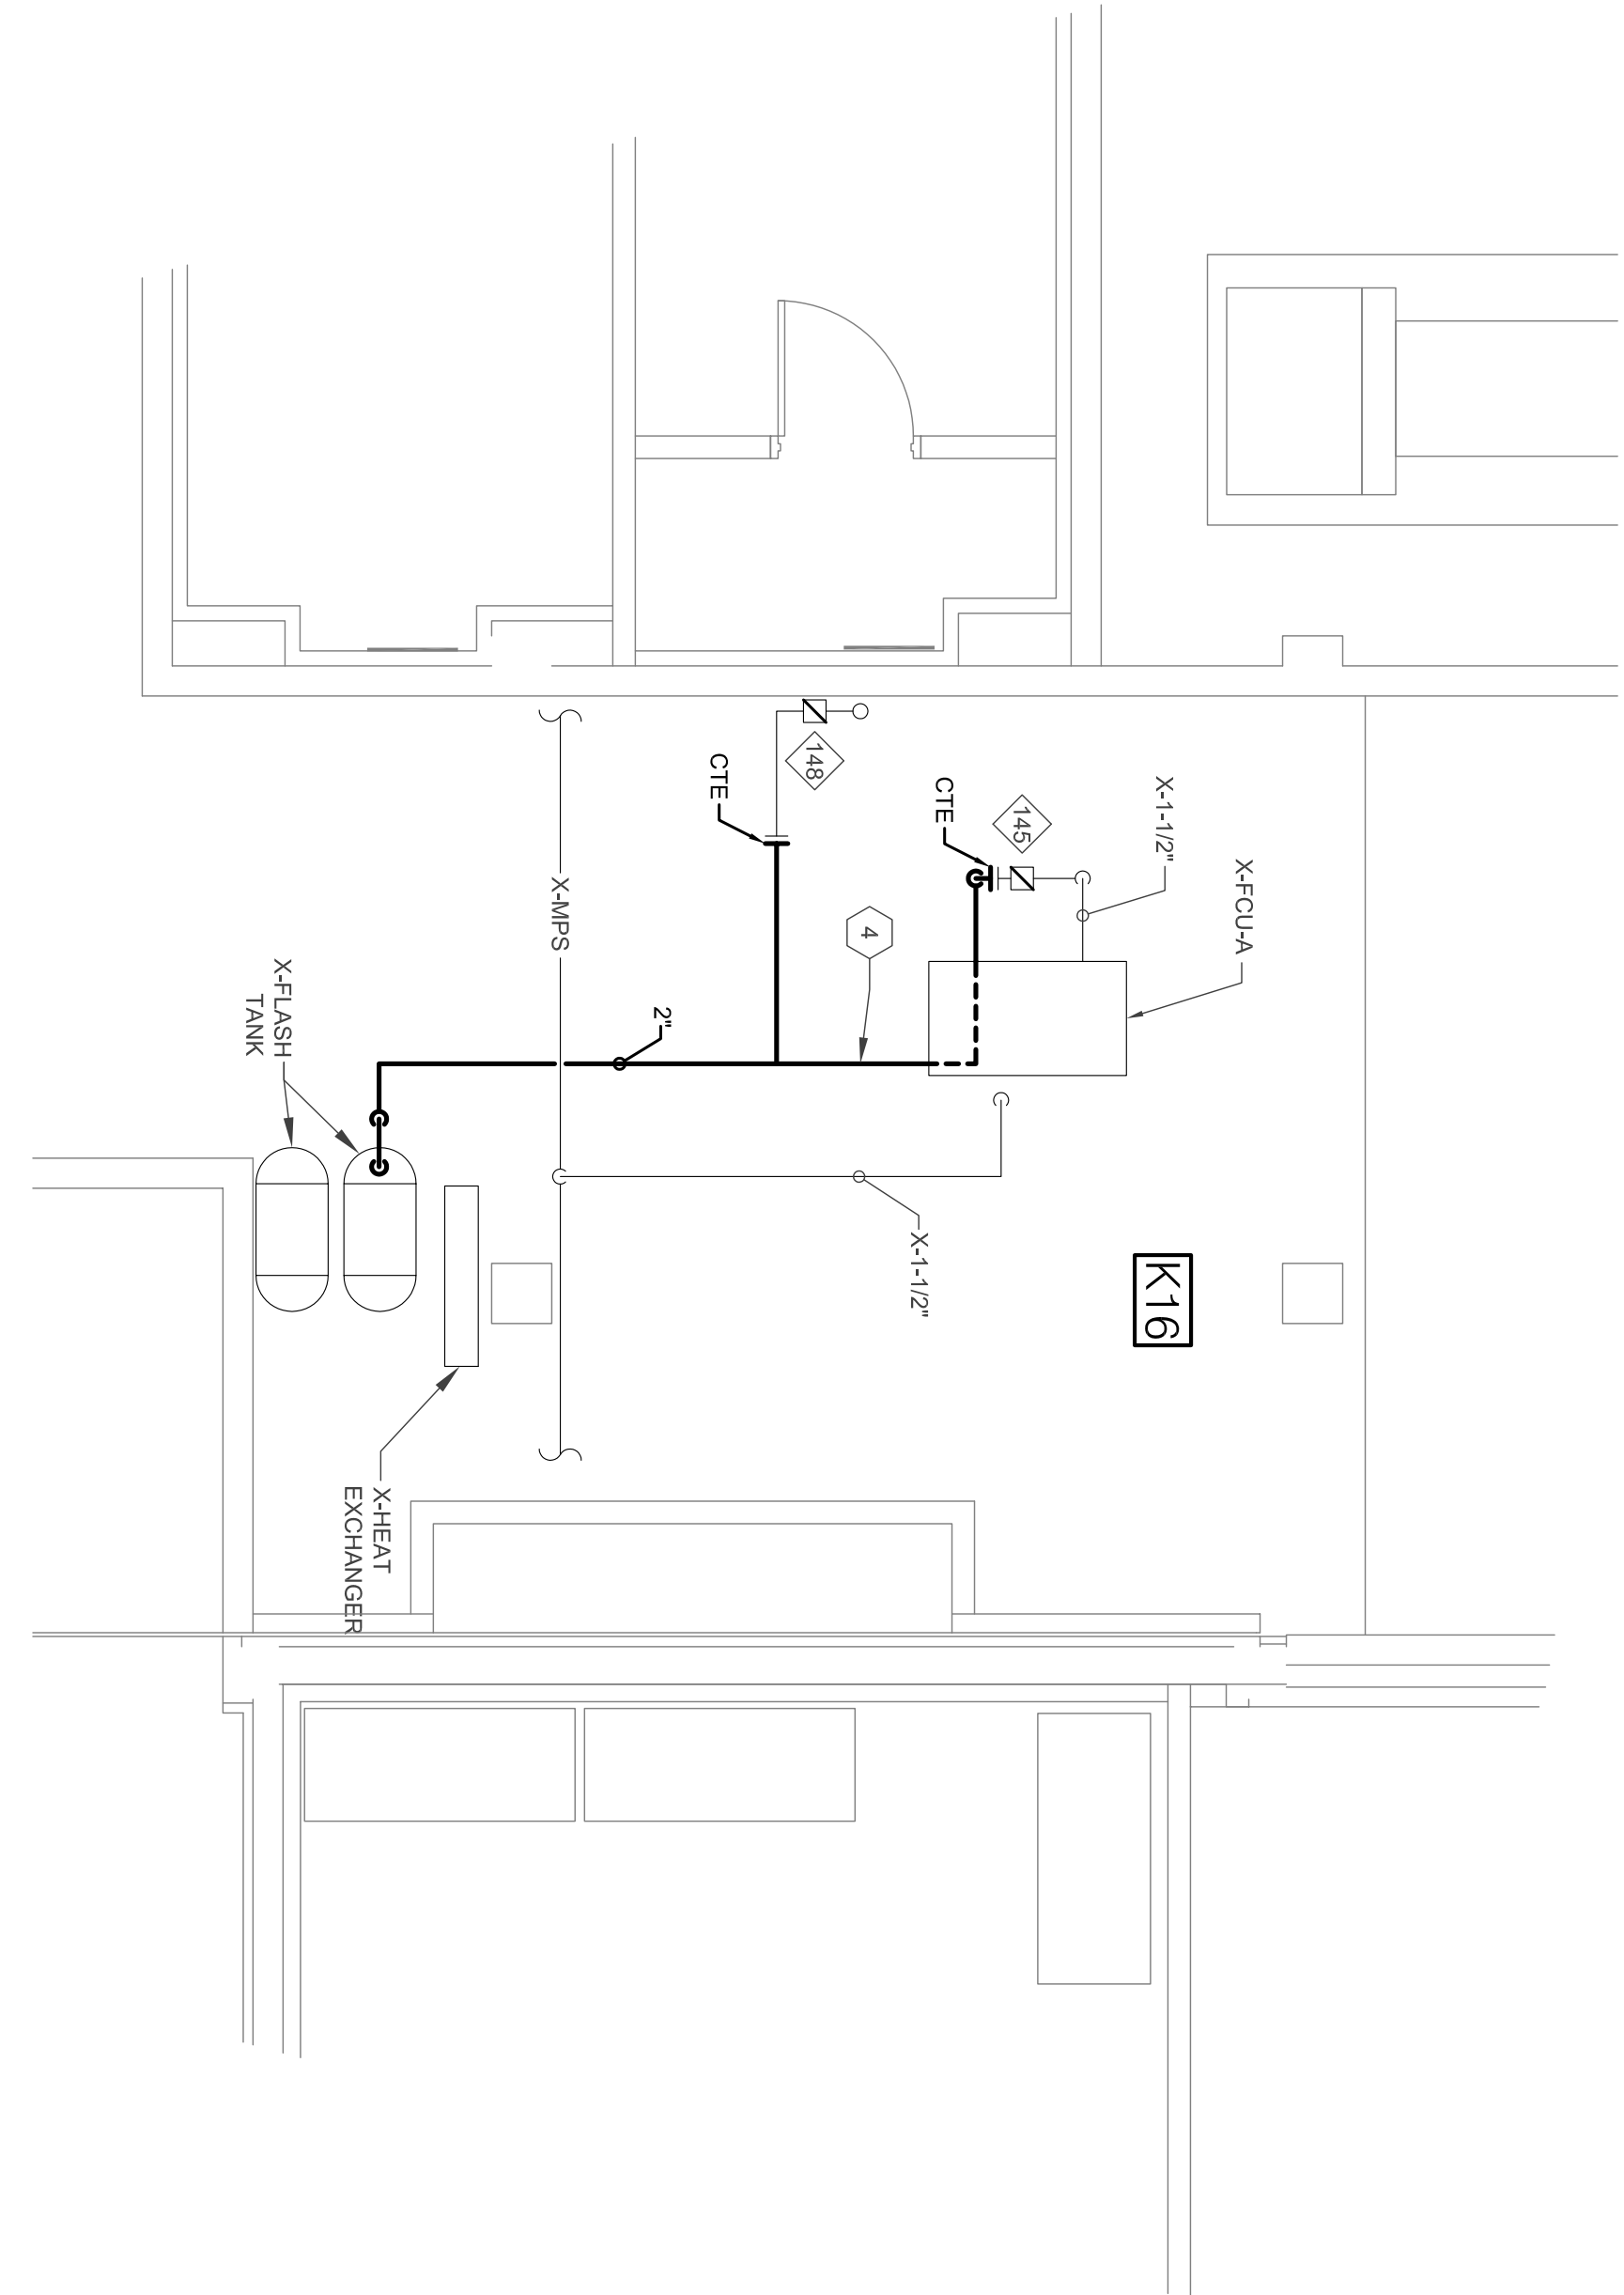

BASEMENT DETAIL 4 - NEW WORK PLAN AREA 1

NOT TO SCALE

4

|  |  |   |  |
|--|--|---|--|
| <b>CONSULTANTS:</b>  |  | <b>ARCHITECT:</b>   |  |
| ISSUED FOR PERIOD<br>FINAL CD SUBMISSION<br>65% SUBMISSION<br>11-16-12   |  | Drawing Title<br><b>BASEMENT STEAM/CONDENSATE PIPING DETAILS</b>              |  |
| FREDERICK, FREDERICK & HEILER<br>ENGINEERS, INC.<br>872 EAST ROYALTON ROAD<br>BROADVIEW HTS., OHIO 44147<br>PH: (440) 546-0888 |  | Approved Project Director   |  |
| Revisions:   |  | Project Title<br><b>STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES</b> |  |
| Date   |  | Location<br><b>VAMC - WADE PARK</b>   |  |
| 12-21-12   |  | Checked<br>JFW  |  |
| 11-16-12   |  | Drawn<br>JMF  |  |
| 10-23-13   |  | Project Number<br>541-12-115  |  |
| 12-21-12   |  | Building Number<br>1  |  |
| 11-30-12   |  | Drawing Number<br>4-01  |  |
| 11-16-12   |  | Office of Facilities Management   |  |