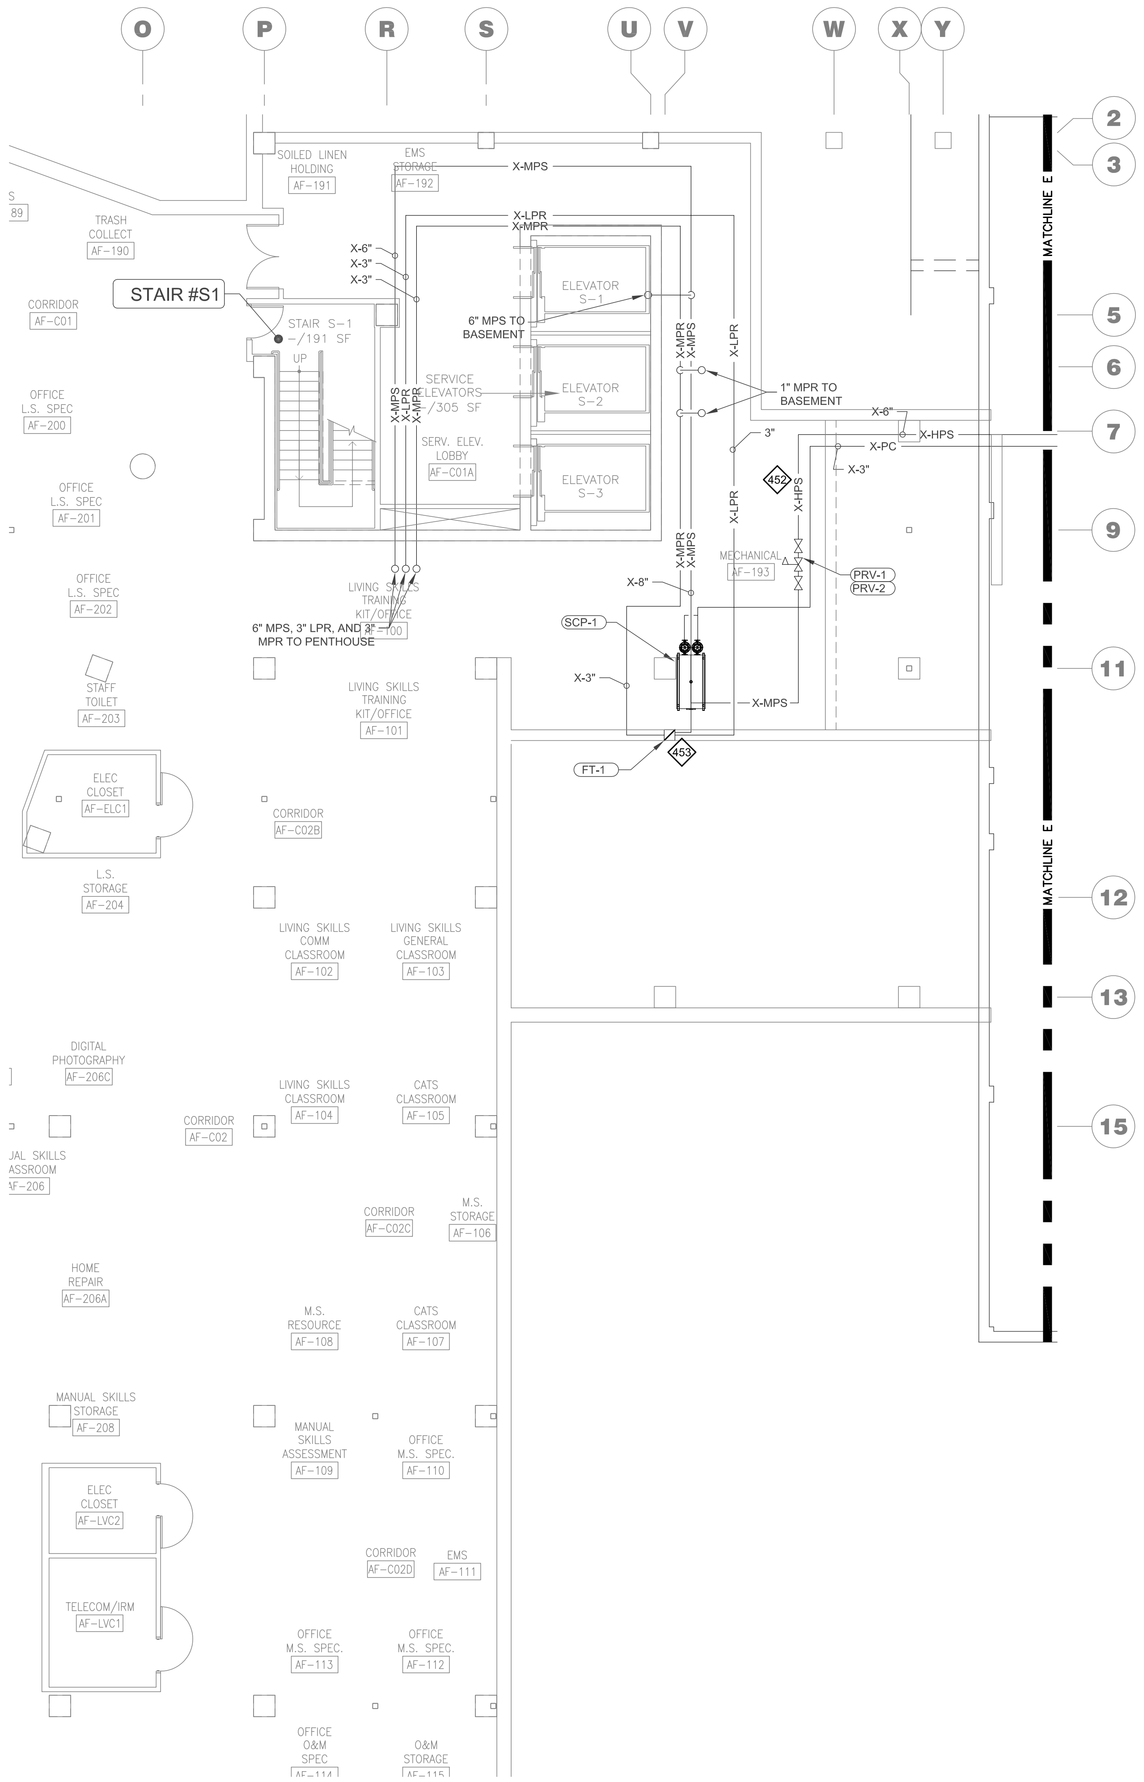

PARTIAL SUB-BASEMENT - STEAM PIPING - AREA 5 (1)

SCALE: 1/8" = 1'-0"

0' 4' 8' 16' 32'

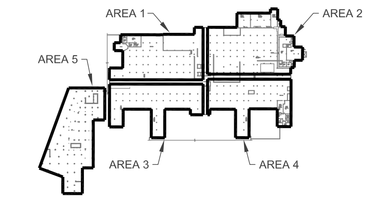

SUB-BASEMENT KEY PLAN

SCALE: N.T.S.

GENERAL NOTES:

A. SUB-BASEMENT SHOWN ON THIS PLAN CAN BEGIN IN PHASE 1. WORK ON THIS PLAN SHALL BE COMPLETED PRIOR TO THE END OF PHASE 2.

B. SUB-BASEMENT IS A CRAWL SPACE APPROXIMATELY FOUR (4) FEET HIGH WITH LIMITED CLEARANCE AND LIGHTING. ACCESS TO SUB-BASEMENT CAN BE ACHIEVED THROUGH STAIR NUMBER EIGHT (8) AND/OR STAIR NUMBER FIVE (5). ALL PIPING SHOWN IS LOCATED BELOW THE BASEMENT IN THE SUB-BASEMENT.

C. ANY OPEN FLAME CUTTING, BRAZING OR WELDING IN SUB-BASEMENT WILL REQUIRE SPOT EXHAUST DUCTED TO OUTSIDE. CONTRACTOR SHALL SUBMIT VENTILATION PLAN TO VA FOR APPROVAL PRIOR TO STARTING WORK.

ISSUED FOR REBID	05-23-13
FINAL CD-SUBMISSION	12-21-12
95% SUBMISSION	11-30-12
65% SUBMISSION	11-16-12
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — BRIAN M. WOJCIWSKI 66625 — PROFESSIONAL ENGINEER

ARCHITECT:

Approved: Project Director

Drawing Title: SUB-BASEMENT FLOOR PLAN AREA 5

Project Title: **STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES**

Location: **VAMC - WADE PARK**

Date: 12-21-12 | Checked: WFW | Drawn: JWF

Project Number: 541-12-115

Building Number: 1

Drawing Number: 3-SB-5

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978