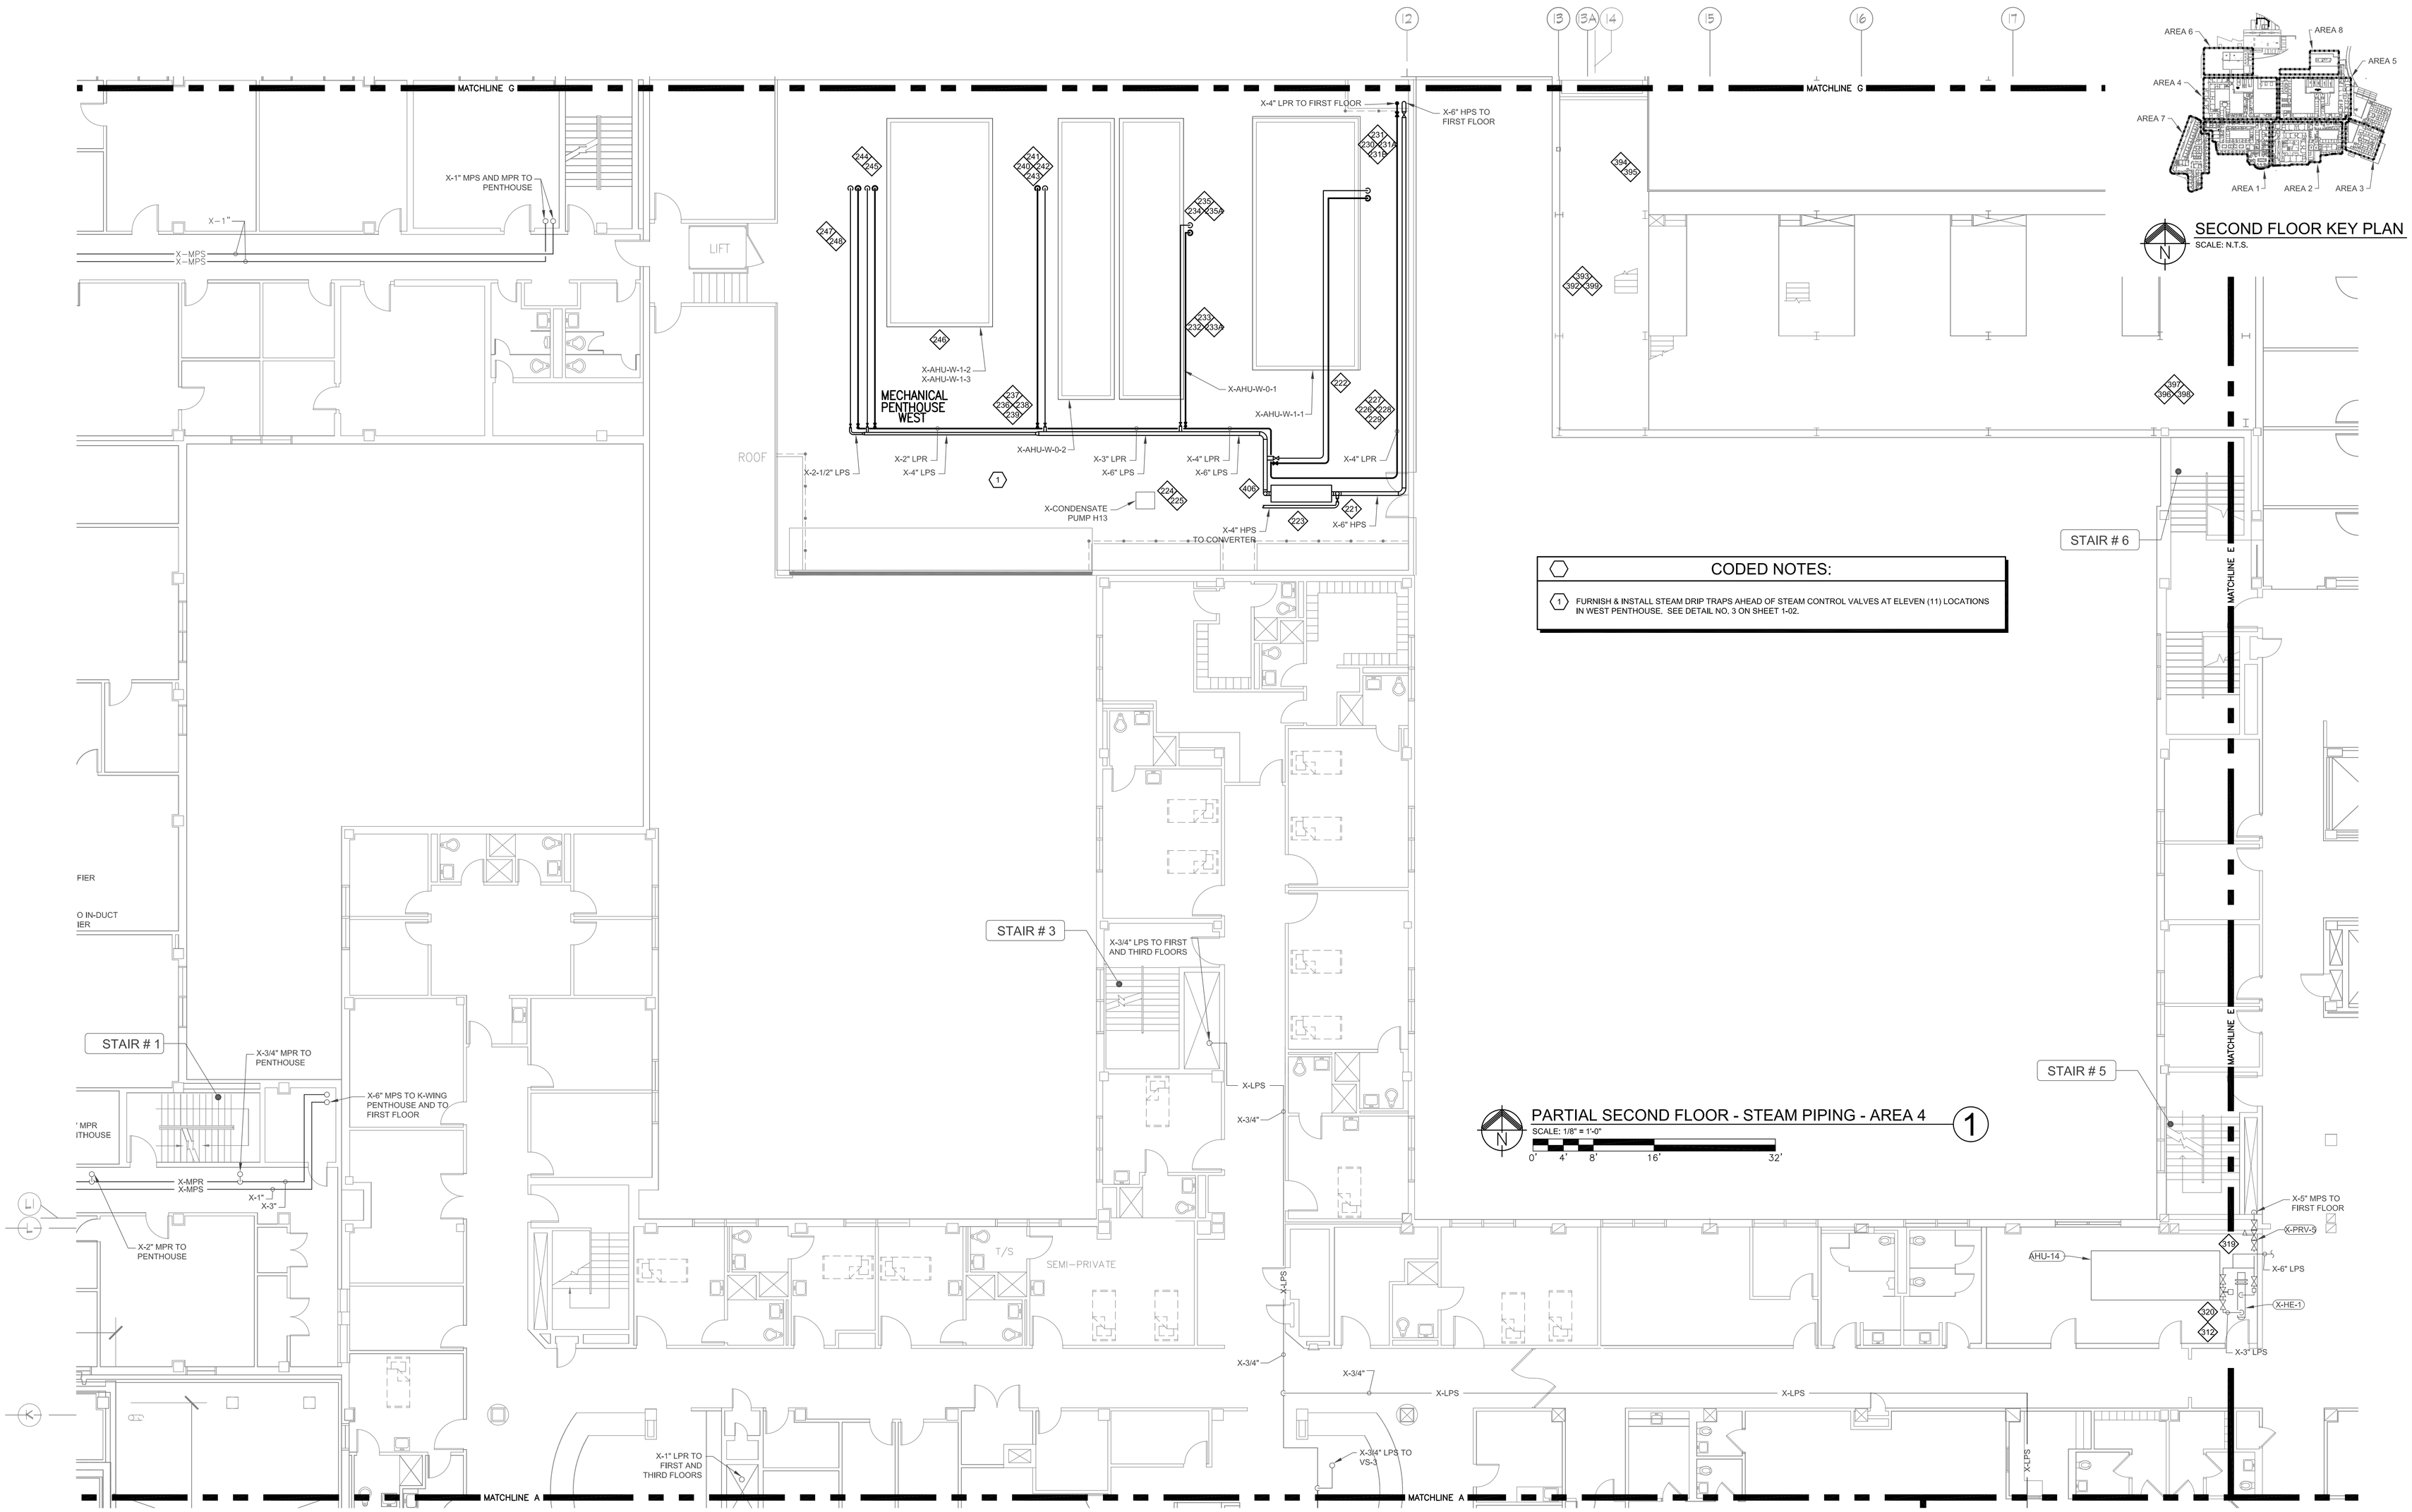

CODED NOTES:

1. FURNISH & INSTALL STEAM DRIP TRAPS AHEAD OF STEAM CONTROL VALVES AT ELEVEN (11) LOCATIONS IN WEST PENTHOUSE. SEE DETAIL NO. 3 ON SHEET 1-02.

Revisions:	Date
ISSUED FOR REBID	05-23-13
FINAL CD-SUBMISSION	12-21-12
95% SUBMISSION	11-30-12
65% SUBMISSION	11-16-12

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — BRIAN M. WIDOWSKI 66625 — REGISTERED PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: SECOND FLOOR PLAN AREA 4

Approved: Project Director

Project Title: **STEAM TRAP MONITORING, INSULATION AND PIPING UPGRADES**

Location: **VAMC - WADE PARK**

Date: 12-21-12 | Checked: WFW | Drawn: JWF

Project Number: 541-12-115

Building Number: 1

Drawing Number: 3-2-4

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978