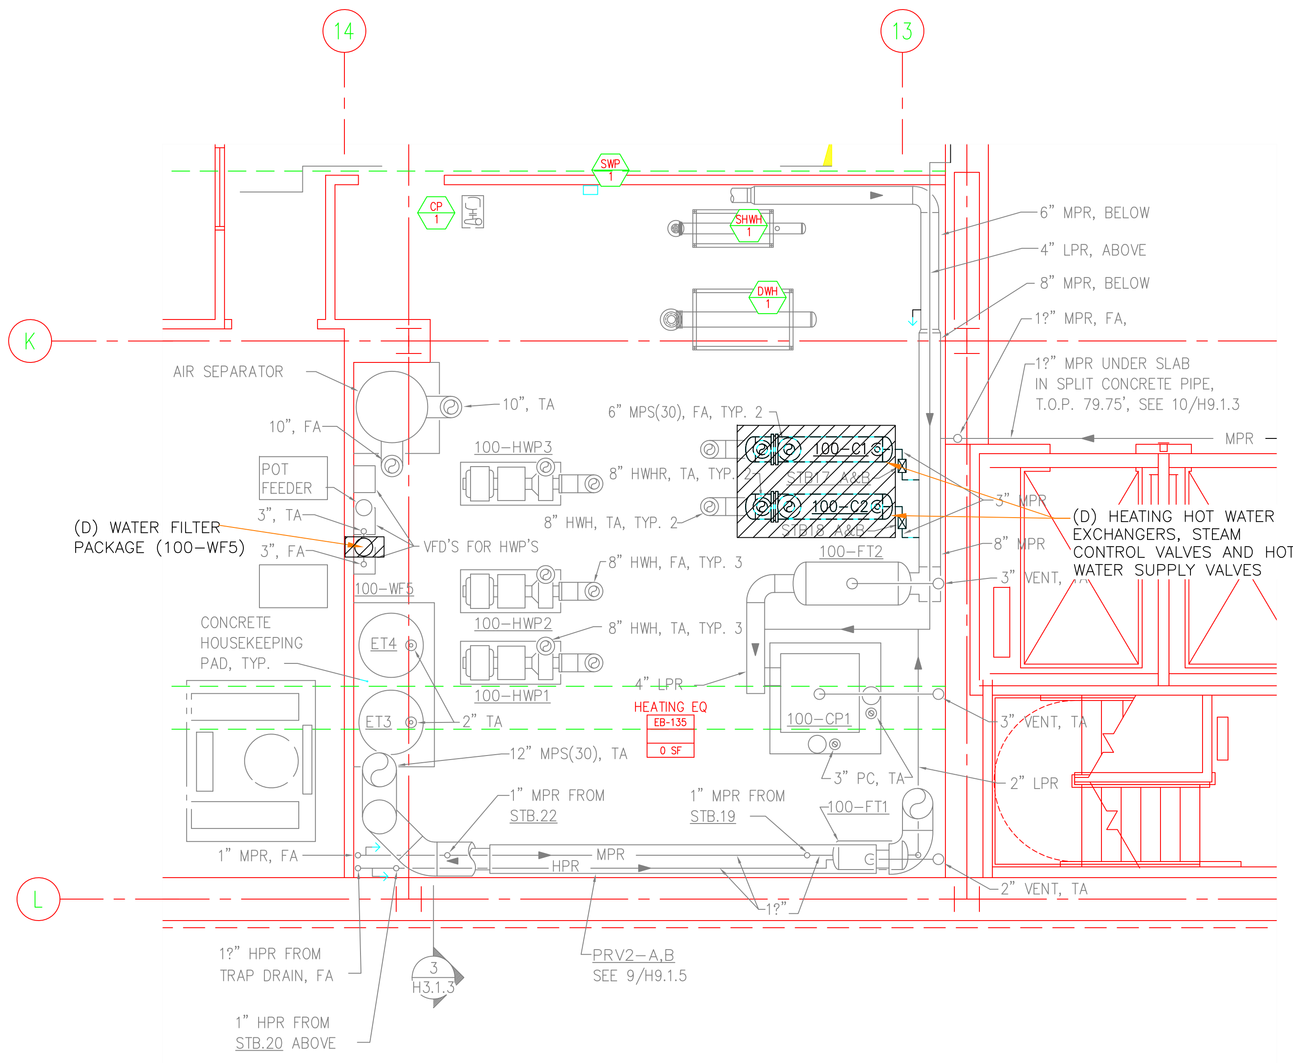

DEMOLITION PLAN

Scale: 1/4"=1'-0"

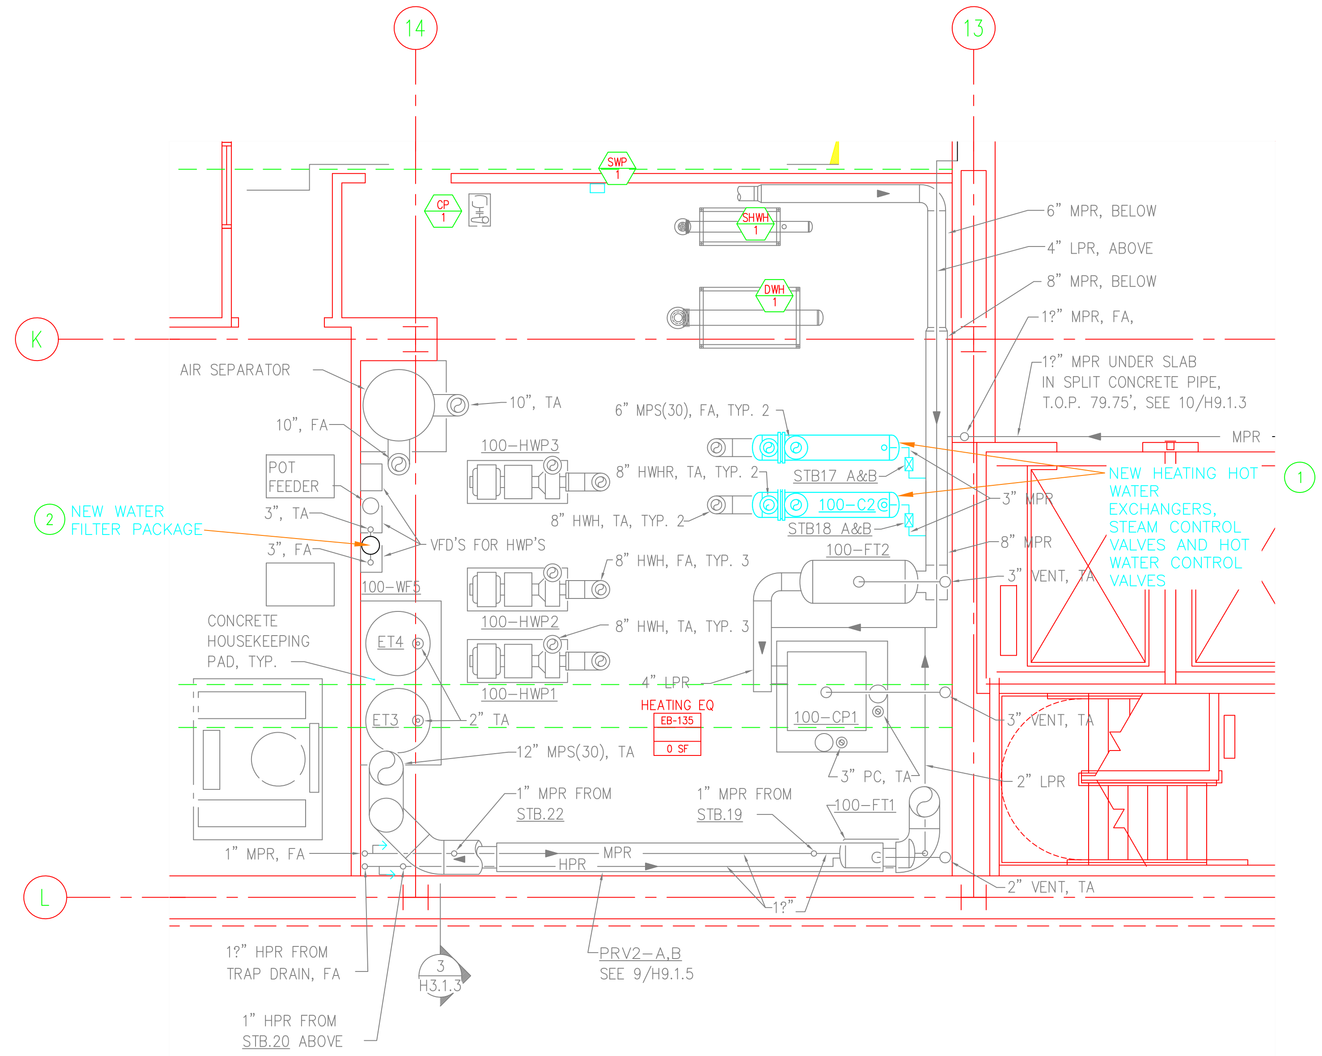

CONSTRUCTION PLAN

Scale: 1/4"=1'-0"

GENERAL NOTE:

1. SEE SPECIFICATIONS FOR DETAIL SCOPE OF WORK.

SHEET NOTES:

1. PROVIDE NEW HEATING HOT WATER HEAT EXCHANGERS OR CONVERTERS, STEAM CONTROL VALVES WITH ELECTRIC ACTUATORS, AND NEW ACTUATORS FOR HEATING HOT WATER CONTROL VALVES PER SPECIFICATION REQUIREMENTS. PROVIDE 24 VDC ELECTRICAL POWER AND 4-20 mA ANALOG INPUT SIGNAL TO EACH NEW ACTUATOR.
2. PROVIDE NEW HEATING HOT WATER FILTER PACKAGE PER SPECIFICATION REQUIREMENTS.



Scale: 1/4"=1'-0"

Revisions	Date
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: DEMOLITION AND CONSTRUCTION PLANS

Project Title: REPLACE HEATING HOT WATER EXCHANGERS IN BUILDING 100

Project Number: 640-13-106P

Building Number: 100

Approved Project Director: LEE
CONTRACTING OFFICER'S TECHNICAL REPRESENTATIVE
VAPAHCS PLANNING AND ENGINEERING

Location: PAD PALO ALTO CA

Date: 2012/11/05 | Checked: JR | Drawn: JPM

Drawing Number: MP-101
Dwg. 2 of 3

Office of Construction and Facilities Management
Department of Veterans Affairs

VA FORM 08-6231

\\Vhpolfsc7\cad_files\CAD_Projects_2012\PAD\640.13-106P.100.PAD.Replace_HW_Exch.0b.000\640.13-106P.100.MP101.PAD.Replace_Hot_Water_Exch.Plumb_Demo_&_Const.eb.135.dwg 12-13-12 01:21:15 PM vhapalleek6