


SOAKER

CHROMATHERAPY


MINUTE DRAIN

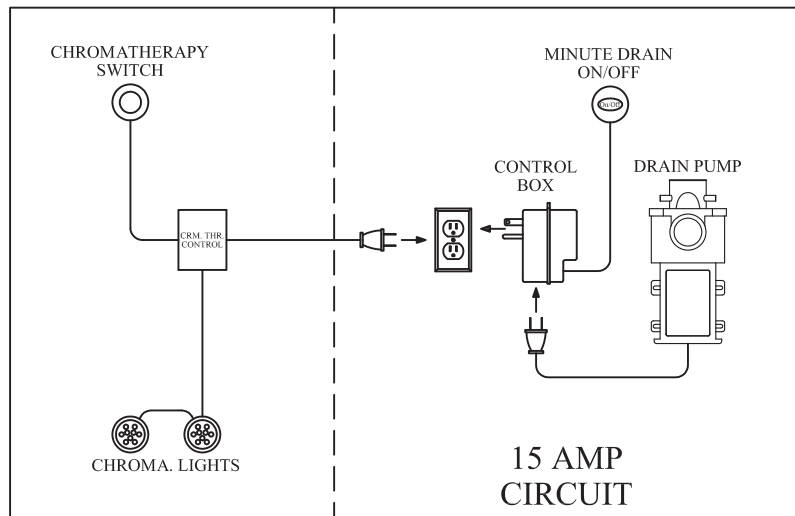

AIR

CHROMATHERAPY

MINUTE DRAIN

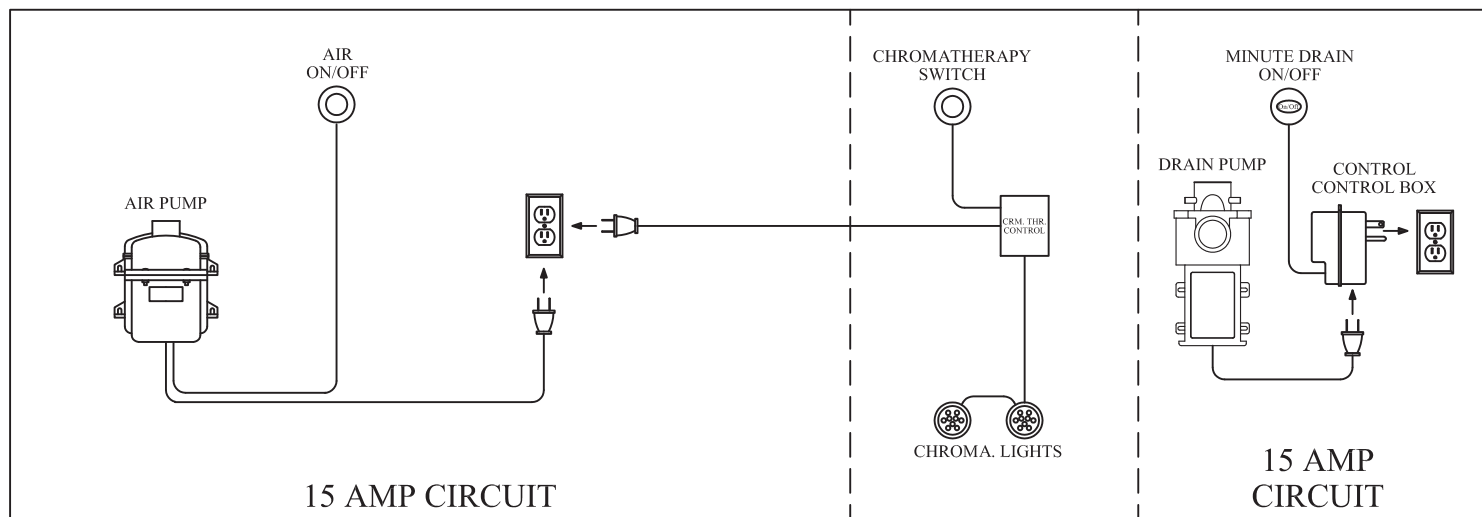

Note: All electrical connections should be made by a licensed electrician. All circuits must be 110 – 120 volts with 12 gauge, three conductor cable from the main electrical panel box and each protected with a Ground Fault Circuit Interrupter (GFCI) of a rating indicated for the application.

©2009 Safety Tubs


US0709

WHIRLPOOL

CHROMATHERAPY

MINUTE DRAIN

INLINE HEATER

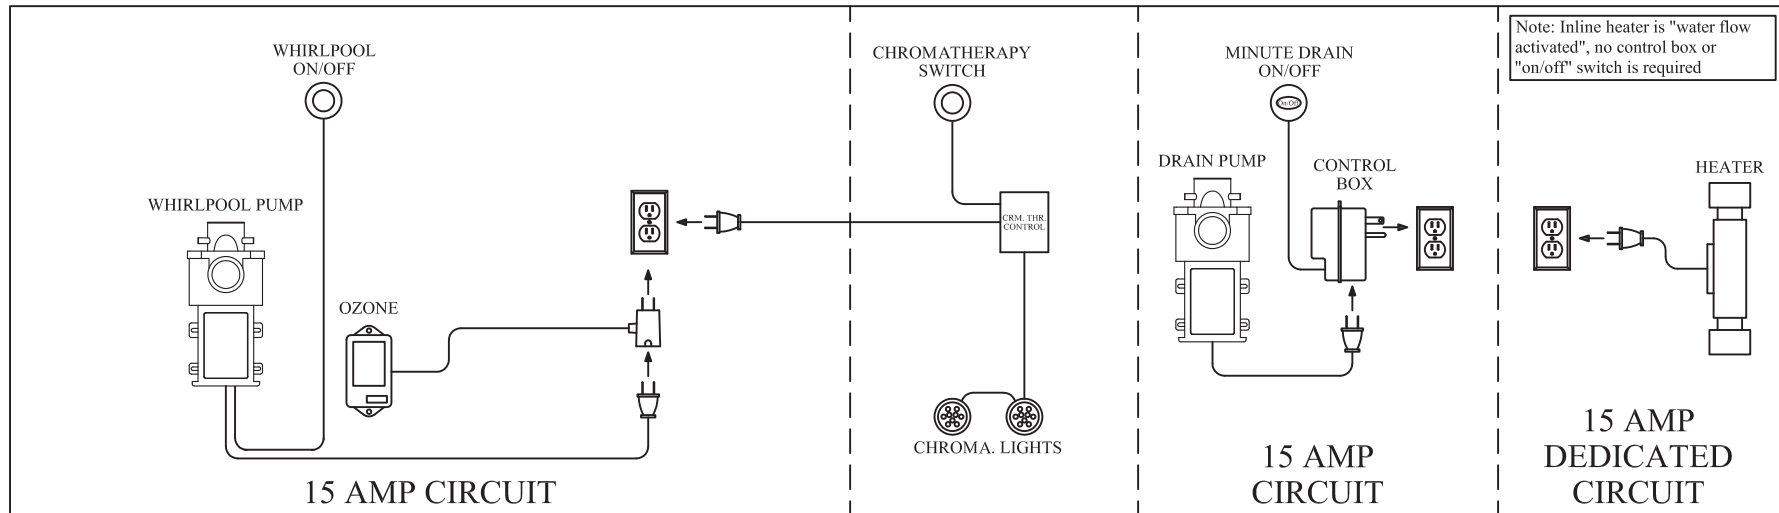


Dual

CHROMATHERAPY

MINUTE DRAIN

INLINE HEATER

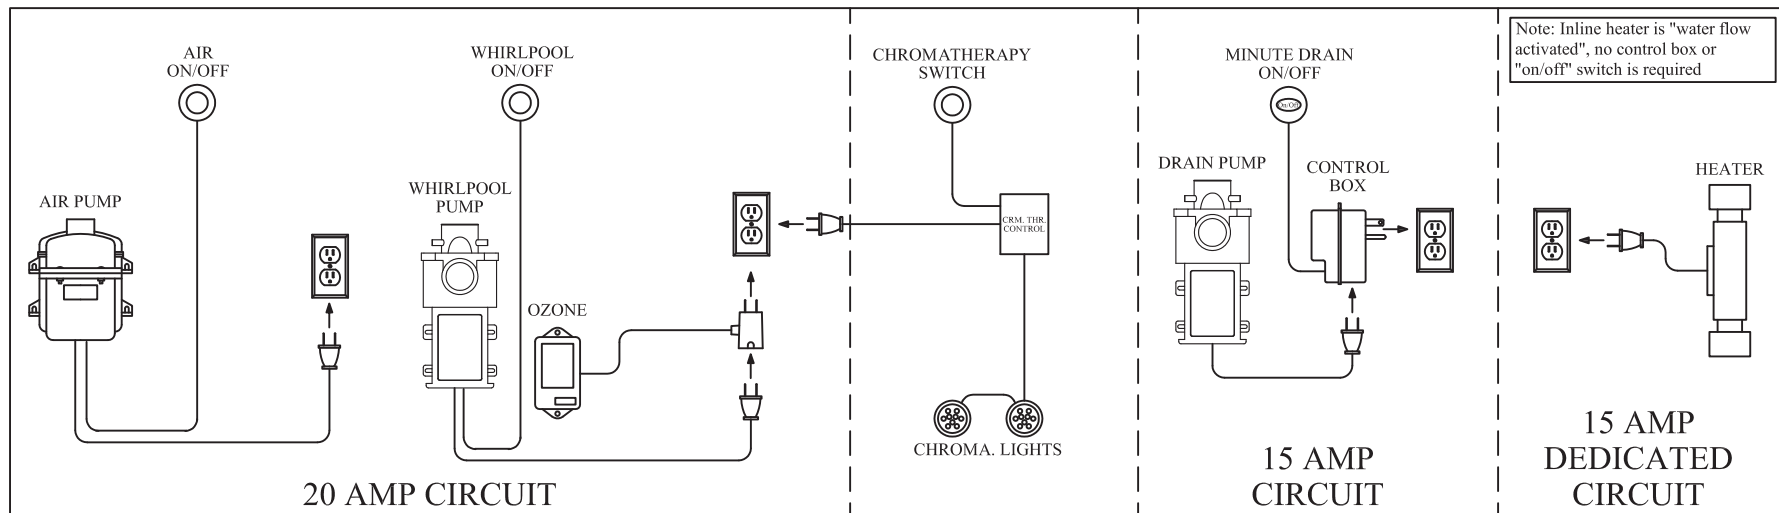

Note: All electrical connections should be made by a licensed electrician. All circuits must be 110 – 120 volts with 12 gauge, three conductor cable from the main electrical panel box and each protected with a Ground Fault Circuit Interrupter (GFCI) of a rating indicated for the application.

©2009 Safety Tubs

US0709