


## SITE PLAN KEY NOTES


- ① UNDERGROUND PVC CONDUIT (QTY AND SIZES AS INDICATED), SCHEDULE 40, RUN UNDERGROUND CONCRETE ENCASED. TYPICAL MINIMUM BURIAL DEPTH 36" BELOW FINISHED GRADE. PROVIDE CONTINUOUS WARNING TAPE OVER ALL BURIED CONDUIT AT 18" BELOW FINISH GRADE. INSTALL 3/8" MARKED PULL TAPE ALONG WITH REQUIRED CABLES.
- ② TURN SCHED 40 PVC CONDUIT UP, SLEEVE AND SEAL FLOOR PENETRATION PER SPECIFICATIONS. TERMINATE CONDUIT AT 12" A.F.F. WITH END BELL. PLUG UNUSED CONDUITS AND SLEEVE AROUND CABLES IN OTHERS.
- ③ CONDUIT SHALL BE STUBBED TO 5' FROM BUILDING ENVELOPE. WORK OUTSIDE 5' PERIMETER PROVIDED BY OTHERS, UNDER SEPARATE CONTRACT.

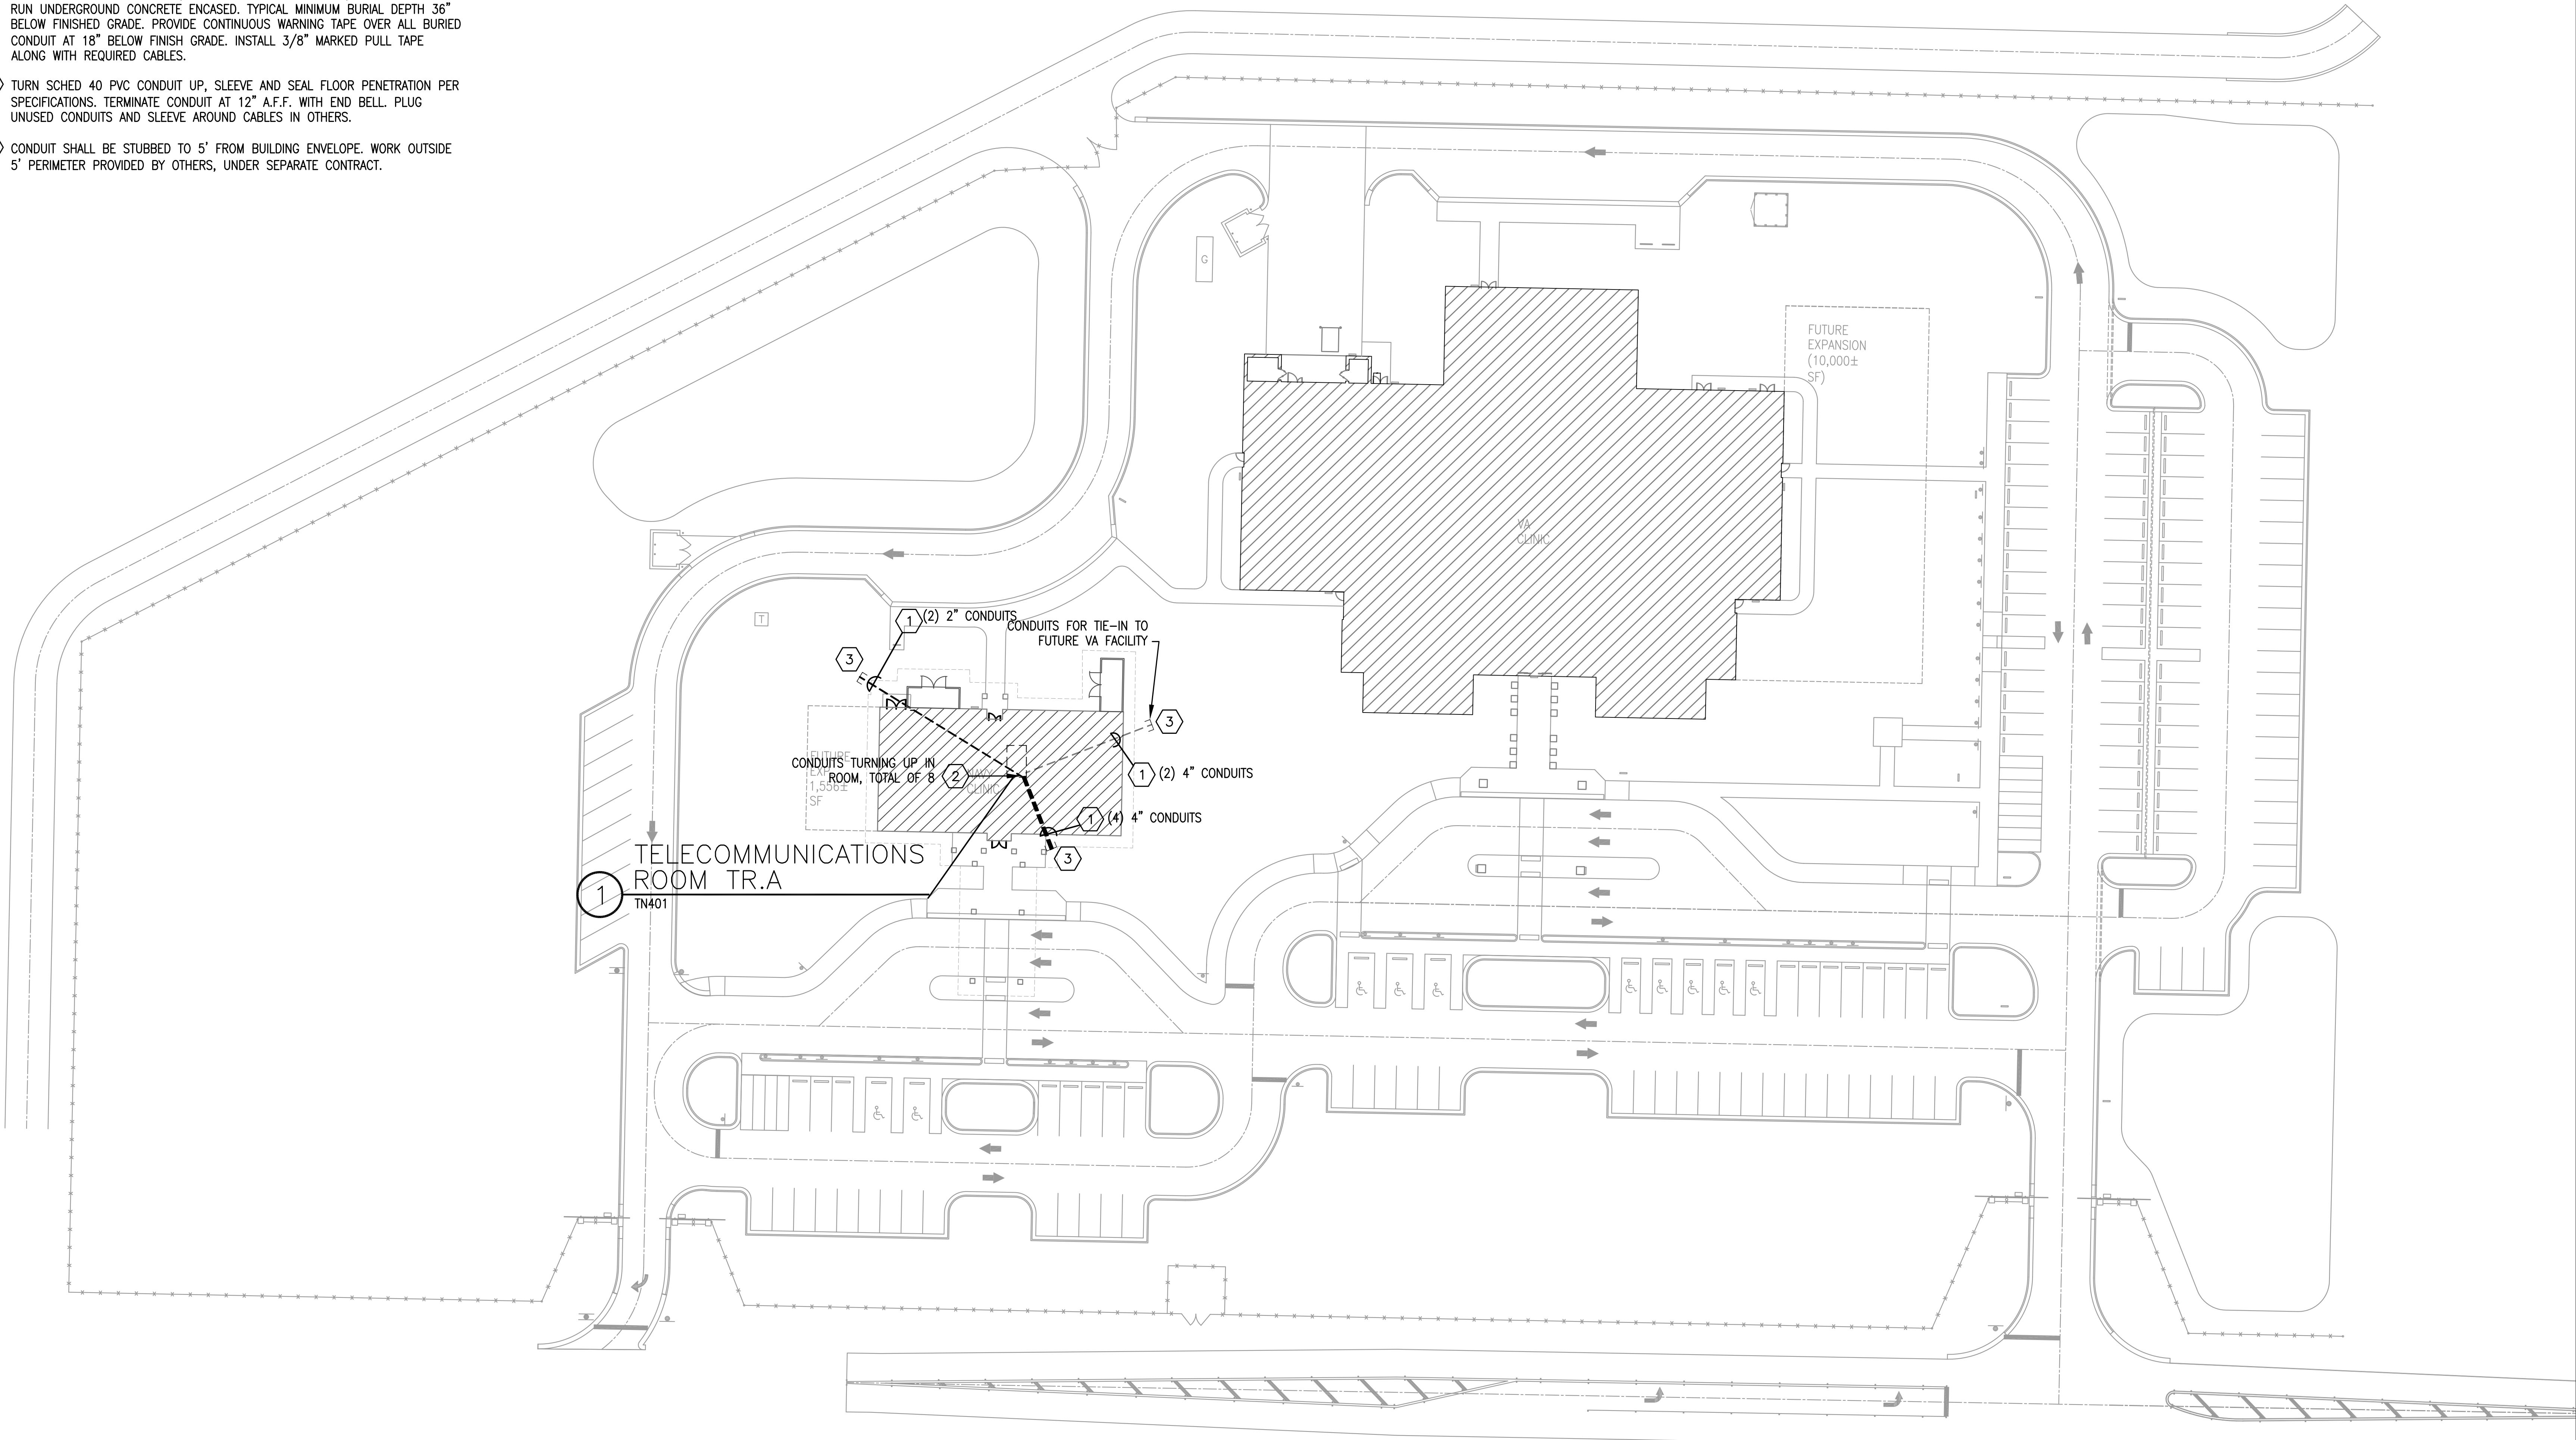

FINAL SUBMISSION  
APRIL 9, 2013


IF SHEET IS LESS THAN (30"x42") IT IS  
A REDUCED PRINT; SCALE ACCORDINGLY

TN101




# TELECOMMUNICATIONS SITE PLAN

TN101

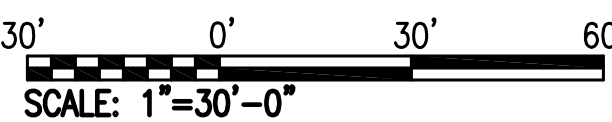

766 MIDDLE ST., FAIRHOPE, AL 36532 251-990-5771  
ARCH. & ENGR. SEAL



NATURAL RESOURCES & ENVIRONMENTAL AFFAIRS		P.W. DWG. NO.		DEPARTMENT OF THE NAVY NAVAL FACILITIES ENGINEERING COMMAND NAVAL SUPPORT ACTIVITY PANAMA CITY, FLORIDA	
SAFETY DEPARTMENT		DRAWN BY		CONSTRUCT NAVAL BRANCH CLINIC, PANAMA CITY TELECOMMUNICATIONS SITE PLAN	
SAFETY DEPARTMENT		CHECKED BY			
FIRE DEPARTMENT		SUPERVISOR			
PUBLIC WORKS SUPERVISOR		APPROVED			
DATE		02/15/2013		NAVFAC DRAWING NO. N/A	
SIZE		F		CODE IDENT. NO.	
HOME PROJ. NO.		520-13-200		CONSTR. CONTR. NO.	
SCALE		AS NOTED		MACC.	
T.O.#		SHEET		2 OF 12	