
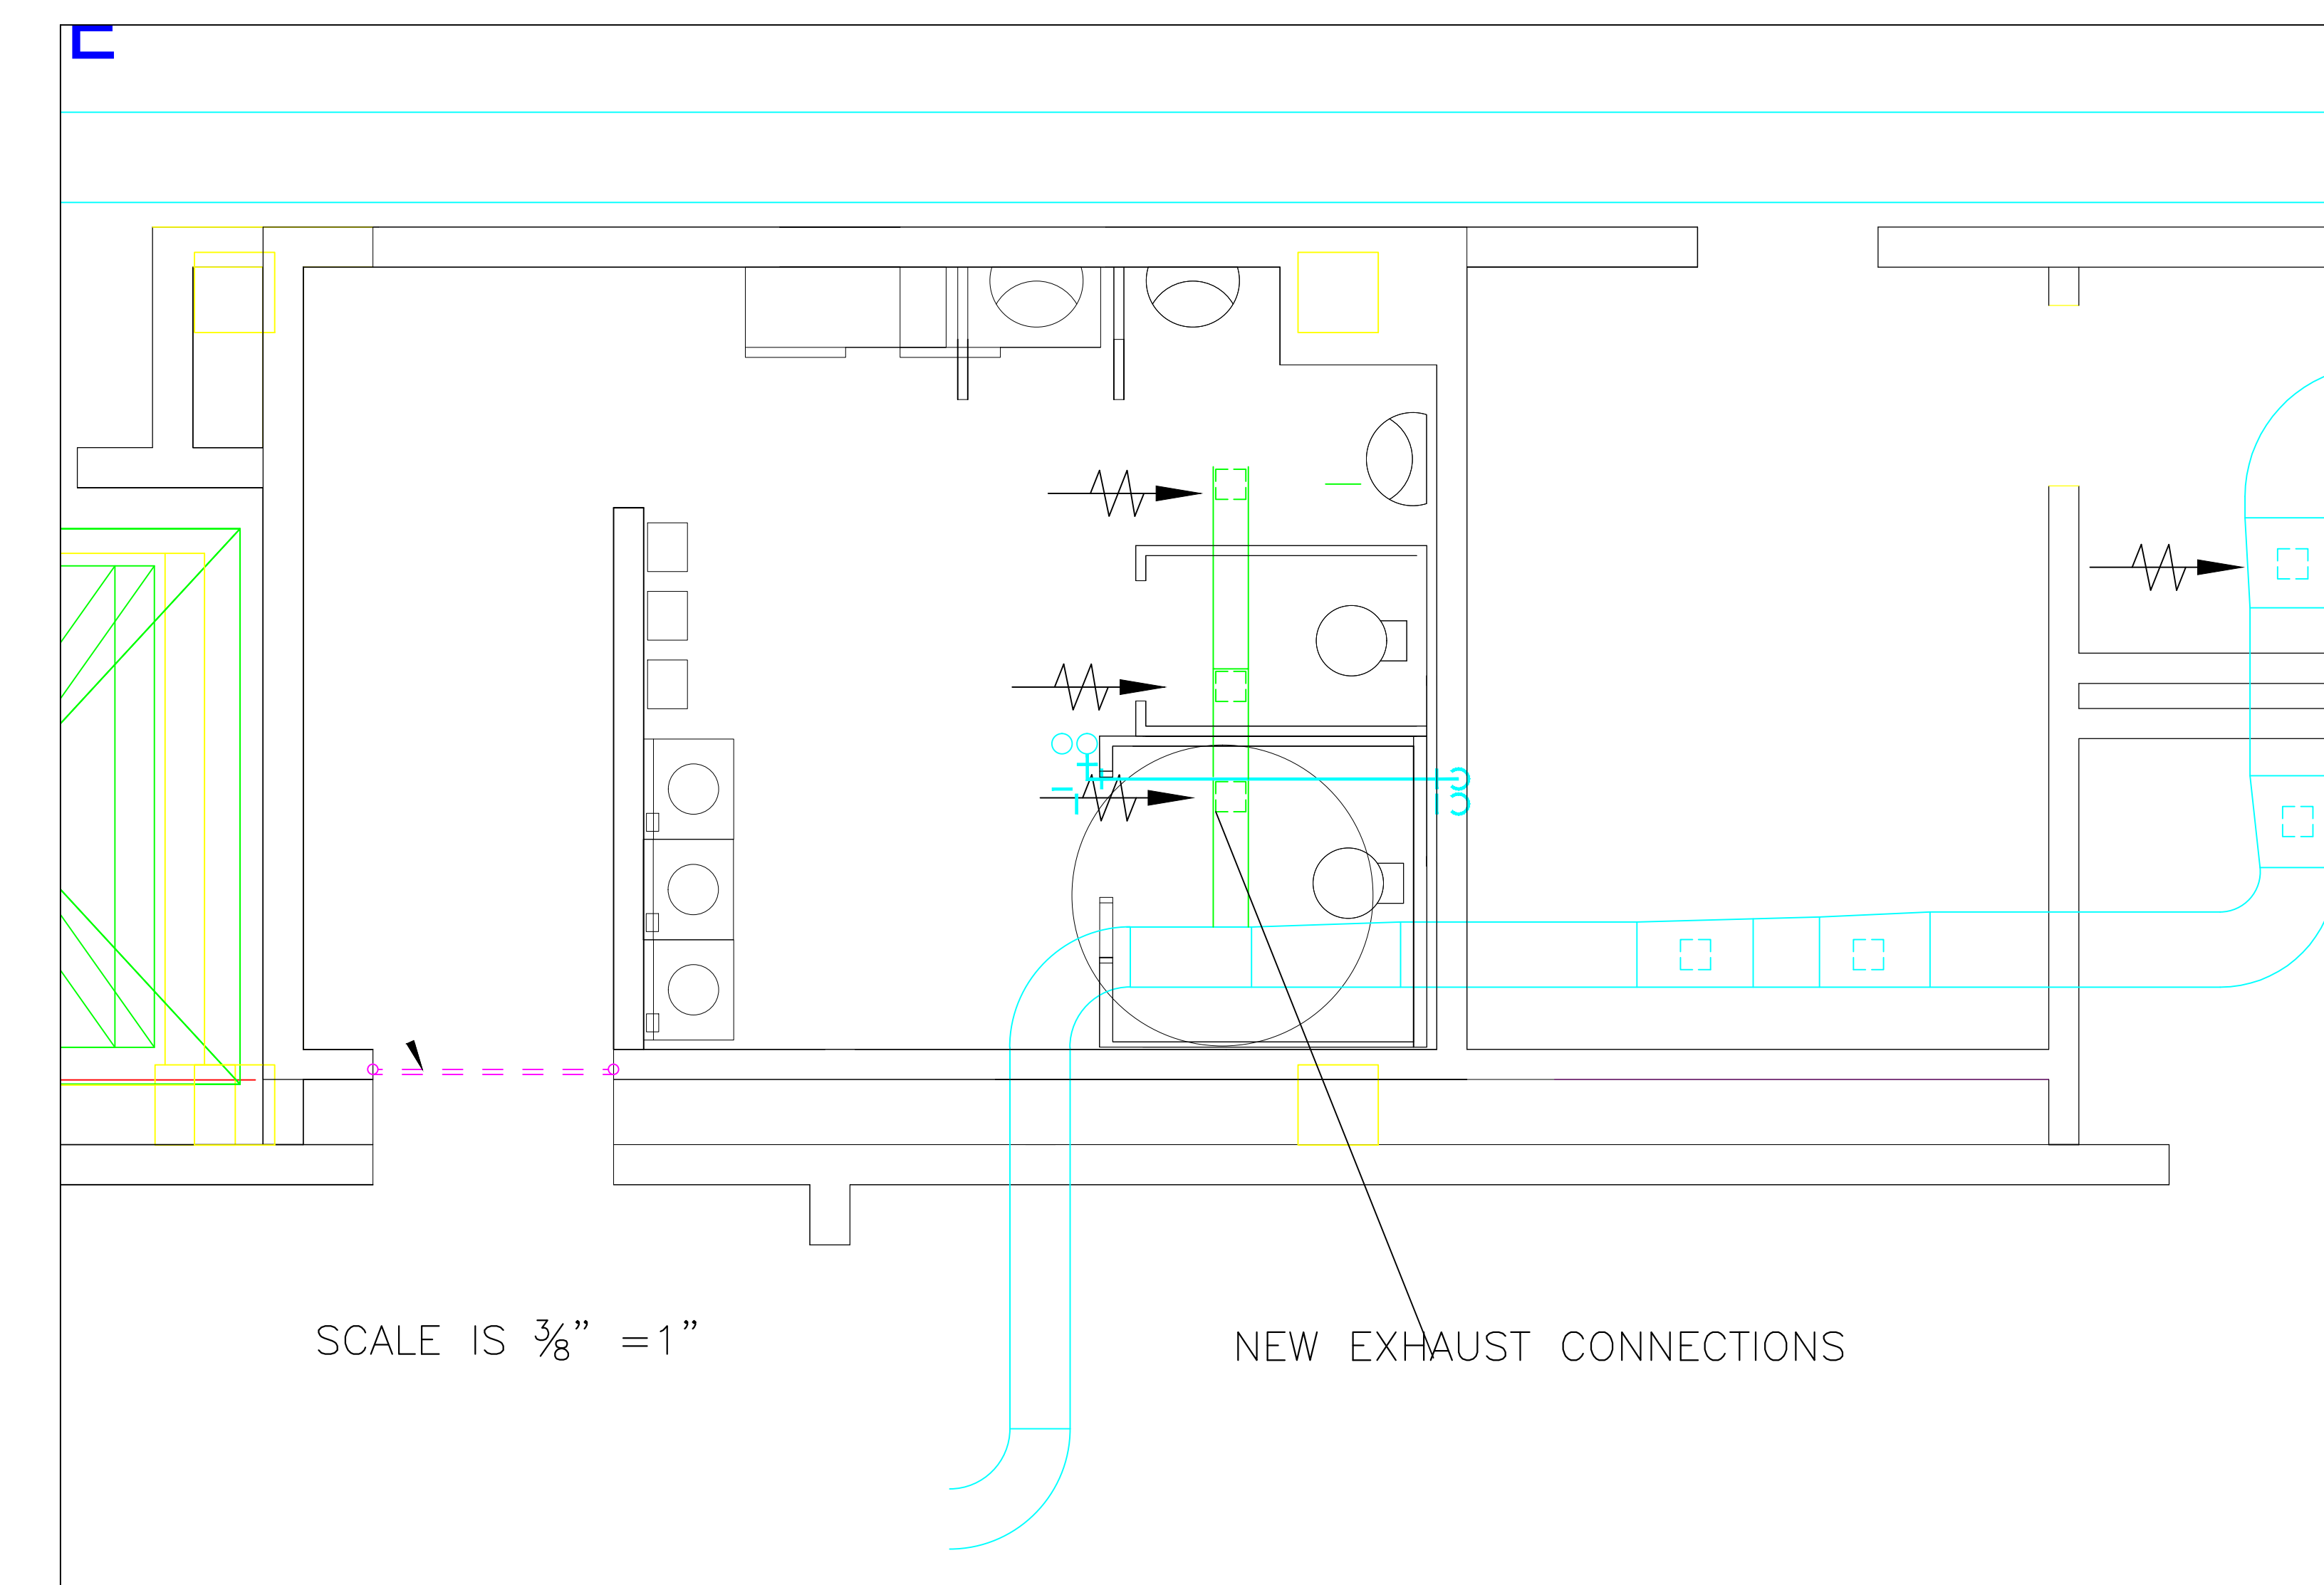
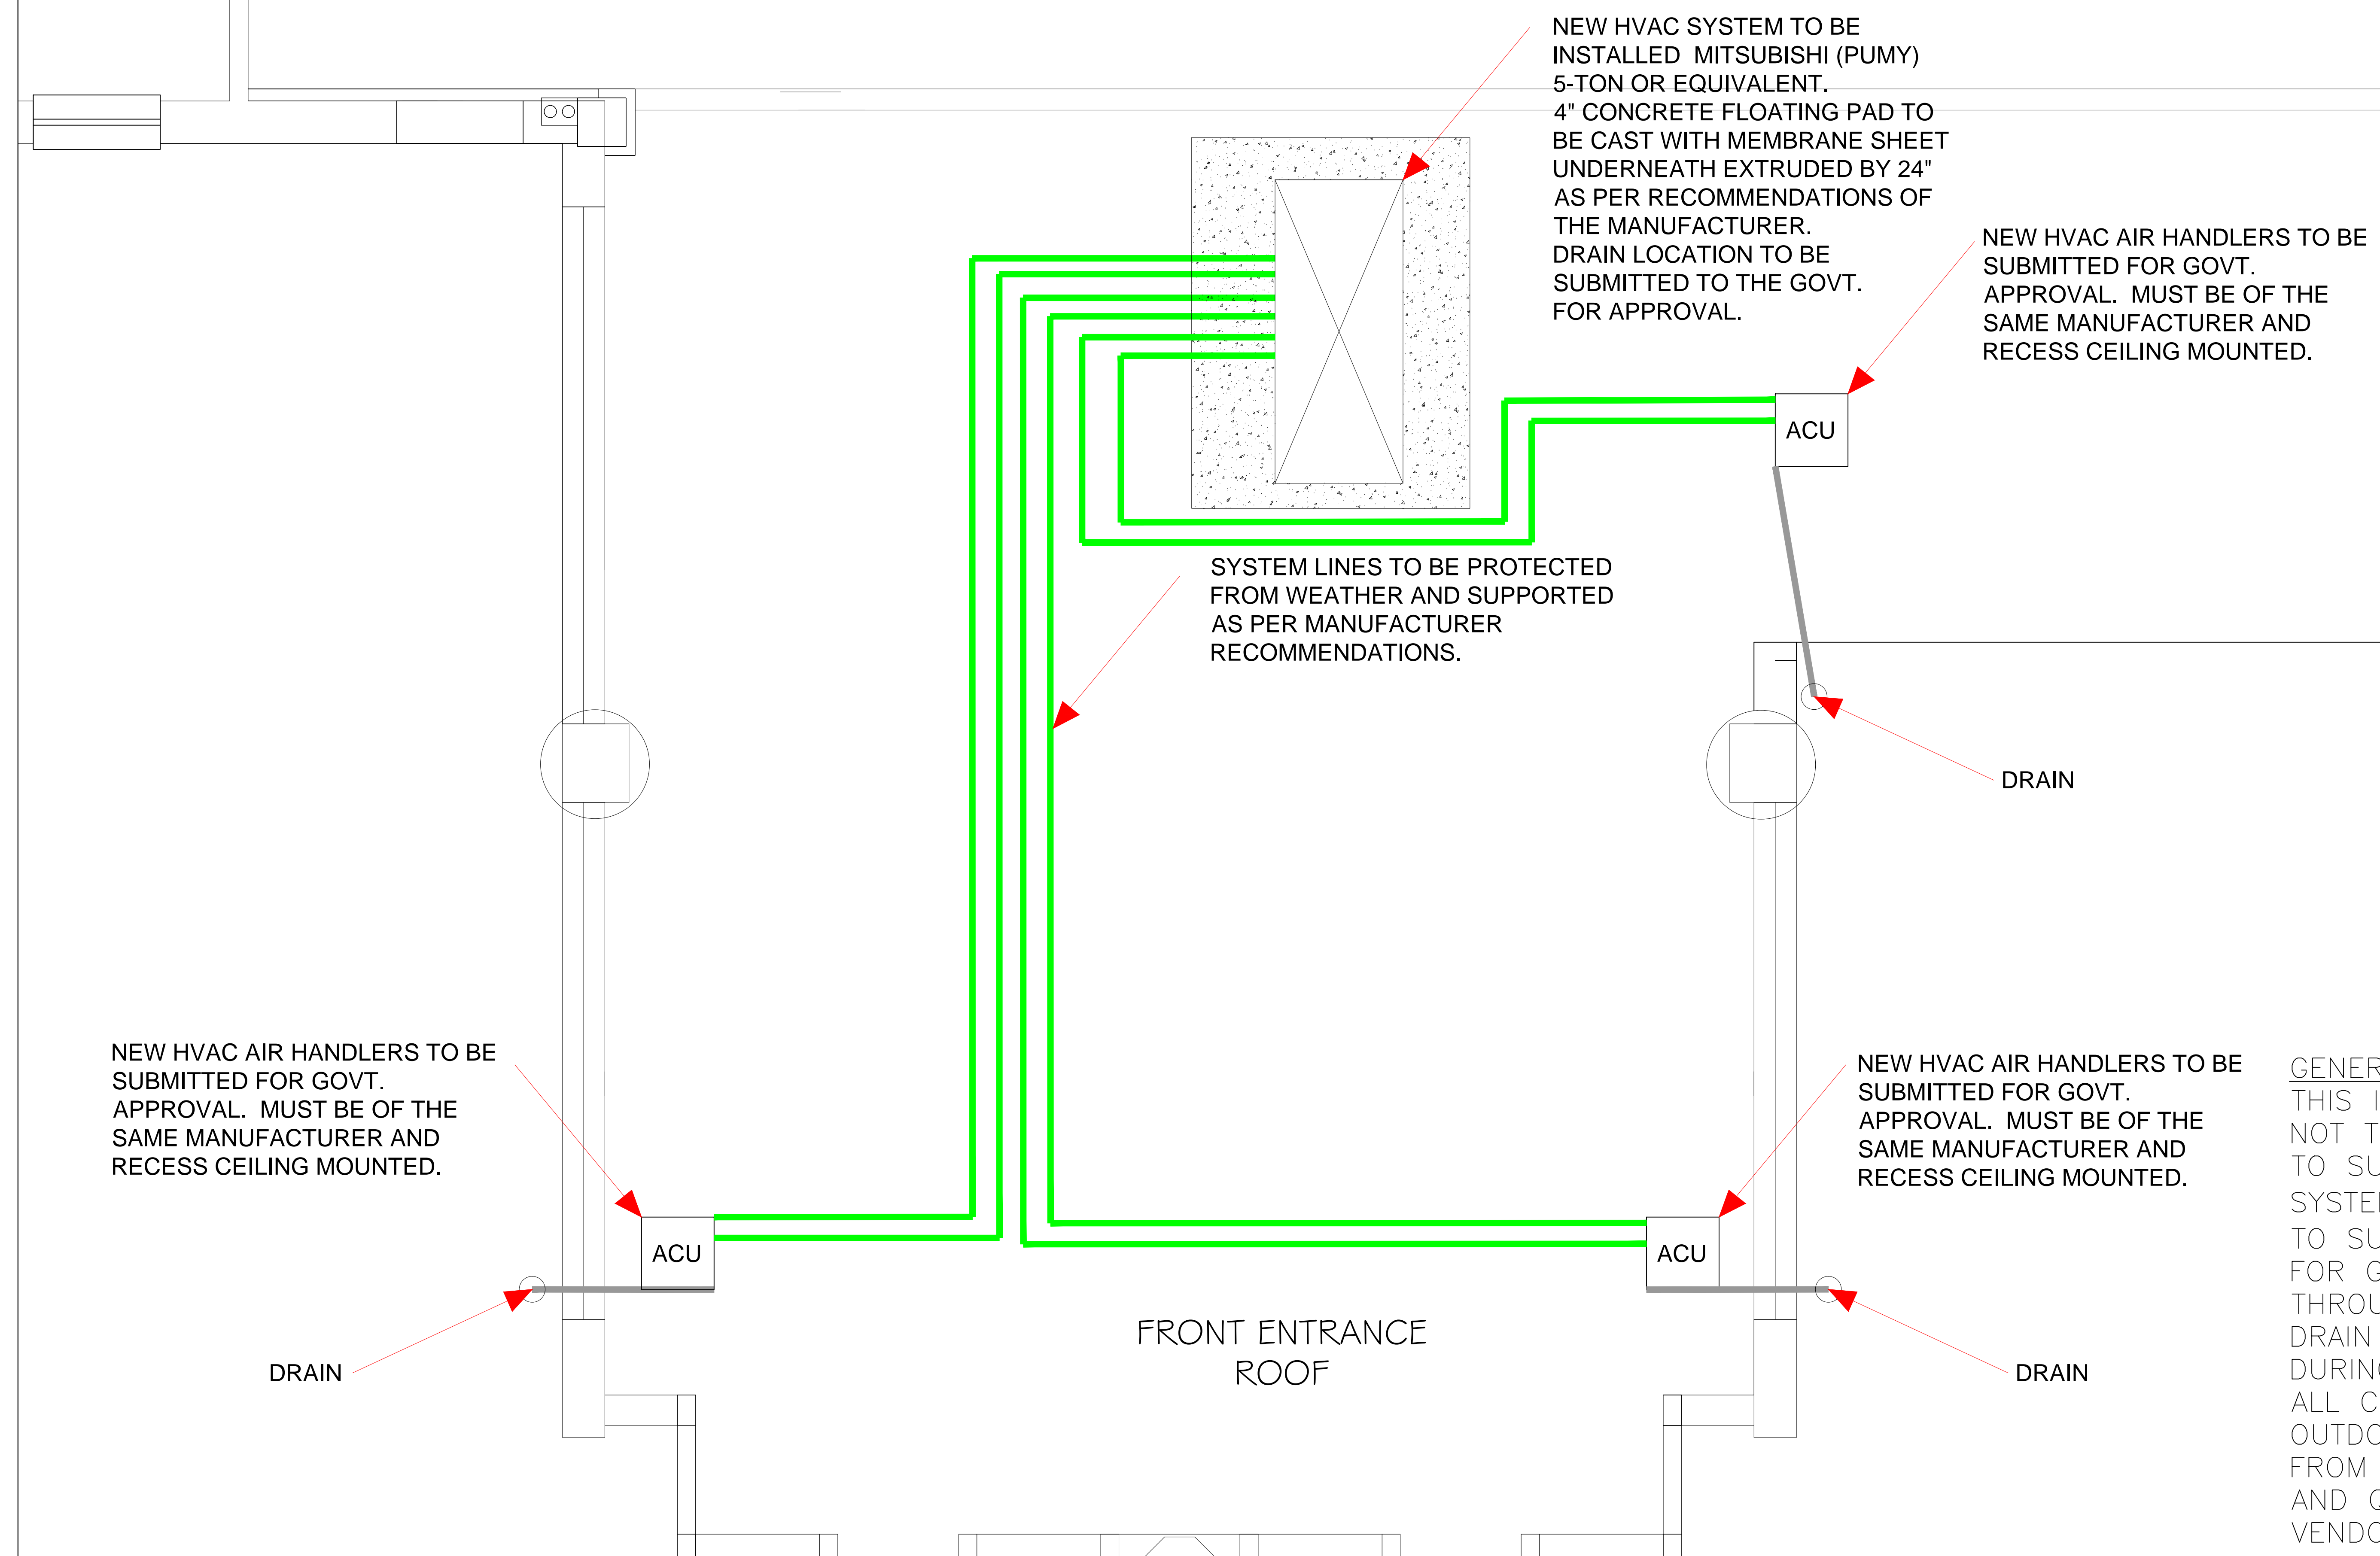
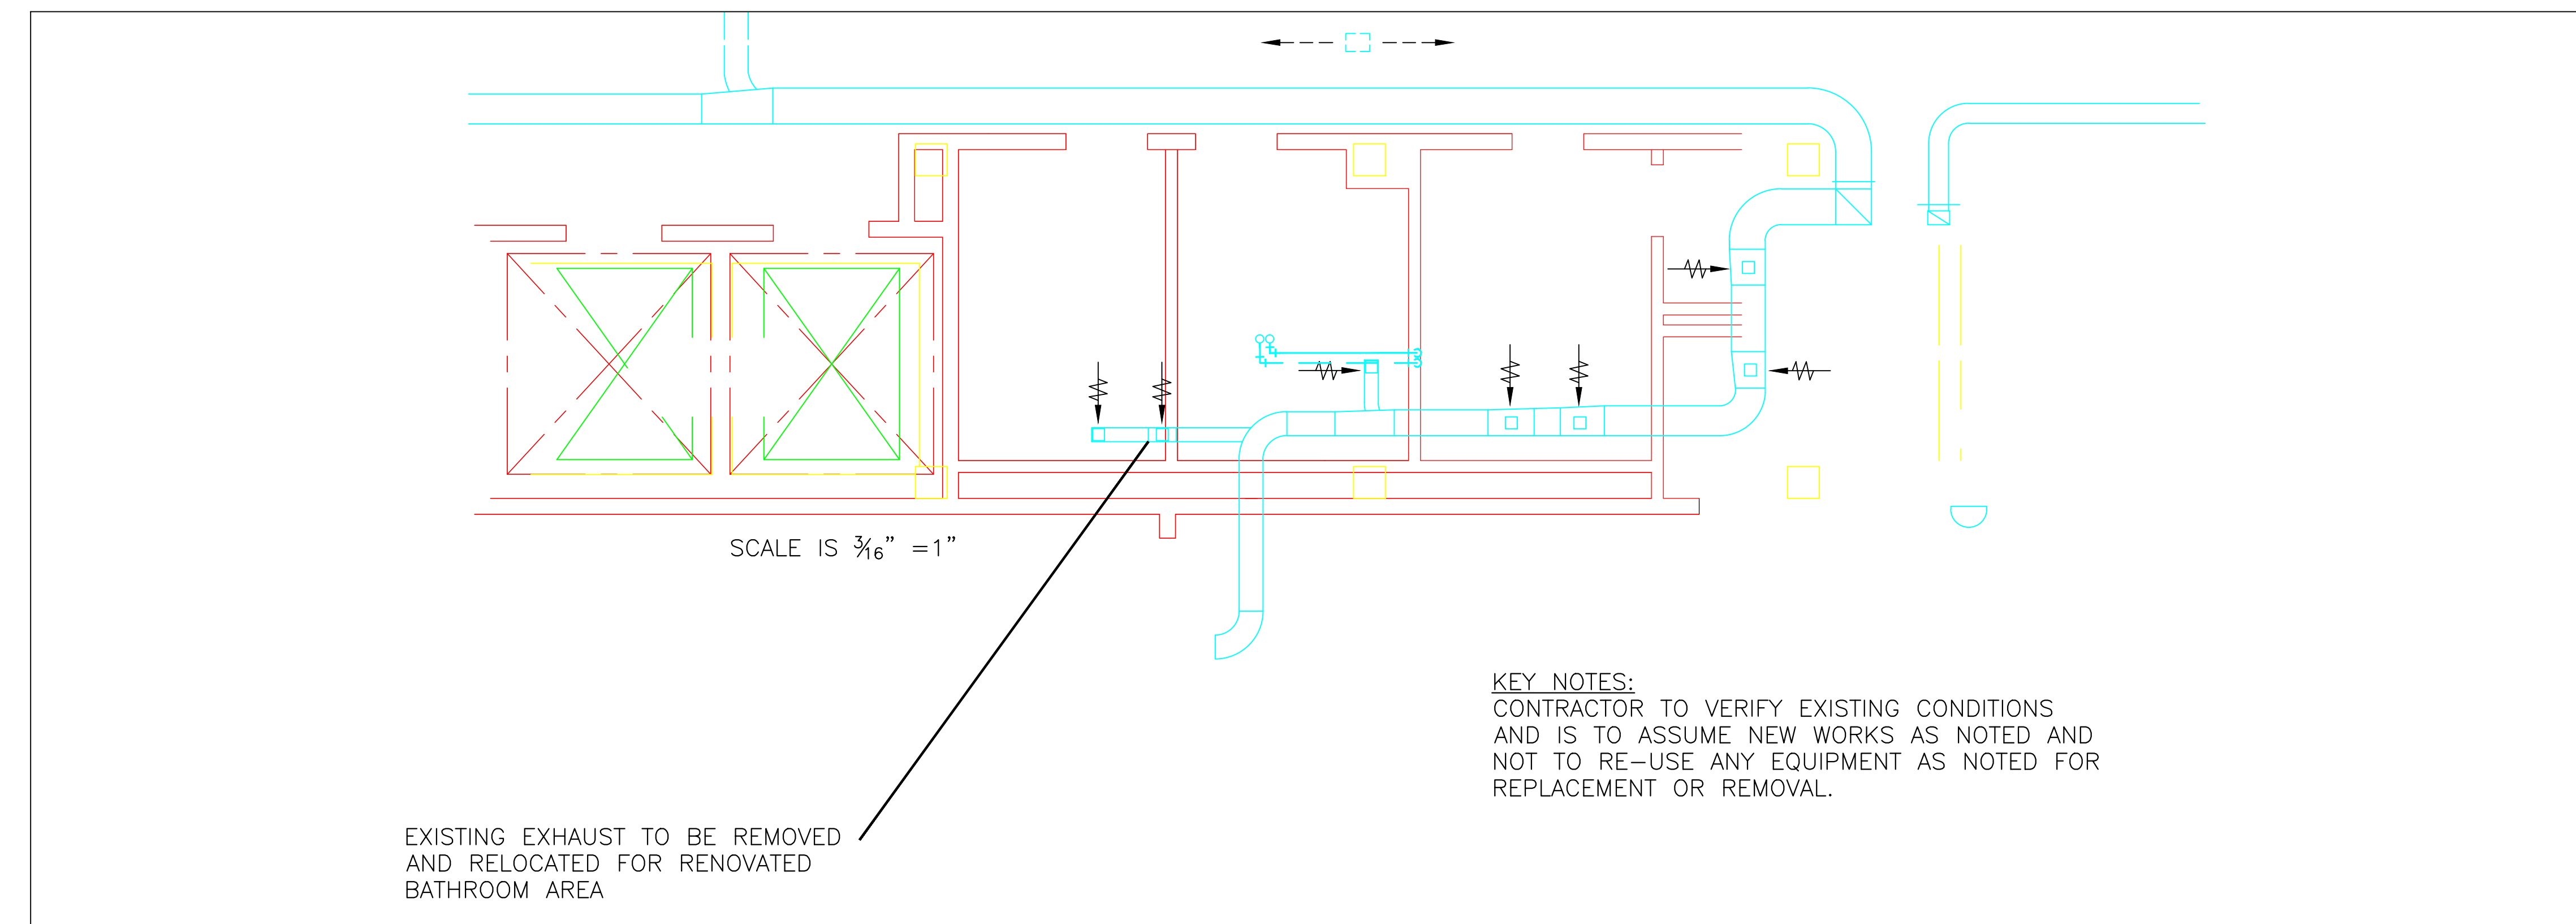


1015
OFFICE
160



GENERAL NOTES:
THIS IS ONLY FOR GENERAL INFORMATION AND IS NOT TO BE USED FOR CONSTRUCTION CONTRACTOR TO SUBMIT FOR GOVT. APPROVAL DIAGRAM OF SYSTEM IN RELATIONSHIP TO ACU'S. CONTRACTOR TO SUBMIT SYSTEM SIMILAR AND/OR EQUIVALENT FOR GOVT. APPROVAL. ALL PENETRATIONS SHALL BE THROUGH WALLS, AND CONDENSATION LINE CAN BE DRAIN TO EXISTING DRAIN SYSTEM. VERIFY LOCATION DURING SITE VISIT.
ALL CONCRETE ELEMENT IN RELATIONSHIP TO OUTDOOR UNITS. REFRIGERANT PIPING SUSPENDED FROM STRUCTURE ABOVE. SET
AND QUANTITY TO BE PROVIDED BY EQUIPMENT VENDOR AS PER MANUFACTURER RECOMMENDATIONS.

SCALE IS $\frac{3}{8}" = 1"$

REVISION: CLARIFICATION IN SCOPE	01 JULY 2013					RECOMMEND APPROVAL				Drawing Title HVAC ROOF WORKS		Project Title B2-ENTRANCE RENOVATION		Date 10 MAY 2013			Department of Veterans Affairs
		REQUESTER		Date							Project No. 659-13-115						
		CHIEF OF SERVICE		Date	CHIEF OF STAFF		Date										
		ASSOC. DIR. PATIENT CARE SVC.		Date	ASSOC. DIR. for OPERATIONS		Date		Approved: Safety Manager/M&O Supervisor		Building Number BUILDING # 2	Checked	Drawn BLR	DRAWING NO. M-102			
Revision	Date	APPROVAL BY:						Date		Approved: Chief of Facilities Management Svr.		Location	W.G.(Bill) Hefner Medical Center 1601 Brenner Ave. Salsbury NC 28144				
		MEDICAL CENTER DIRECTOR															