



- A. REVIEW EACH SYSTEM WITH VA BEFORE REMOVING. TEST FOR PROPER OPERATION OF ALL COMPONENTS AND REPORT ANY MALFUNCTIONING COMPONENTS BEFORE REMOVALS. CONTRACTOR IS RESPONSIBLE FOR SYSTEMS BEING RESTORED TO PRECONSTRUCTION CONDITION AT COMPLETION OF PROJECT.
- B. REMOVE ALL CEILING MOUNTED SPEAKERS, SMOKE DETECTORS, OCCUPANCY SENSORS AND MOTION DETECTORS. SPEAKERS AND SMOKE DETECTORS MAY BE REUSED IF FULLY FUNCTIONAL, UNDAMAGED AND CLEAN.
- C. LIGHT REMOVALS SHALL INCLUDE POWER AND SWITCHING CIRCUIT REMOVAL BACK TO SOURCE. RESTORE POWER AND SWITCHING TO REMAINING FIXTURES AND SWITCHES.
- D. TEMPORARILY SUPPORT FIXTURES AND CEILING MOUNTED DEVICES IN AREAS WITH PARTIAL OR TEMPORARY CEILING REMOVALS. REINSTALL AND CLEAN AFTER WORK IS COMPLETE.
- E. DETAIL SCHEDULE ALL WORK AREAS FOR SHUT DOWNS AND RELOCATIONS MINIMUM TWO WEEKS IN ADVANCE. SEE ARCHITECTURAL PHASING PLAN AND PROVIDE CPM SCHEDULE TO COORDINATE WITH PHASING.
- F. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR CUTTING AND FINISH PATCHING FOR ELECTRICAL, COMMUNICATION AND FIRE ALARM WORK OUTSIDE OF MAIN PROJECT DEMOLITION AREA. SEE ARCHITECTURAL DRAWINGS FOR EXTENT OF DEMOLITION AND PATCHING BY GENERAL CONTRACTOR.


- ① REMOVE ROOM LIGHTING, SWITCHING, OCCUPANCY SENSORS AND POWER BACK TO COMMON POINT OF CONNECTION. LEAVE EXISTING LIGHTING CIRCUIT FOR RECONNECTION TO NEW FIXTURES.
- ② REMOVE TRACK LIGHT AND SWITCHING USED FOR ID BADGE STATION. SAVE FOR REINSTALLATION AT NEW BADGE STATION LOCATION.
- ③ REMOVE ROOM LIGHTING OR INDICATED FIXTURES, SWITCHING, OCCUPANCY SENSORS AND POWER BACK TO SOURCE. EXISTING LIGHTING CIRCUITS ARE NOT REUSED FOR RENOVATED ROOMS.
- ④ REMOVE PA SPEAKER AND REPLACE WITH NEW SPEAKER IN NEW AREA. VERIFY SPEAKER IS FUNCTIONING BEFORE REMOVAL.
- ⑤ REMOVE TWO LIGHT FIXTURES FOR NEW CABLE TRAY CLEARANCE. RECONNECT EXISTING FIXTURES TO REMAIN.
- ⑥ TEMPORARILY RECIRCUIT LIGHTING TO EMERGENCY POWER FROM PANEL E1C-C AND INSTALL SWITCH FOR TEMPORARY DISPATCH ROOM. SEE ARCHITECTURAL PHASING PLAN.
- ⑦ EXISTING OFFICE 108 AND 108A TO BE USED AS TEMPORARY OPERATOR'S ROOM. TEMPORARILY CIRCUIT ROOM LIGHTS TO PANEL E1C-C DURING USE BY OPERATORS.

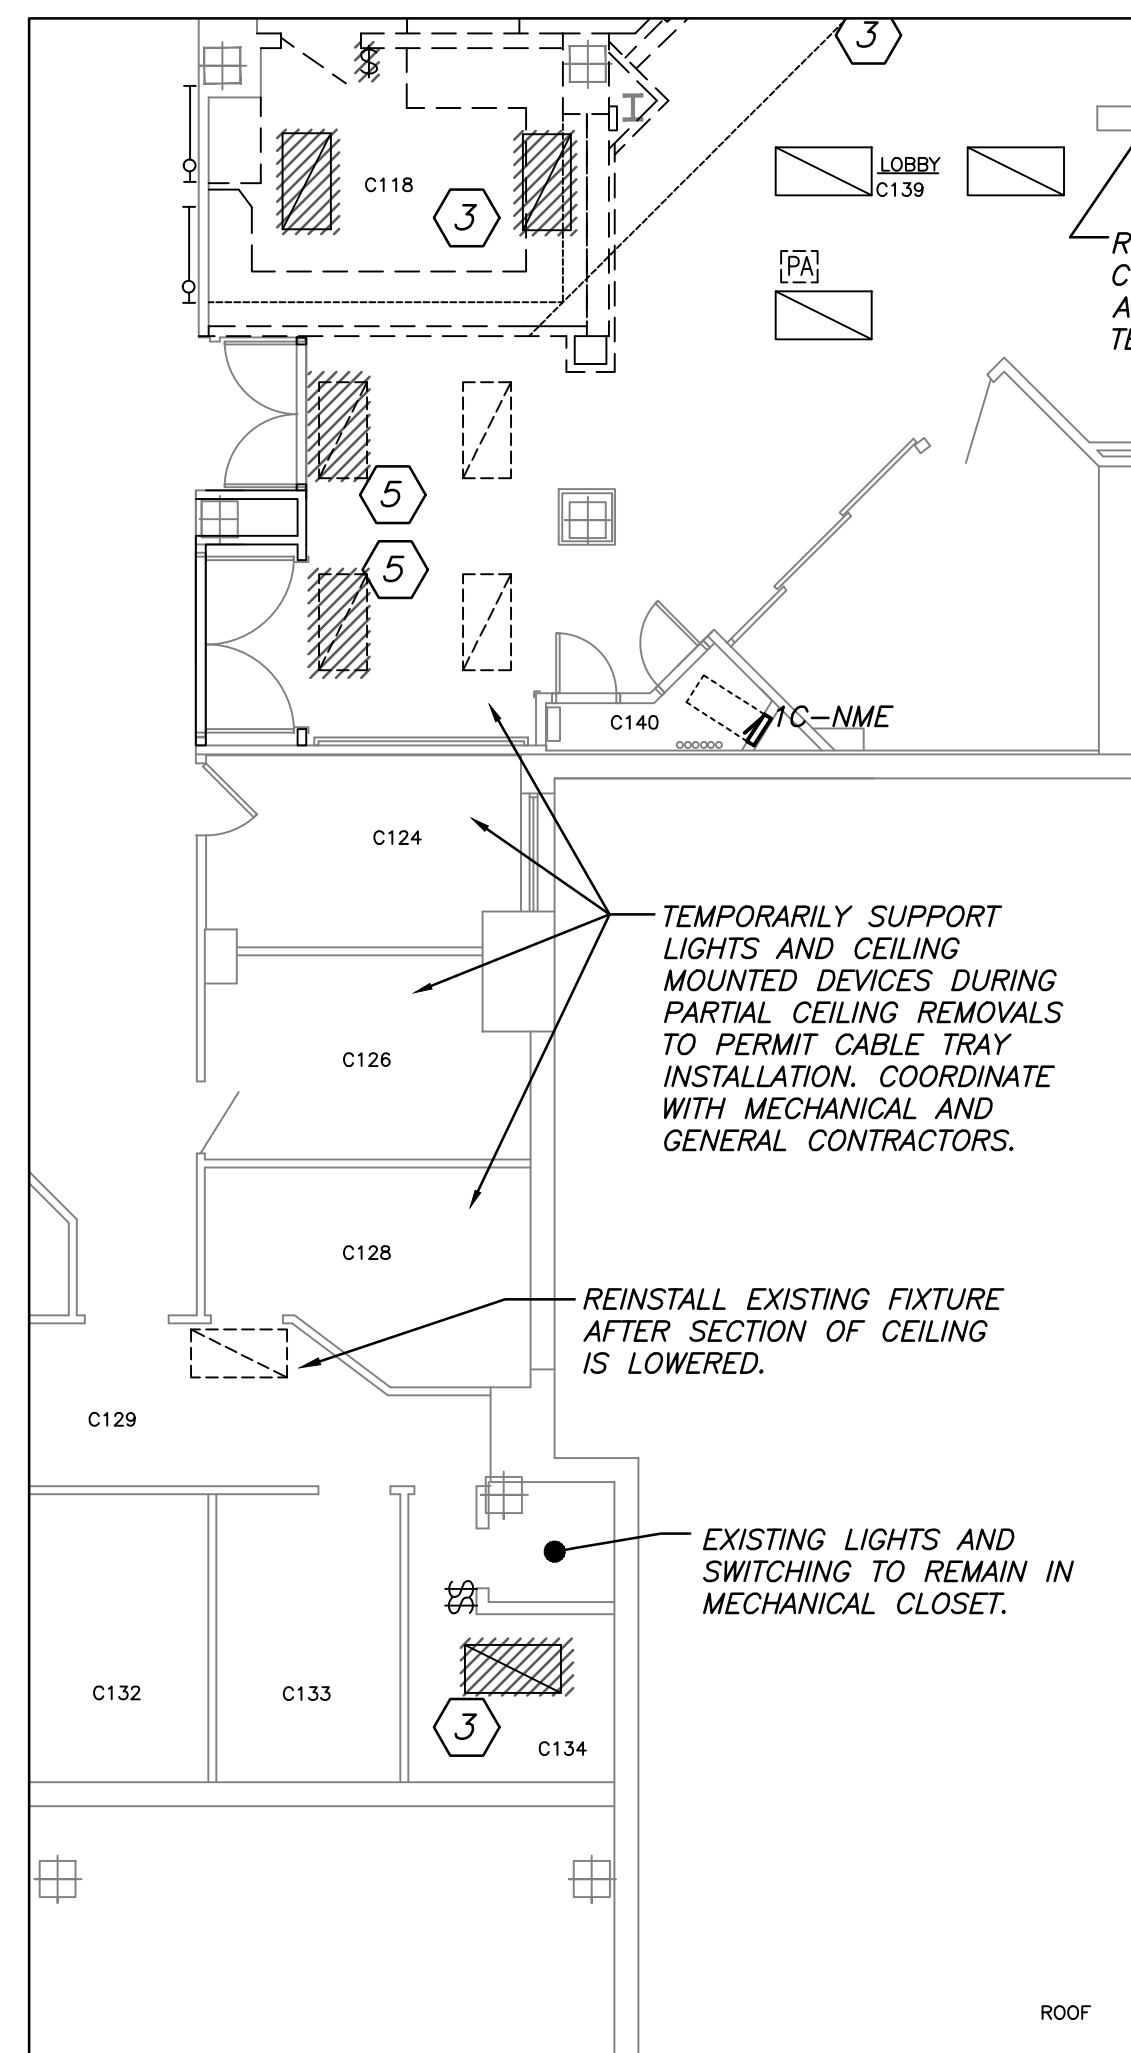


**2 ELECTRICAL LIGHTING DEMOLITION PART PLAN**  
**DE1** SCALE: 1/8" = 1'-0"

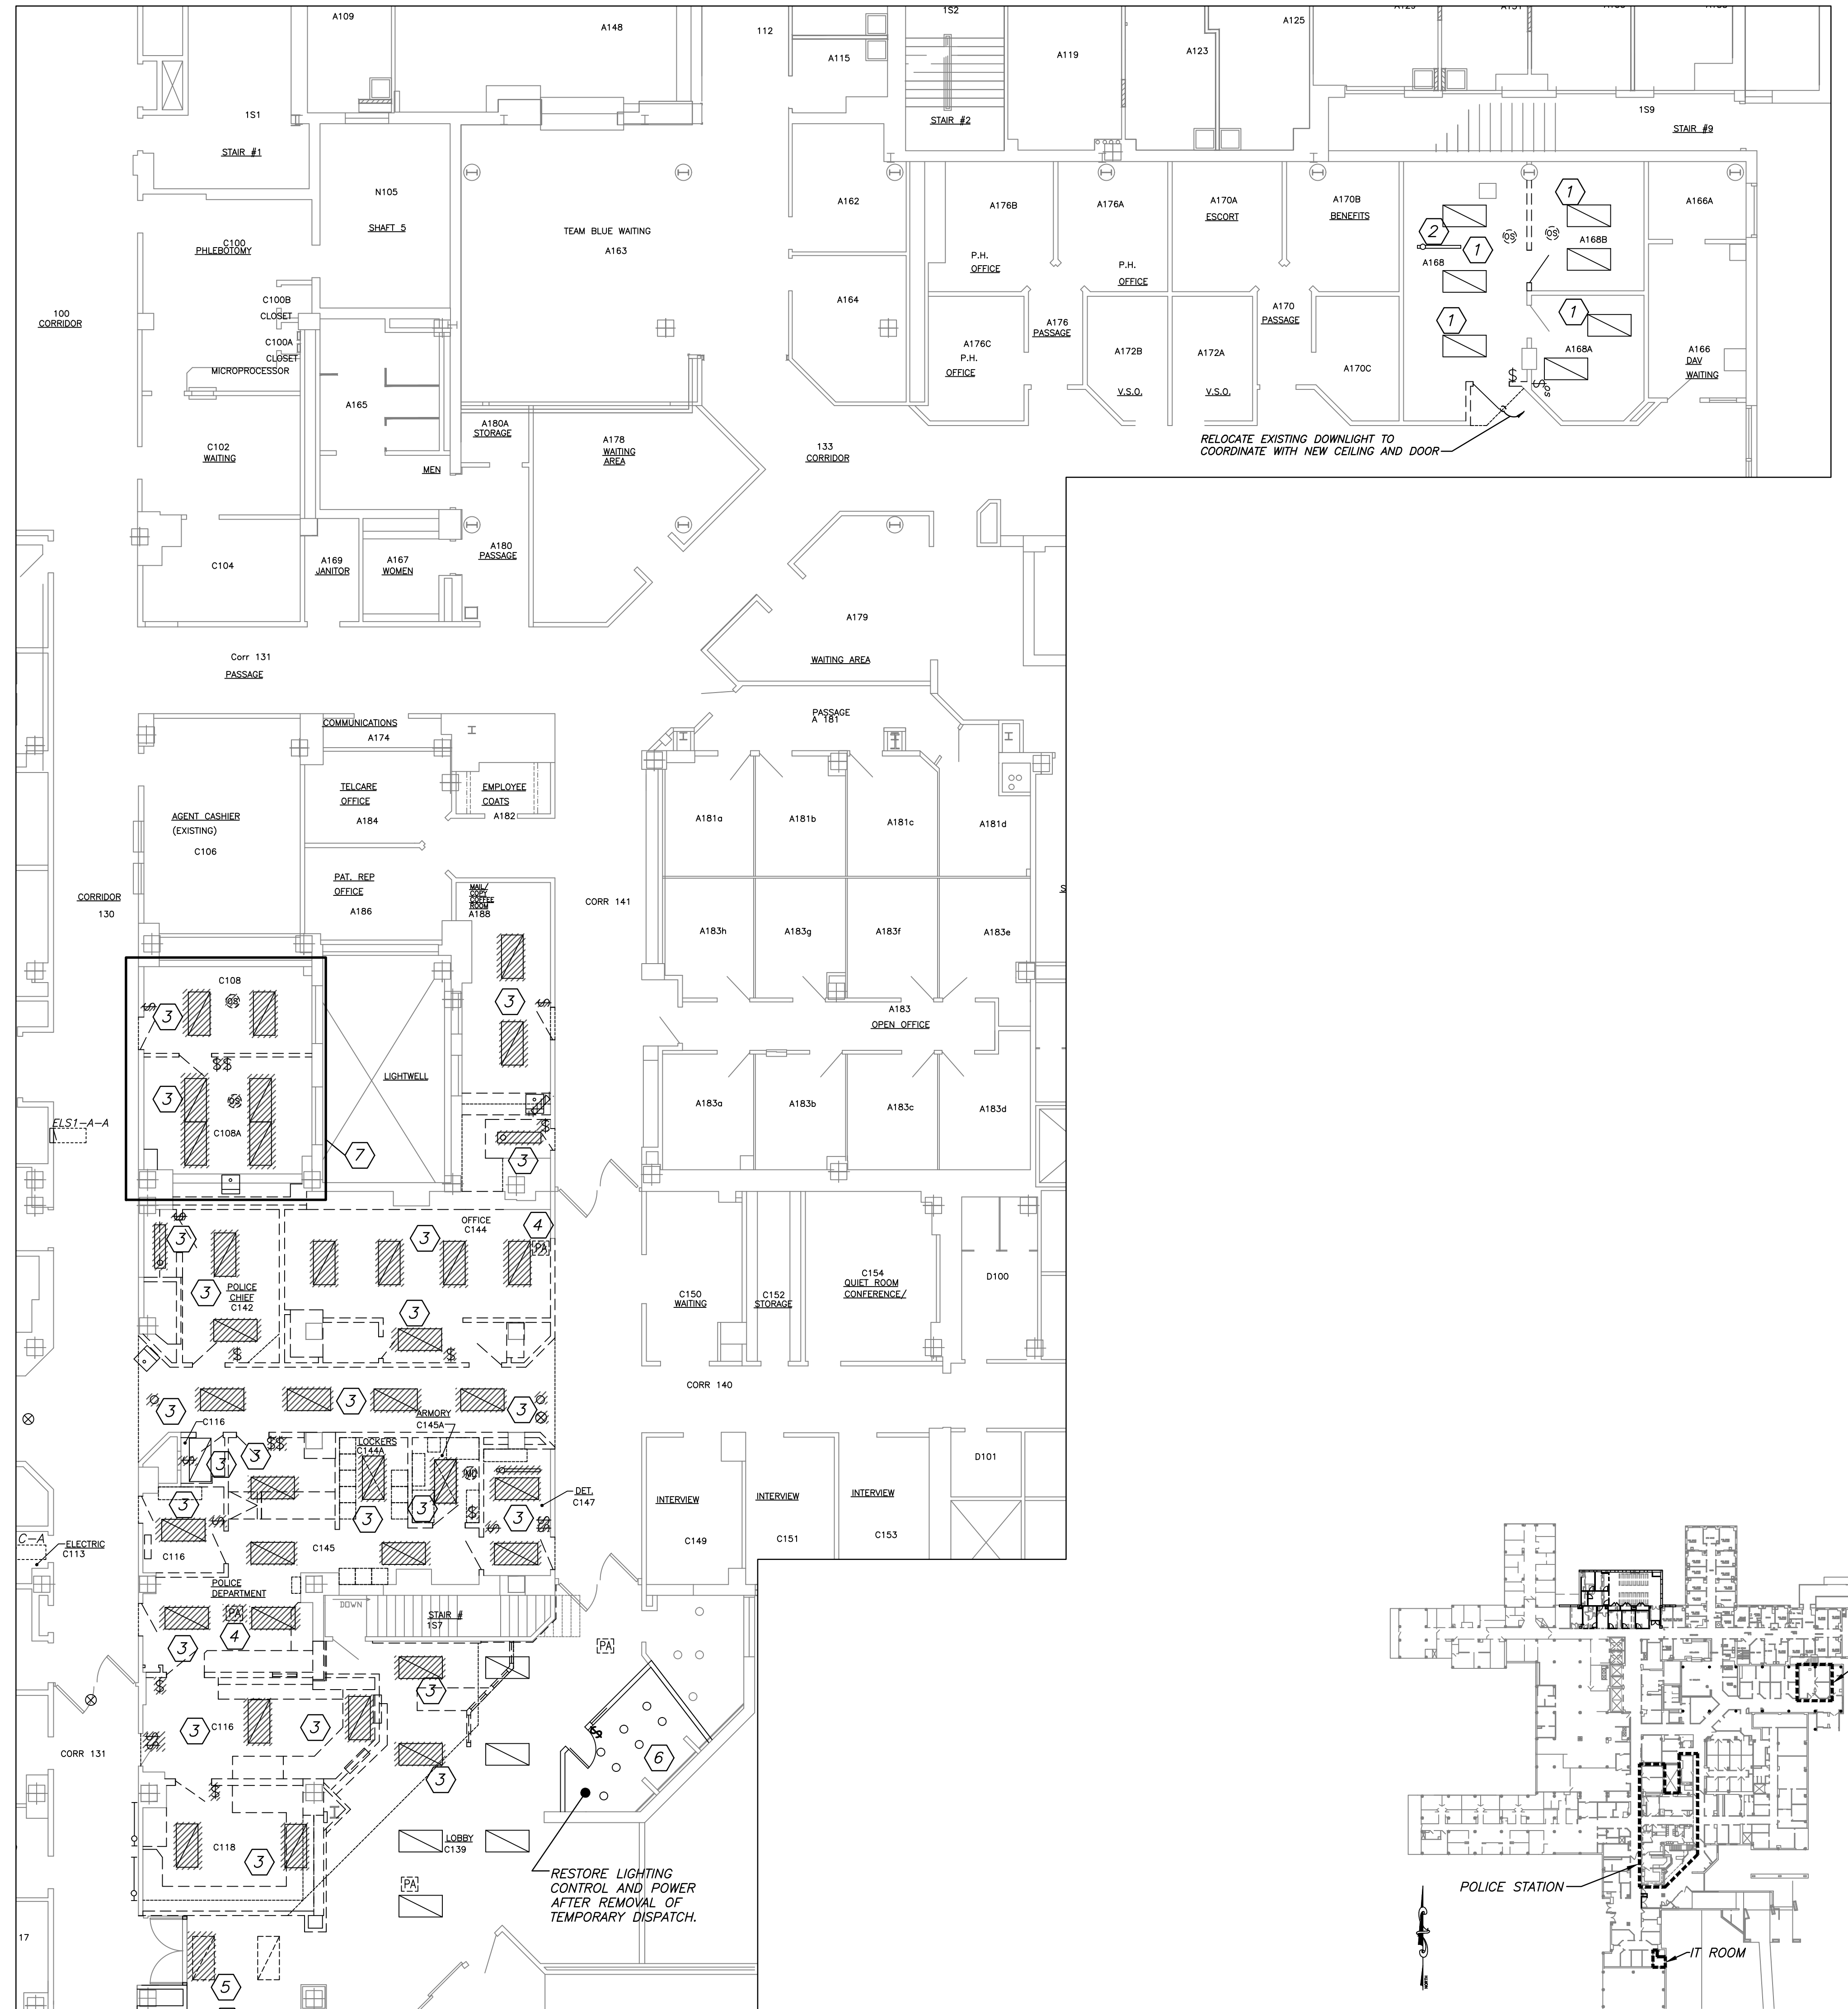

**1 ELECTRICAL LIGHTING DEMOLITION PART PLAN**  
**DE1** SCALE: 1/8" = 1'-0"

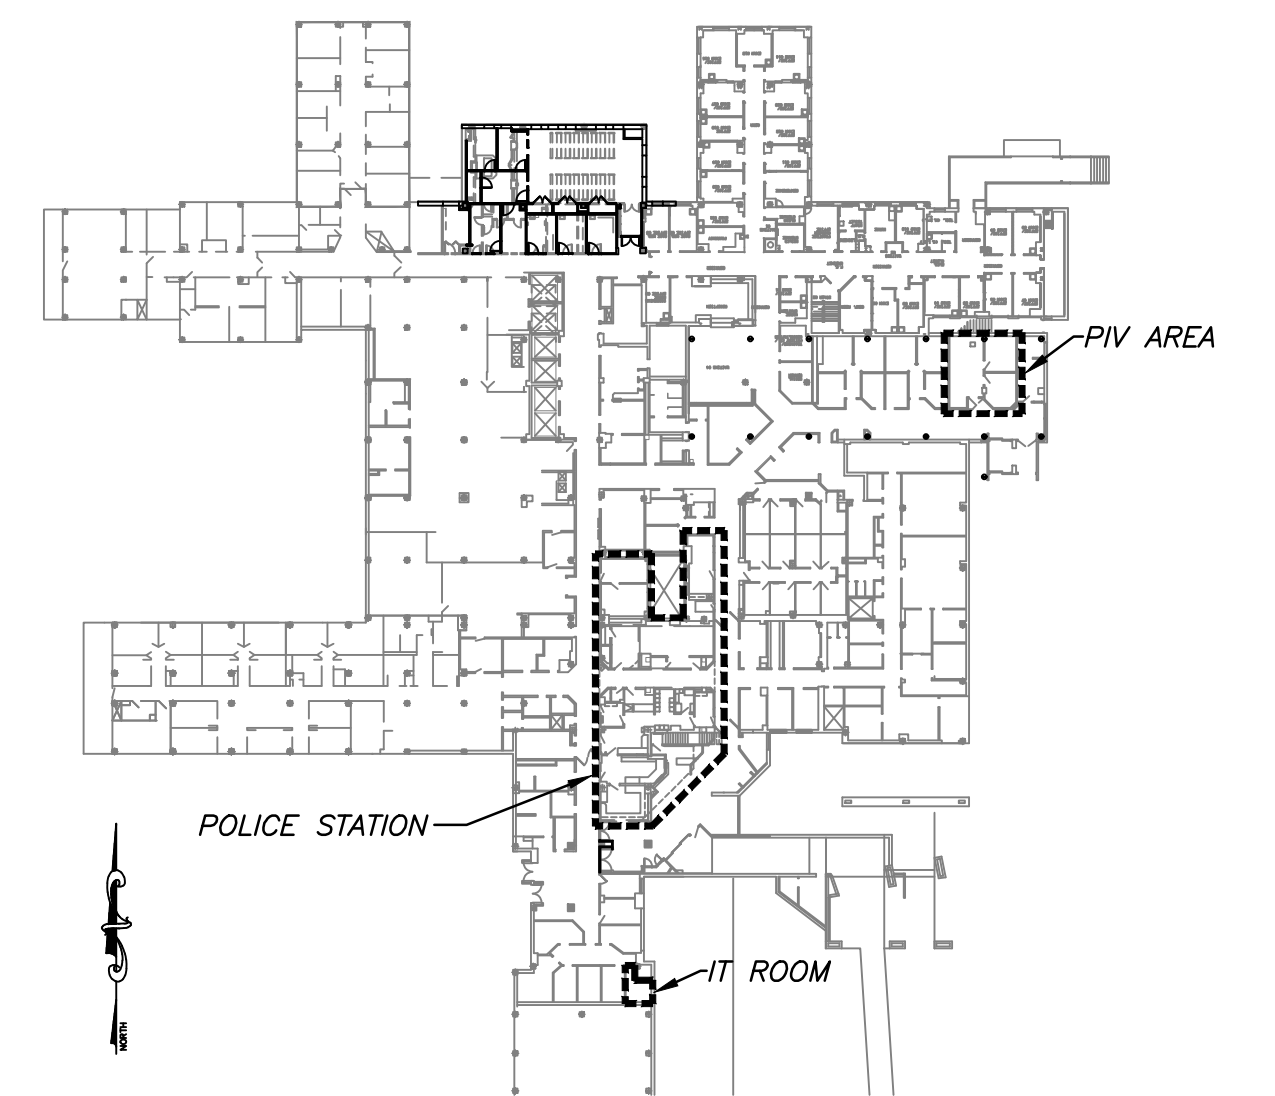

**KEY PLAN**  
**NOT TO SCALE**

VA FORM 08-6231

**Engineering and  
Land Surveying, P.C.**

---

1533 Crescent Road - Clifton Park, NY 12065



4 Collamer Road, Malta, NY 12020      PH (518) 581-9428      FX (518) 580-9325

Approved: Project Director

Date	Checked	Drawn
4/19/13	- PJM	- PJM

DE1  
Dwg. 25 of 31



Department of  
Veterans Affairs