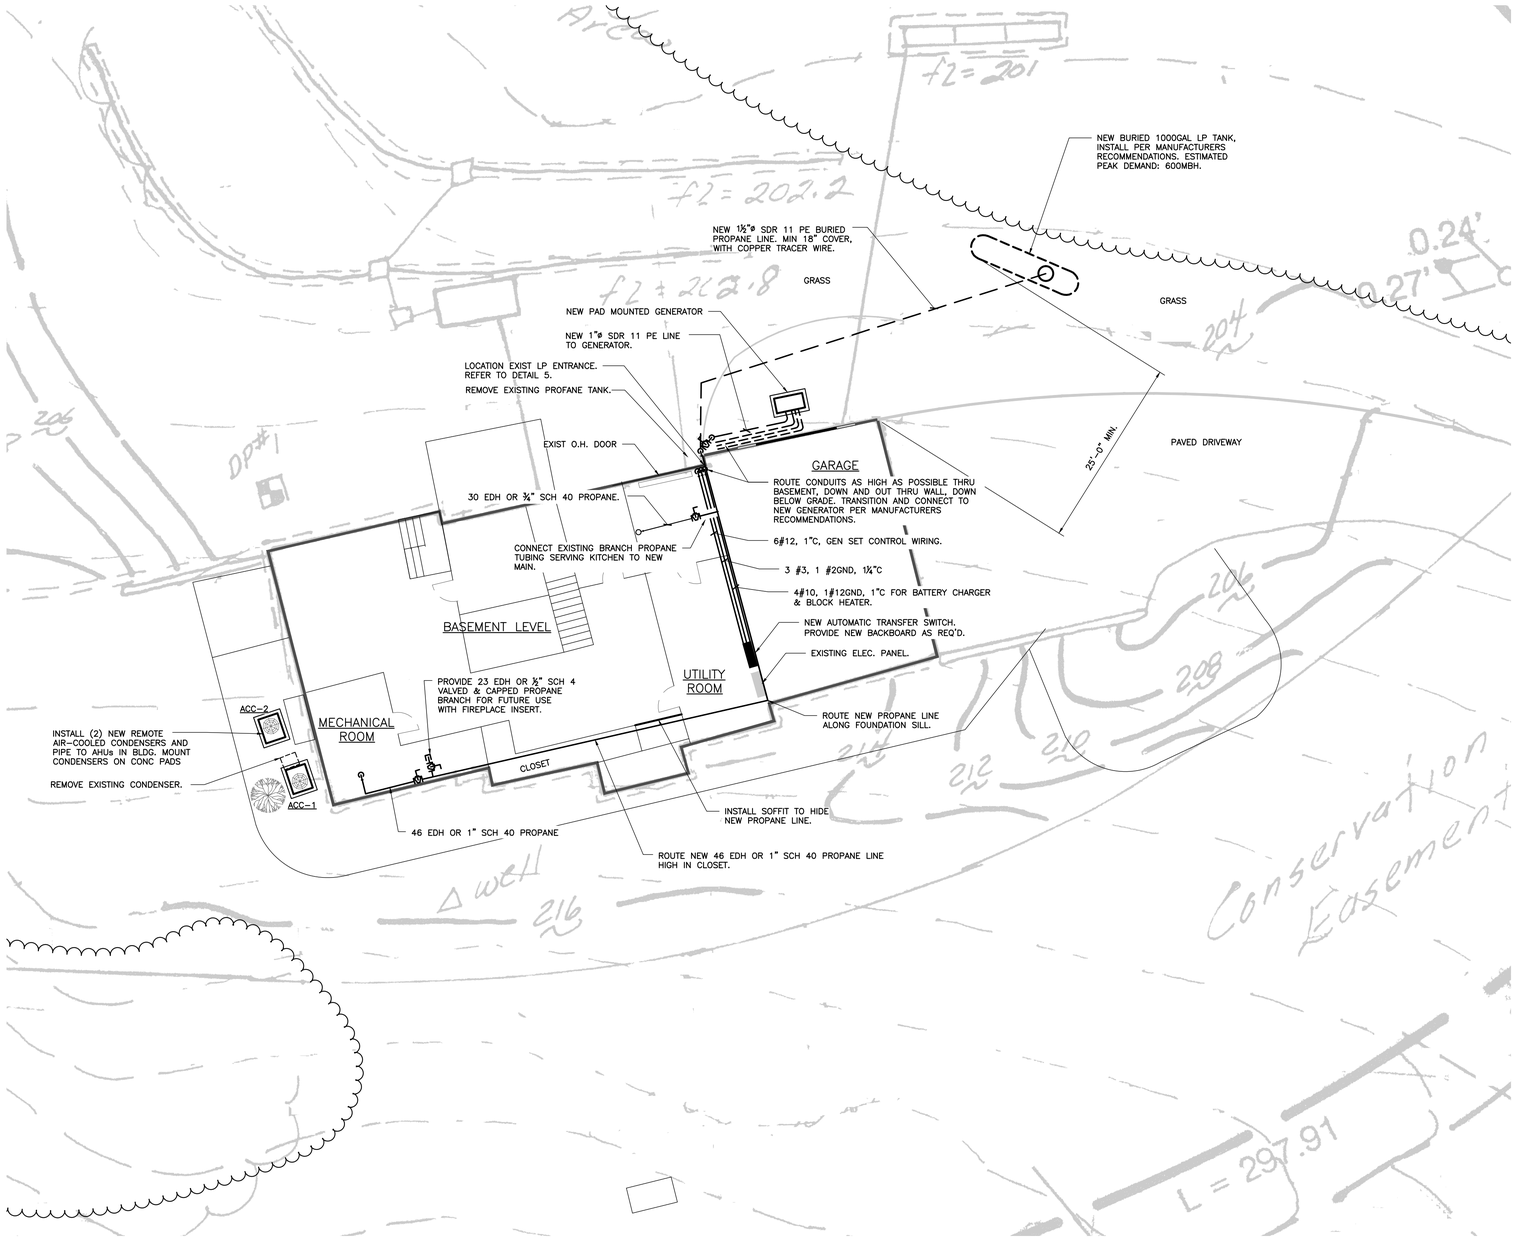

1 SITE PLAN
1"=10'

NORTH

GENERAL NOTES:

1. PIPE AND CONDUIT ROUTINGS SHOWN ARE SCHEMATIC IN NATURE, CONTRACTOR TO VERIFY ACTUAL ROUTINGS AND COORDINATE WITH OTHER TRADES PRIOR TO THE START OF WORK.
2. SEAL ALL EXTERIOR WALL PENETRATIONS WEATHERTIGHT.
3. SITE PLAN BACKGROUND IS FROM DRAWING TITLED "SITE DEVELOPMENT PLAN" DATED OCT. 05 1992 REPAIRED BY BERNARD J. BISSON, P.E. CONSULTING ENGINEER, 120 BURWELL ROAD, R.F.D. 2, WINSTEAD, CT. 06098.

NOTICE

FORTY-EIGHT (48) HOURS PRIOR TO ANY SITE WORK THE CONTRACTOR SHALL CALL "CALL-BEFORE-YOU-DIG" 1-800-922-4455 AND REQUEST THAT ALL UNDERGROUND UTILITIES BE TRACKED. SITE WORK SHALL NOT PROCEED UNLESS ALL UTILITIES ARE CLEARLY MARKED. IF MARKINGS ARE DISTURBED BEFORE SITE WORK IS PERFORMED CONTRACTOR SHALL TAKE EVERY MEASURE NECESSARY TO MAINTAIN INFORMATION CONCERNING LOCATION OF EXISTING UTILITIES TO ENSURE THAT THE UTILITIES ARE NOT DAMAGED.

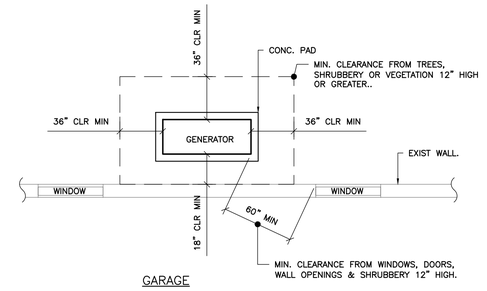

2 DETAIL - GENERATOR POSITIONING
NTS

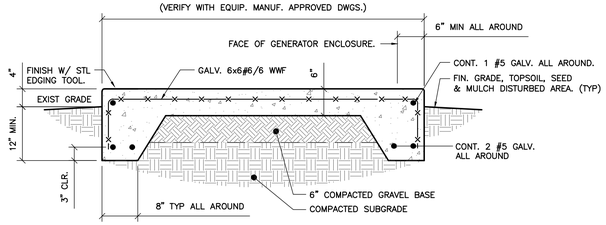

3 SECTION AT GENERATOR/CONDENSER PAD
NTS

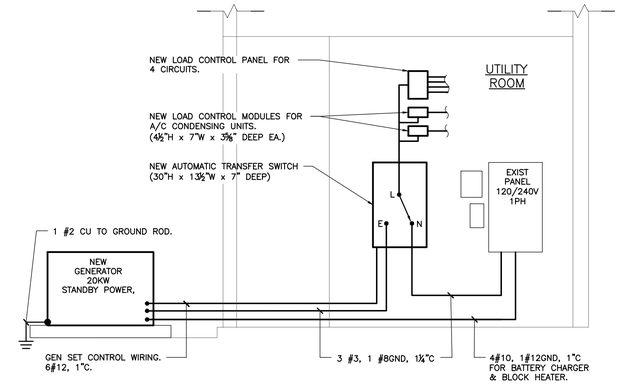

4 ELECTRICAL RISER DIAGRAM
NTS

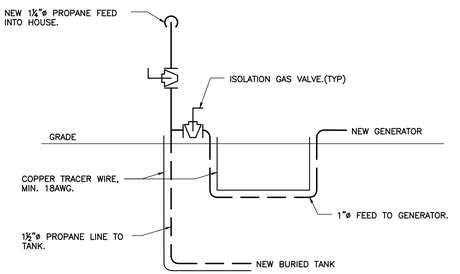

5 GAS PIPING SCHEMATIC
NTS

PROGRESS 5/2/13
NOT FOR CONSTRUCTION

REV.	DESCRIPTION OF REVISION	DATE	APPR.

Loureiro Engineering Associates, Inc.
100 Northwest Drive • Plainville, Connecticut 06062
Phone: 860-747-6181 • Fax: 860-747-8822
An Employee Owned Company
Email: info@loureiro.com

Loureiro
Engineering • Construction • EMS • Energy • Water

SCALE: NOTED
COMM. NO.: 48KA3.01
DRAWN BY: JTF
DATE:
APPROVED BY: RLS/JKH
DATE:

NEW STANDBY GENERATOR INSTALLATION
5 HALLVIEW DRIVE, SIMSBURY CT

PART SITE PLAN
SECTIONS AND DETAILS

Loureiro
Engineering • Construction • EMS • Energy • Water

DRAWING
SI-1

SHEET NO. 1 NO. OF SHEETS 1

G:\AUTOCAD\PROJECTS\48KA3D\DWGS\SI-1.DWG Tabs: SI-1 Saved: 5/2/2013 8:47 AM Plotted: 5/2/2013 8:48 AM