

FIRE SPRINKLER KEYNOTES


- 1 REMOVE EXISTING FIRE SPRINKLER BACK TO MAINS. INSTALL NEW PIPING, FLOW SWITCH AND VALVES FOR EXPANDED FIRE PROTECTION ZONE. DEMOLITION WORK TO OCCUR AFTER HOURS TO PREVENT DISRUPTION TO THE MEDICAL CENTER.
- 2 PROVIDE NEW FIRE PROTECTION SPRINKLER ZONE WITH PIPING, FLOW SWITCH AND VALVES.
- 3 REMOVE AND REPLACE FIRE PROTECTION SPRINKLER SYSTEM IN REMODEL AREA TO PROVIDE 100% COVERAGE.
- 4 ORDINARY HAZARD GROUP 1 AREA.
- 5 NEW F.P. SPRINKLER PIPING TO NEW CONSTRUCTION AREA.

NOTE: NOT ALL KEYNOTES MAY BE USED ON EACH PLAN



1F BASEMENT FLOOR FIRE SUPPRESSION PLAN

1/16" = 1'-0"

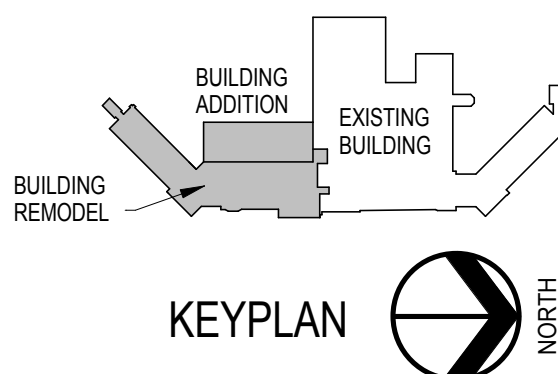

FULLY SPRINKLERED  
100% CONSTRUCTION DOCUMENTS

<b>CONSULTANTS:</b>			<b>ARCHITECTS/ ENGINEERS:</b>		<b>Drawing Title</b> BASEMENT FLOOR FIRE SUPPRESSION PLAN		<b>Project Title</b> Sioux Falls VA Health Care System Acute Inpatient Medical Unit Addition and Renovation		<b>Project Number</b> 04100857		<b>Office of Construction and Facilities Management</b>  		
			TSP, Inc. 1112 N. West Ave. Sioux Falls, SD 57104 phone: (605) 336-1160 fax: (605) 336-7926 www.teamtsp.com 		Approved: Project Director		Location VA Medical Center 2801 W. 22nd Street, PO Box 5046 Sioux Falls, SD 57117-5046		<b>Building Number</b> 5				
						Date 08/06/2012		Checked BSW		Drawn RAK		<b>Drawing Number</b> <b>5-FX1B1</b> Dwg. 52 of 123	