## MECH DEMO GENERAL NOTES

1. WHERE EQUIPMENT AND/OR FIXTURES ARE INDICATED TO BE REMOVED, THE EXISTING SERVICES SHALL BE CAPPED AND CONCEALED BEHIND FINISHED SURFACES. ABANDONED BRANCH SERVICES SHALL BE REMOVED BACK TO THE MAINS AND CAPPED, UNLESS OTHERWISE INDICATED.
2. CAP ANY ABANDONED OR UNUSED PIPE AND/OR DUCT OPENINGS.
3. THIS CONTRACTOR SHALL BE RESPONSIBLE FOR PATCHING AND PAINTING TO MATCH EXISTING WALLS, FLOORS, AND CEILINGS.
4. HYDRONIC AND DOMESTIC PIPING SHALL BE PROPERLY AND THOROUGHLY CLEANED BEFORE PUTTING INTO PERMANENT SERVICES.

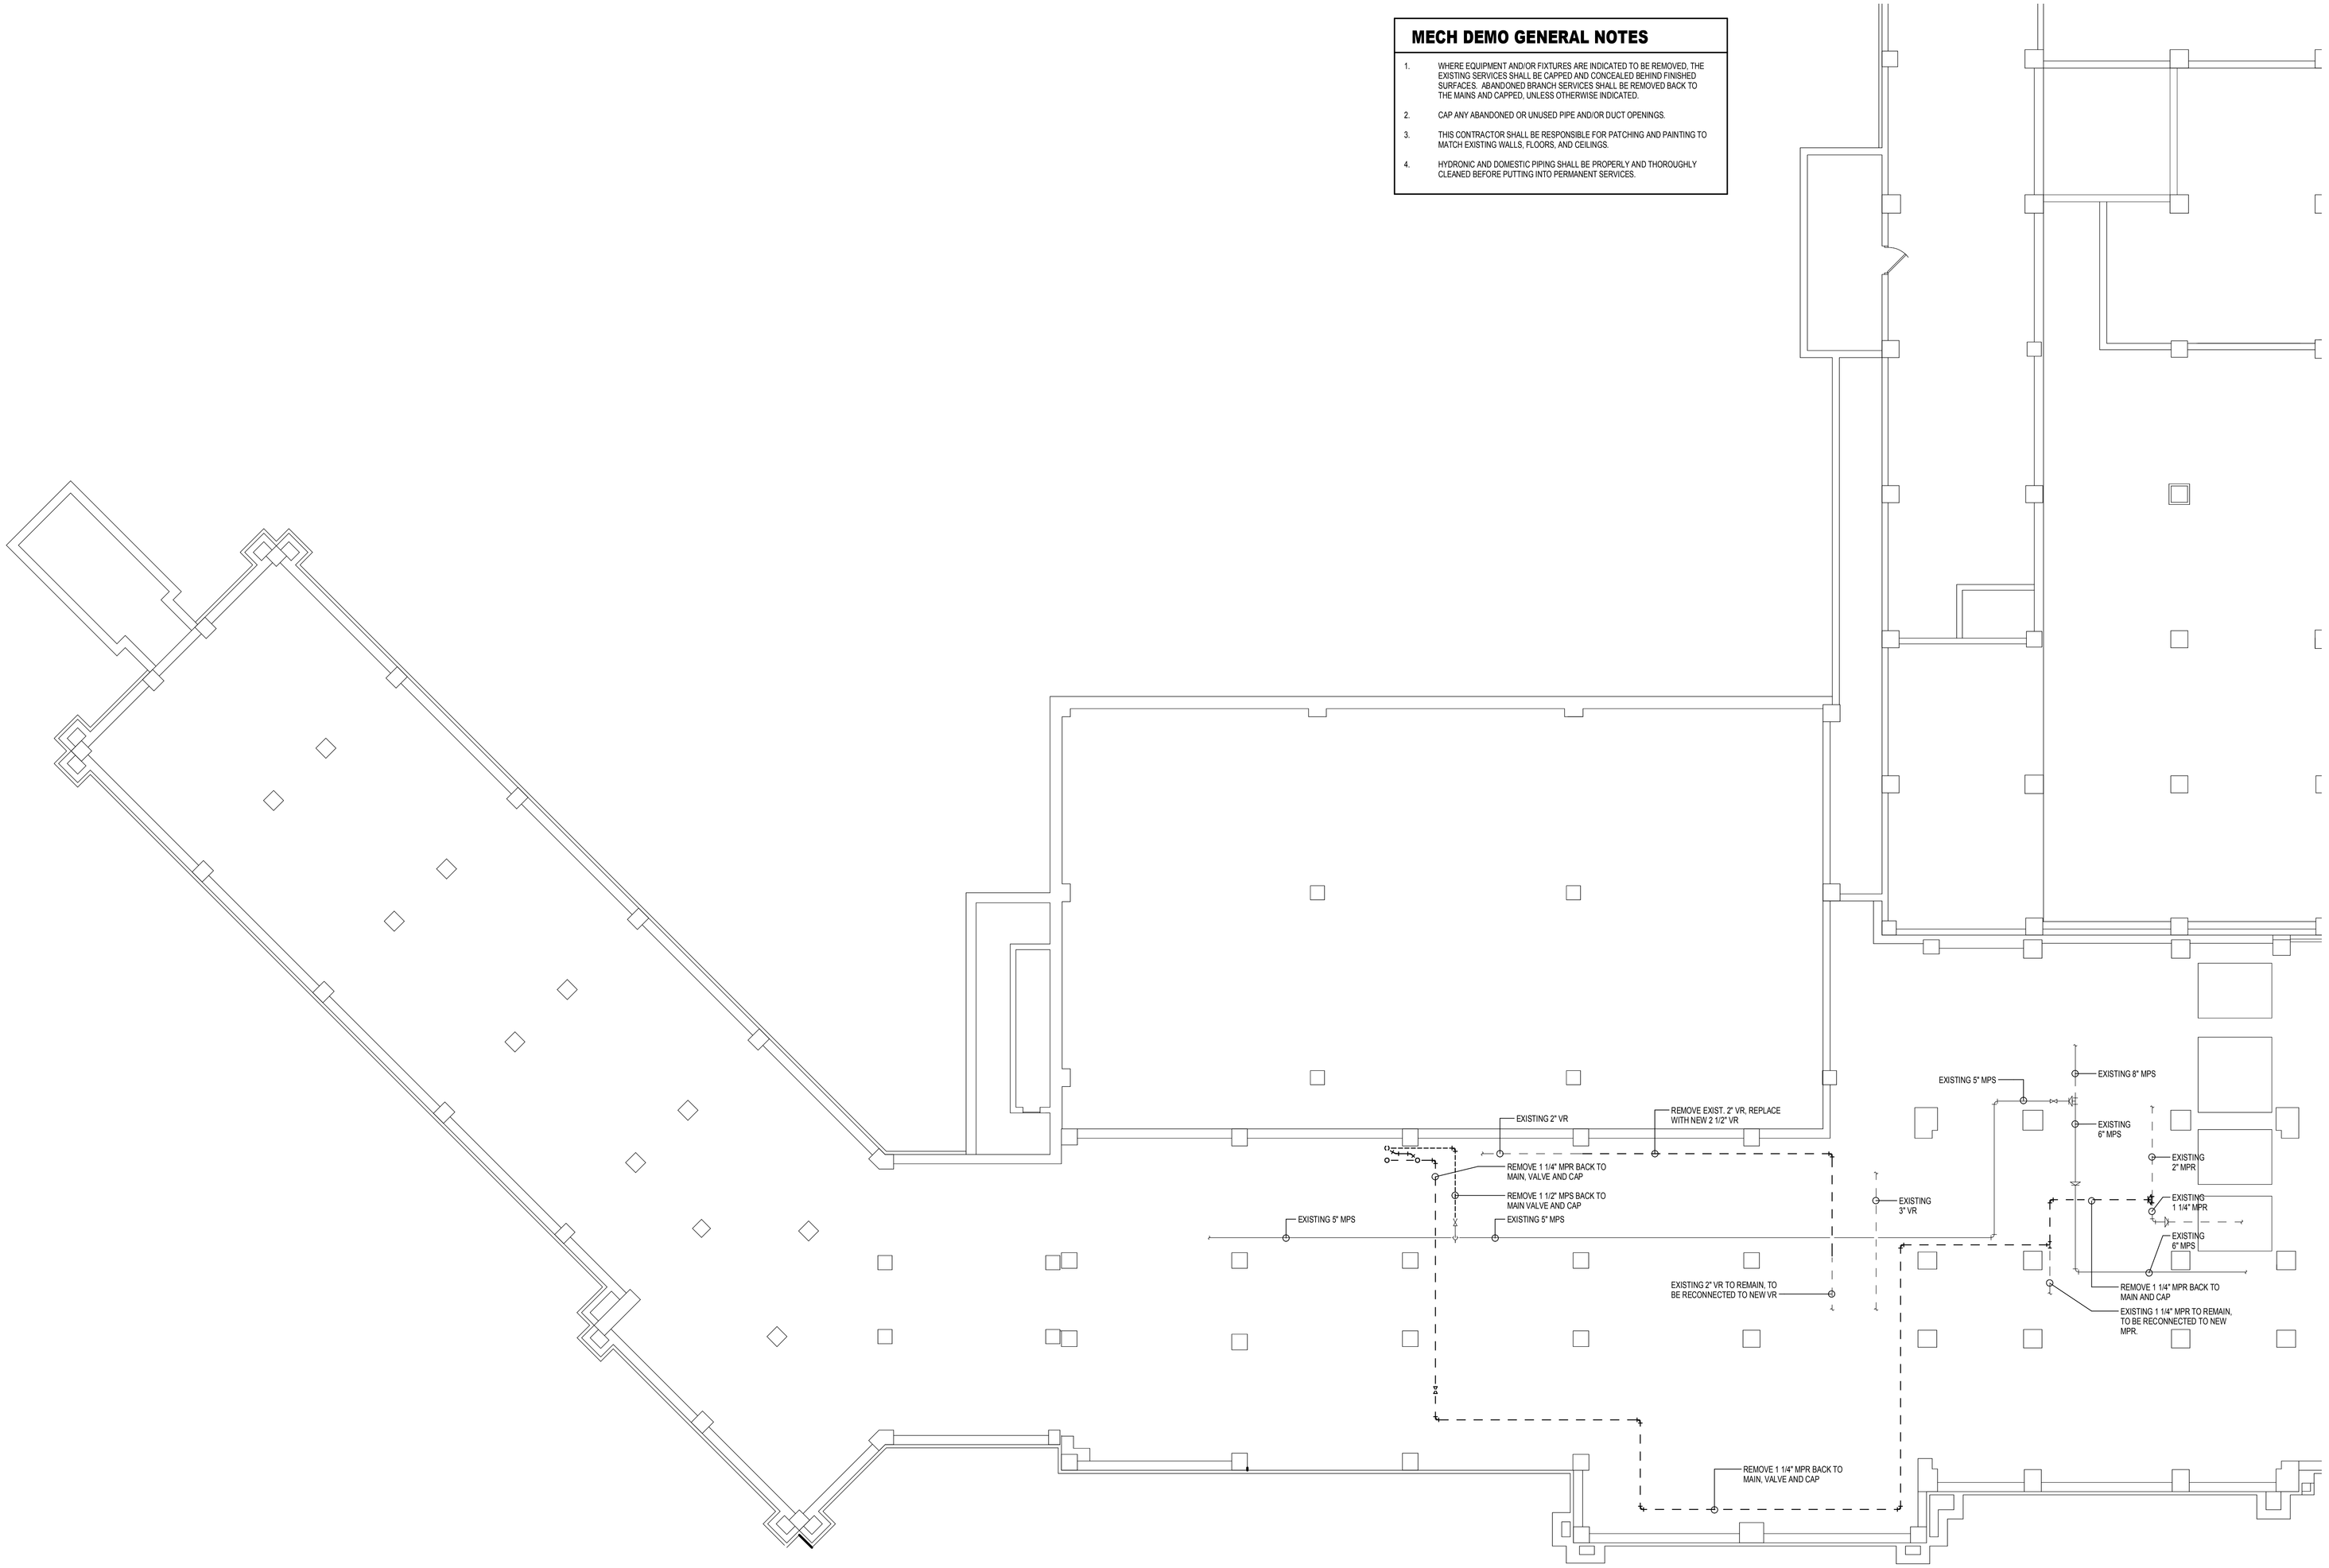





**1F BASEMENT FLOOR PIPING DEMOLITION PLAN**
1/8" = 1'-0"

**FULLY SPRINKLERED**
**100% CONSTRUCTION DOCUMENTS**

| MARK | REVISION DESCRIPTION | DATE |
|---|---|---|

**CONSULTANTS:**

REGISTERED PROFESSIONAL ENGINEER
REG. NO. 9068
BRIAN S. WEBSTER
SOUTH DAKOTA
DATE 8/06/2012

**ARCHITECTS/ ENGINEERS:**

TSP, Inc.
1112 N. West Ave,
Sioux Falls, SD 57104
phone: (605) 336-1160
fax: (605) 336-7926
www.teamtsp.com

TSP
To Solve. To Excel. Together.

Drawing Title: **BASEMENT FLOOR PIPING DEMOLITION PLAN**

Approved: Project Director

Project Title: **Sioux Falls VA Health Care System Acute Inpatient Medical Unit Addition and Renovation**

Location: VA Medical Center, 2501 W. 22nd Street, PO Box 5046, Sioux Falls, SD 57117-5046

Date: 08/06/2012 | Checked: BSW | Drawn: BSW

Project Number: 04100857
Building Number: 5
Drawing Number: **5-MD1B1**
Dwg. 74 of 123

Office of Construction and Facilities Management
Department of Veterans Affairs

C:\Users\costellej\Documents\04100857_VA_MEP1Z_Central_costellej2.rvt
8/6/2012 12:00:23 PM

VA FORM 08-6231

Copyright TSP, Inc. 2012