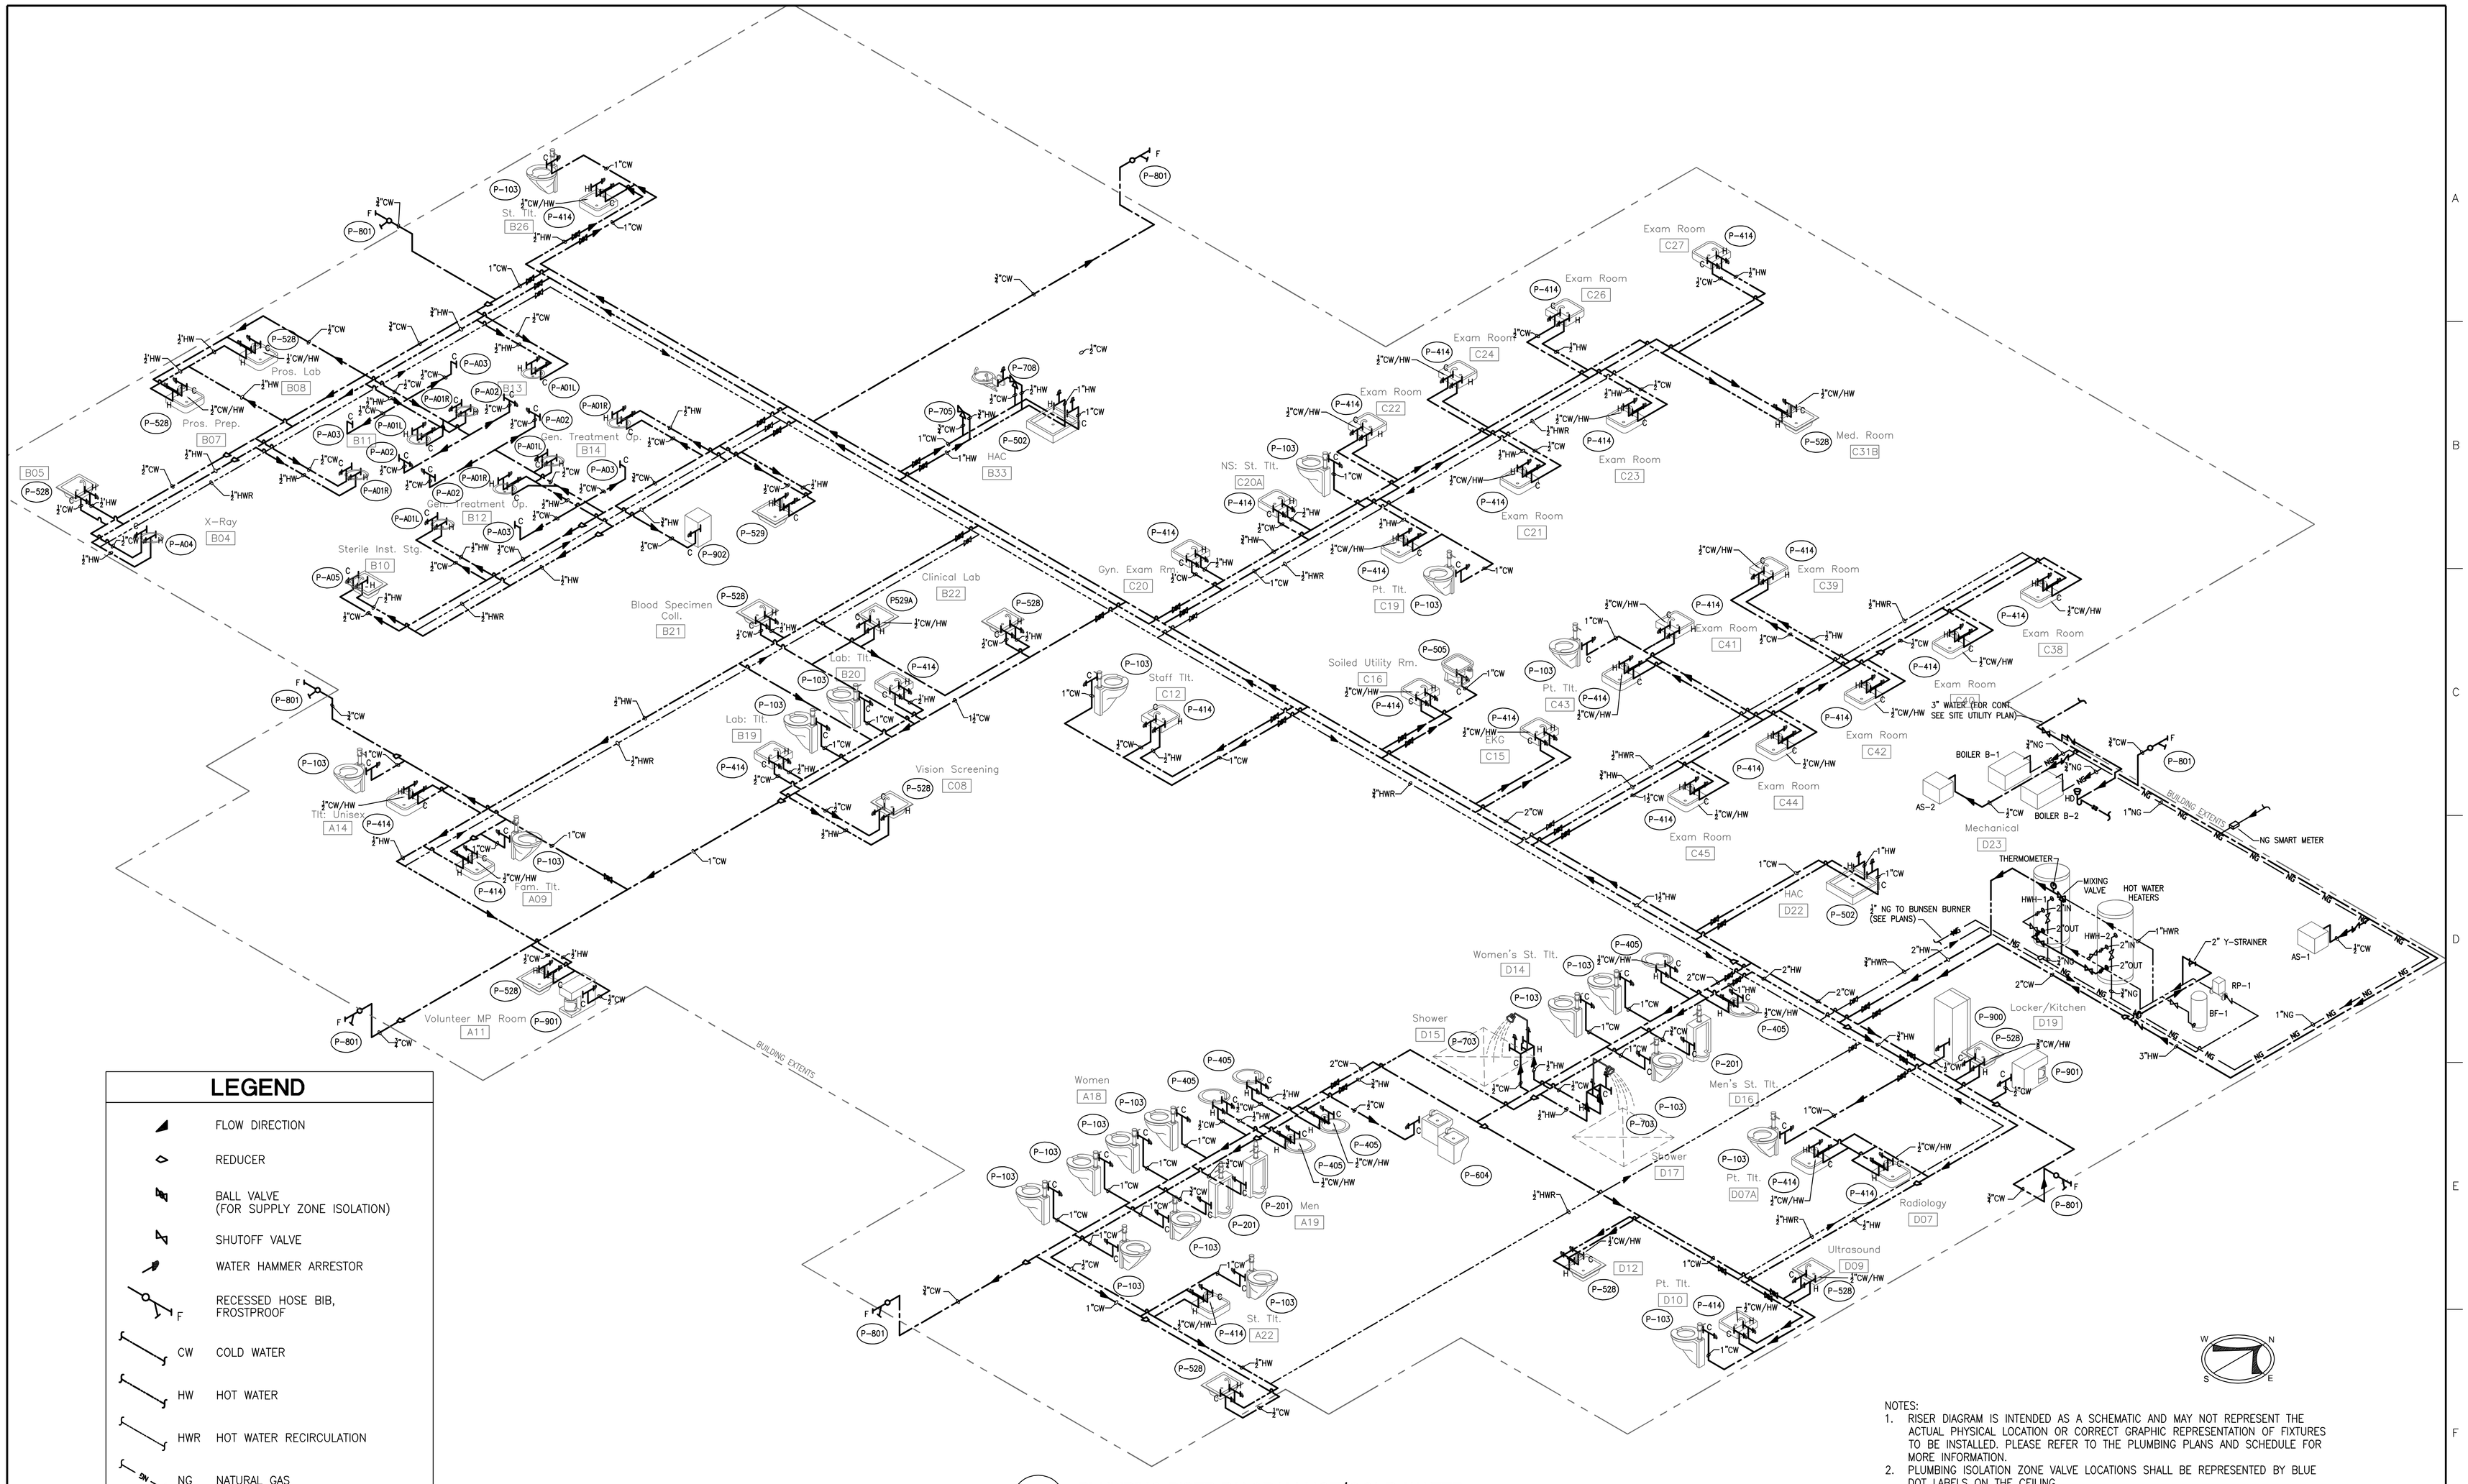

LEGEND

	FLOW DIRECTION
	REDUCER
	BALL VALVE (FOR SUPPLY ZONE ISOLATION)
	SHUTOFF VALVE
	WATER HAMMER ARRESTOR
F	RECESSED HOSE BIB, FROSTPROOF
CW	COLD WATER
HW	HOT WATER
HWR	HOT WATER RECIRCULATION
NG	NATURAL GAS
P-101	PLUMBING FIXTURE DESIGNATION (SEE DWG. PL601 FOR SCHEDULE)

1 PLUMBING RISER DIAGRAM HOT/COLD WATER

NOTES:
1. RISER DIAGRAM IS INTENDED AS A SCHEMATIC AND MAY NOT REPRESENT THE ACTUAL PHYSICAL LOCATION OR CORRECT GRAPHIC REPRESENTATION OF FIXTURES TO BE INSTALLED. PLEASE REFER TO THE PLUMBING PLANS AND SCHEDULE FOR MORE INFORMATION.
2. PLUMBING ISOLATION ZONE VALVE LOCATIONS SHALL BE REPRESENTED BY BLUE DOT LABELS ON THE CEILING.
3. ALL COLD, HOT AND RECIRC. PIPING TO BE INSTALLED ABOVE THE CEILING.
4. HWH TO BE SET AT 140°F. MIXING VALVE DISCHARGE TO BE SET AT 110°F.
5. DEDUCTIVE ALTERNATE WILL BLANK PLUMBING IN ROOMS A22 THROUGH A27.

FINAL SUBMISSION / FULLY SPRINKLERED

Revisions	Date

CONSULTANTS:

CIVIL:
KENNETH HORNE & ASSOCIATES
7201 NORTH 9TH AVENUE, STE. 6
PENSACOLA, FLORIDA 32504
PH: (850) 471-9005
FX: (850) 471-0093

LANDSCAPE ARCHITECT:
CSA GROUP, INC.
6300 PICCADILLY SQUARE DRIVE
MOBILE, ALABAMA 36609
PH: (251) 344-4023
FX: (251) 344-4052

COMM/IDS:
SCHMIDT CONSULTING GROUP, INC.
40 S. PALAFOX PLACE, STE. 300
PENSACOLA, FLORIDA 32502
PH: (850) 438-0050
FX: (850) 432-8631

SURVEYORS:
KCI TECHNOLOGIES, INC.
10401 HIGHLAND MANOR DRIVE, SUITE 120
TAMPA, FLORIDA 33610
PH: (813) 740-2300

W.W. BOLTON CERTIFICATE NO. 56537 STATE OF FLORIDA PROFESSIONAL ENGINEER

ARCHITECT/ENGINEERS:

BES DESIGN/BUILD

BES DESIGN/BUILD, LLC
766 Middle St, Fairhope, AL 36532
Phone: 251.990.5778 Fax: 251.990.3716

Drawing Title	PLUMBING RISER DIAGRAM COLD AND HOT WATER
Approved: Project Director	
Project Title	CONSTRUCT VA OUTPATIENT CLINIC, PANAMA CITY
Location	PANAMA CITY, FLORIDA
Date	APRIL 2013
Checked	WWB
Drawn	JLL
Project Number	520-326
Building Number	-
Drawing Number	PL503
Dwg. 14 of 16	

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231