PLAN NORTH

N

LIFT STATION, MPA-14,16,18

VA PROVIDED GENERATOR, INSTALLED BY CONTRACTOR

300 KVA DRY-TYPE T-FORMER, SEE ONE-LINE

REFER TO DUCTBANK DETAIL "B" THIS SHEET.

REFER TO DUCTBANK DETAIL "A" THIS SHEET.

SEE SHEET EP102 FOR DOCK LIFT

RPC-16 FOR CAMERA

RPC-16 FOR CAMERAS

RPC-16 FOR CAMERAS

RPC-16 FOR CAMERA

MP

ATS

FOIR 3" LB 3724

FOIR 3" LB 3724

S88°38'37"E 499.94'

S01°20'37"W 514.89'

N89°43'49"E 513.97'

6' CHAIN LINK FENCE ON LINE

6' CHAIN LINK FENCE 0.34' OUT

6' CHAIN LINK FENCE

NAVAL CONC. MONUMENT OO-51 N:423608.71 E:1575925.34 ELEV:14.59

FOIR 3" LB 3274

KCI TBM#2 N:423613.05 E:1575569.45 ELEV:15.43

FCM 4x4 0.67' NORTH OF LINE

KCI TBM#3 N:423560.81 E:1575468.32 ELEV:14.95

N82°53'18"W 950.07'

12"OAK

16"OAK

14"OAK

BURIED HEADWALL

2" VERT PVC PIPE

6' WOOD PRIVACY FENCE

CABLE MARKER

GAS MARKER

VERT PVC PIPES

SV

6' WOOD

2 DUCTBANK DETAIL "A"

NTS

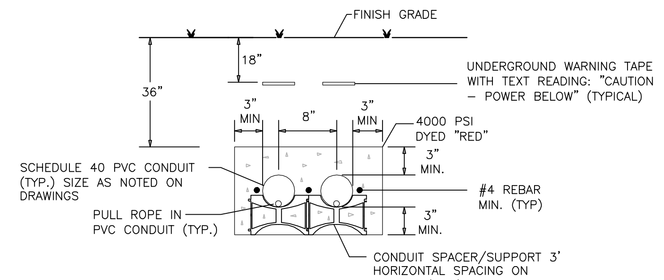

NOTES:

1. UNDERGROUND CONDUITS SHALL BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR IN ACCORDANCE WITH THE OWNER'S REQUIREMENTS.
2. MINIMUM BENDING RADIUS FOR UNDERGROUND CONDUITS AND CABLES SHALL BE 12" FOR 2" CONDUIT.
3. UNDERGROUND CONDUCTORS SHALL BE FURNISHED AND INSTALLED PER SHT. EP-601

3 DUCTBANK DETAIL "B"

NTS



NOTES:

1. UNDERGROUND CONDUITS SHALL BE FURNISHED AND INSTALLED BY THE ELECTRICAL CONTRACTOR IN ACCORDANCE WITH THE OWNER'S REQUIREMENTS.
2. MINIMUM BENDING RADIUS FOR UNDERGROUND CONDUITS AND CABLES SHALL BE 12" FOR 2" CONDUIT.
3. UNDERGROUND CONDUCTORS SHALL BE FURNISHED AND INSTALLED PER

ELECTRICAL SITE PLAN DEDUCTIVE ALTERNATE #1

30 0 15 30 60

1 INCH = 30 FEET

FINAL SUBMISSION / FULLY SPRINKLERED

Revisions	Date

CONSULTANTS:

CIVIL:
KENNETH HORNE & ASSOCIATES
7201 NORTH 9TH AVENUE, STE. 6
PENSACOLA, FLORIDA 32504
PH: (850) 471-9005
FX: (850) 471-0093

LANDSCAPE ARCHITECT:
CSA GROUP, INC.
6300 PICCADILLY SQUARE DRIVE
MOBILE, ALABAMA 36609
PH: (251) 344-4023
FX: (251) 344-4052

COMM/IDS:
SCHMIDT CONSULTING GROUP, INC.
40 S. PALAFOX PLACE, STE. 300
PENSACOLA, FLORIDA 32502
PH: (850) 438-0050
FX: (850) 432-8631

SURVEYORS:
KCI TECHNOLOGIES, INC.
10401 HIGHLAND MANOR DRIVE, SUITE 120
TAMPA, FLORIDA 33610
PH: (813) 740-2300

W.R. BOLTON CERTIFICATE NO. 56537 STATE OF FLORIDA PROFESSIONAL ENGINEER

ARCHITECT/ENGINEERS:

BES DESIGN/BUILD

BES DESIGN/BUILD, LLC
766 Middle St, Fairhope, AL 36532
Phone: 251.990.5778 Fax: 251.990.3716

Drawing Title: ELECTRICAL SITE PLAN

Approved: Project Director

Project Title: CONSTRUCT VA OUTPATIENT CLINIC, PANAMA CITY

Location: PANAMA CITY, FLORIDA

Date: APRIL 2013 | Checked: - | Drawn: GWS

Project Number: 520-326

Building Number: -

Drawing Number: ES101A1

Dwg. 1 of 6

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231