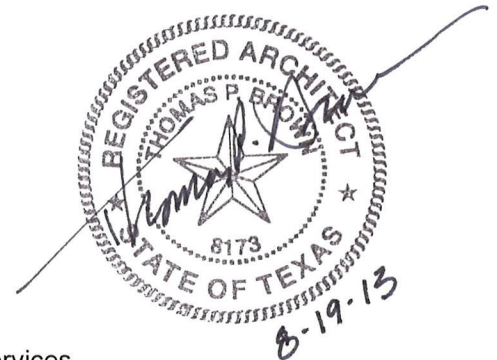


**AMENDMENT NUMBER ONE**

19 August 2013

VA Waco Install Cogen  
Waco, TXWAG Project No. 12250.000  
VA Project No. 674A4-13-301**DISTRIBUTION:**Dave Lindeman  
Ted Davison  
Nick Patterson  
Lewis Perry  
Larry Fisher  
Mike Brueggerhoff  
Lina Chtay  
David Mojica  
John Lajsal  
Dorothy Gumm Denison  
Tom Brown  
Michael SmithVA  
O'Connell Robertson  
O'Connell Robertson  
O'Connell Robertson  
Engineering 360, Inc.  
CCRD  
Belton Engineering  
Belton Engineering  
Farnsworth and Lott Construction Services  
DGD  
Wilson Architectural Group  
Wilson Architectural Group**NOTICE TO ALL BIDDERS**

This Amendment forms a part of the Contract Documents and modifies the original Project Manual and Drawings issued for bid, 24 May 2013, to the extent noted herein.

Careful note of this Amendment shall be taken by all parties of interest so that proper allowance is made in all computations, estimates and contracts and so that all trades affected are fully advised in the performance of work that will be required by them.

Items revised on Drawings are designated by a cloud line and triangle surrounding the corresponding revision number. Items revised in Project Manual are designated with an asterisk (\*) and as specified herein.

This Amendment supersedes all previous Drawings, Project Manual and instructions pertaining to these items.

**ITEM      DESCRIPTION****1.01    Sheet 225-ES1.1-Electrical Site Plan**

Add: Note 6

"Install fiber optic cable for protective relaying communication between buildings 133 and 225 utilizing existing duct banks. Provide (2) 1 1/4" conduits from entry point to breaker 'CG2', (2) 1 1/4" conduits from breaker 'CG2', (2) 1 1/4" conduits from breaker 'CG2 to breaker 'CG1', and (2) 1/4" conduits from breaker 'CG1' to the turbine/generator control console. See sheet 225-EP3.2 for communication circuits to be installed in these pathways.

**1.02    Sheet 225-FP3.1-Fire Alarm Plan Cogen Plant**

Delete: Note 2 under 'Fire Protection General Notes'.

**AMENDMENT NUMBER ONE**

19 August 2013

VA Waco Install Cogen  
Waco, TX

WAG Project No. 12250.000  
VA Project No. 674A4-13-301

Add: Note 2- "Fire Alarm Active Devices' shall be by and compatible with existing simplex-Grinnell fire alarm panel. Provide expansion module (s), if required, to accommodate new devices."

1.03 Sheet 225-EP3.2-Protective Relaying

Delete: Sheet 225-EP 3.2 dated 5/24/13

Add: Sheet 225-EP 3.2 dated 8/14/13.

1.04 Specification Volume 2

Add: section 28 10 00-Electronic Access Controls.

1.05 Specification Volume 2

Add: 28 23 00-Video Surveillance.

1.06 Specifications Volume 1 & 2

Delete: Table of Contents page 00 01 10-3 dated 05/24/13.

Add: Table of contents page 00 01 10-3 dated 08/14/13. Added new sections 28 10 00 and 28 23 00. Typical volume 1 and 2.

1.07 Specification Volume 1

Delete: section 08 90 00-Louvers and Vents:

Add: Section 08 90 00-Louvers and Vents. Revised to be aluminum wind driven rain louver as shown on drawings.

1.08 Specification Volume 1

Delete: 09 06 00 Schedule for finishes

Add: 09 06 00 Schedule for finishes. Revised to reflect paint finish for aluminum wall louvers.

1.09 Specification Volume 1

Delete: 09 91 00 Painting

Add: 09 91 00 Painting. Revised to reflect paint finish for aluminum wall louvers.

1.10 Sheet 1/MH7.2-Mechanical HVAC Controls

Add: Note 3. Chilled water valve shall modulate 100% open when outside air temperature is below 38 deg. F. (Adjustable).

**END OF AMENDMENT NUMBER ONE**