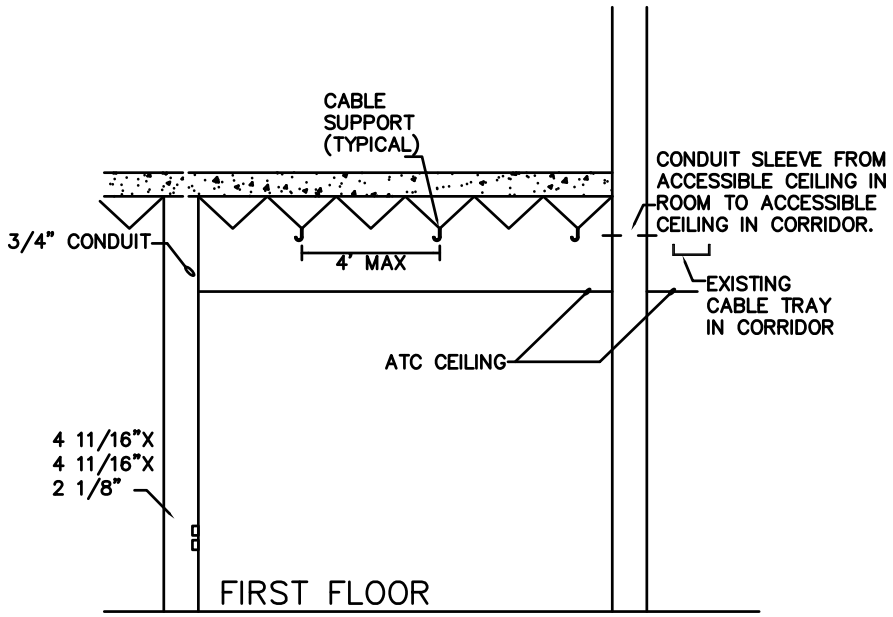

TELECOMMUNICATION HORIZONTAL PATHWAY SCHEMATIC

NO SCALE

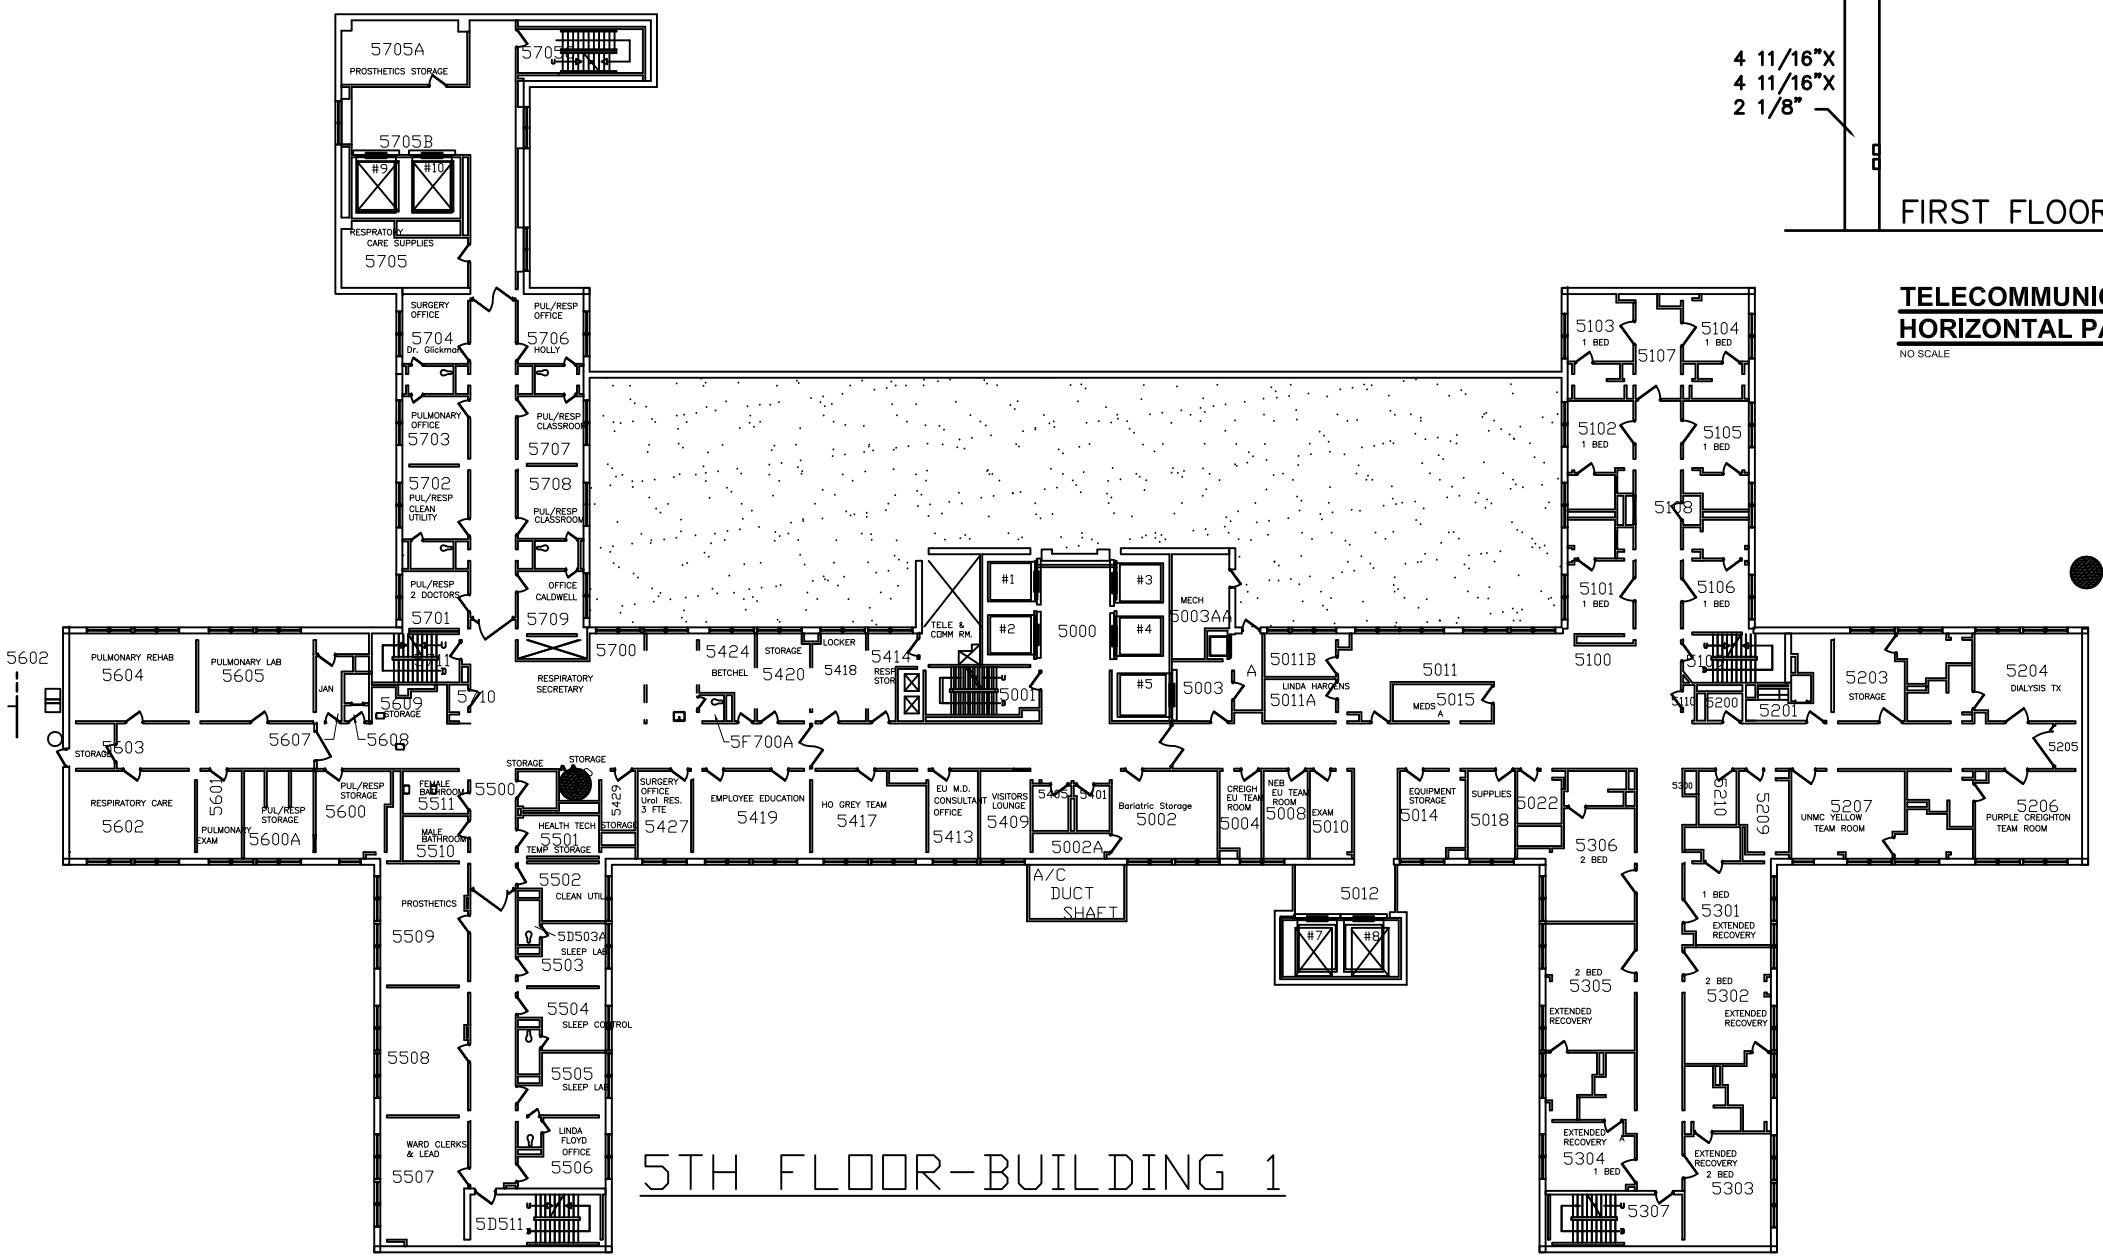

- Location of Kiosk one this floor. Provide hospital grade quad receptacle feed from Panel N5W1 in room 5609. Run conductors in EMT conduit sized according to NEC and locate outlet 16" off the finished floor or match existing. Channel wall to eliminate exposed conduit and install a flush mounted 4X4 gang box.

Provide one data drop that will be fed from room 5414. Data cable and devices will be CAT 6 certified. Cable will use existing raceways and ¾" conduit down to outlet.

The contractor shall be responsible for patching, painting, repairing or replacement of all walls, ceilings, or other building elements which are disturbed as part of the demolition or installation of electrical work.

Revisions / Date	CONSULTANTS:	ARCHITECT/ENGINEERS:	Drawing Title: 5th Floor Approved Project Director	Project Title: Site Prep for Kiosk Location Date / Checked / Drawn	Project Number Building Number Drawing Number: E1.3 Dwg. of	Office of Construction and Facilities Management

VA FORM 08-6231